

**STANDARD SPECIFICATIONS
and
INFORMATION BULLETIN**





UNION SANITARY DISTRICT
2006

UNION SANITARY DISTRICT



USD CORPORATE OFFICES
& TREATMENT PLANT

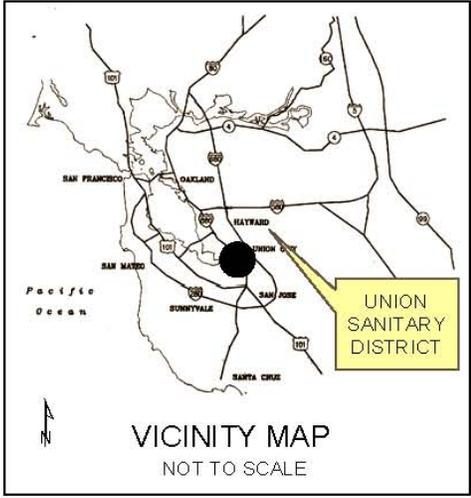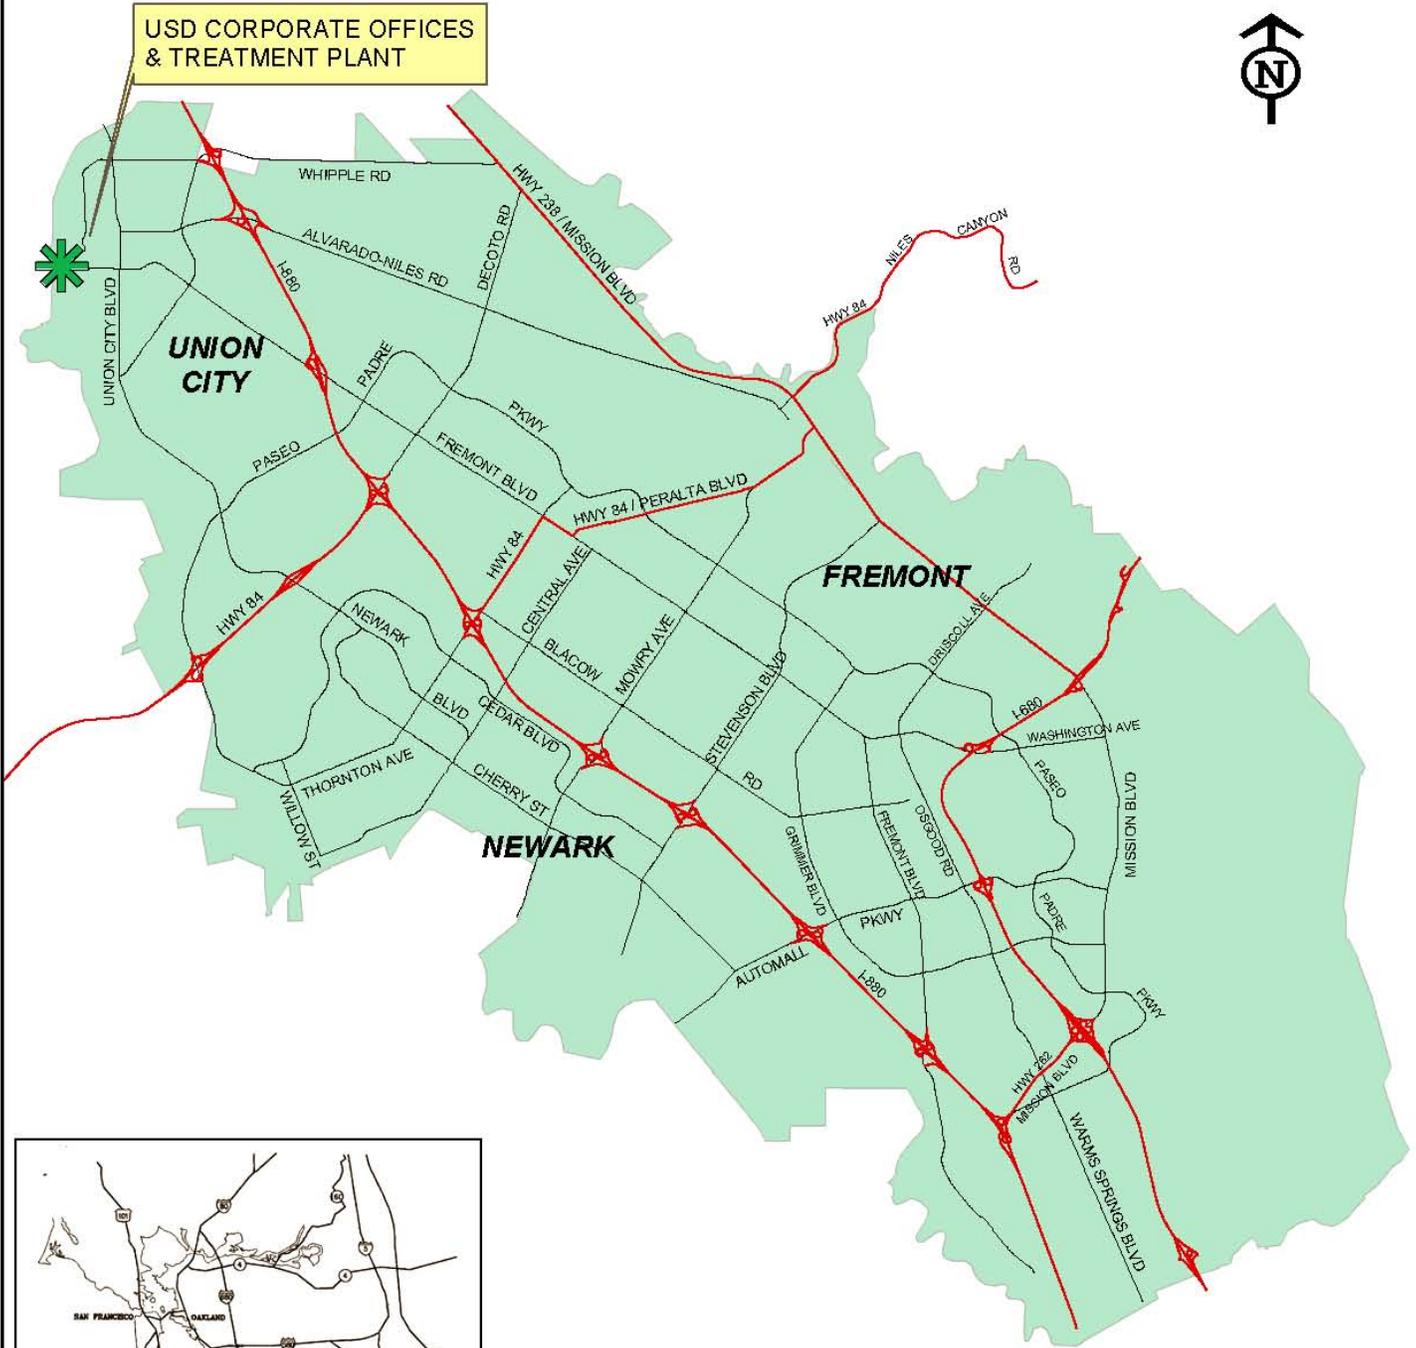

VICINITY MAP
NOT TO SCALE

SERVICE AREA LOCATION MAP



**STANDARD SPECIFICATIONS
Table of Contents**

SECTION 1 - INTRODUCTION	1
1.01 – Introduction	1
SECTION 2 – DEFINITIONS AND TERMS	2
2.01 – Definitions and Terms	2
2.02 – Abbreviations	3
2.03 – Pipe Types	4
SECTION 3 – SCOPE OF WORK	5
3.01 – Scope	5
3.02 – Guarantee of Work	5
3.03 – Indemnification.....	5
3.04 – Safety	5
SECTION 4 – SITE PREPARATION	7
4.01 – Site Preparation.....	7
4.02 – Contaminated Materials.....	7
SECTION 5 – SEWER PIPE LINES	8
5.01 – Sewer Construction Materials.....	8
5.02 – Pipe Materials	8
5.03 – Pipe Couplings	12
5.04 – Saddle	12
5.05 – Embedment.....	13
5.06 – Stainless Steel Bands.....	13
SECTION 6 – PORTLAND CEMENT CONCRETE AND MORTAR	14
6.01 – Concrete.....	14
6.02 – Mortar and Grout.....	14
SECTION 7 – SEWER PIPE AND STRUCTURE INSTALLATION	16
7.01 – Sewer Pipe Laying	16
7.02 – Splice.....	19
7.03 – Manhole.....	19
7.04 – Riser – Main Sewer Only	22
7.05 – Cleanout to Grade – Building Sewer Only	22
7.06 – Two-Way Cleanout to Grade – Building Sewer Only	22
7.07 – Test Wye – Building Sewer Only	23
7.08 – Sewer Through Casing	23
7.09 – Sewer Through Bore.....	24
7.10 – Rehabilitation of Building Sewers Using Pipe-Bursting	24
SECTION 8 – EXCAVATION	27
8.01 – Definition.....	27
8.02 – Open Trenching.....	27
SECTION 9 – TRENCH BACKFILLING.....	30
9.01 – Definition.....	30
9.02 – Pipe Foundation	30
9.03 – Geotextile Filter Fabric	30
9.04 – Pipe Embedment	31
9.05 – Trench Backfill Material.....	34
SECTION 10 – PAVING REPLACEMENT	35
10.01 – Definition.....	35

10.02 – Paving in Public Rights of Way or Public Utility Easements	35
10.03 – Paving in Union Sanitary District Easements and in Private Property	35
SECTION 11 – MISCELLANEOUS REQUIREMENTS	36
11.01 – Inspection	36
11.02 – Alterations	36
11.03 – Defective Work and/or Materials.....	36
11.04 – Manhole Protection.....	36
11.05 – Use of Existing Building Sewers	37
11.06 – Building Sewer Marking	37
11.07 – Manhole Marking.....	37
11.08 – Repair of Damaged Sewers and Other Utilities.....	37
11.09 – Connection or Adjustment to Existing Main Sewers or Appurtenances	38
11.10 – Abandonments	39
11.11 – Grease and Oil Collection Systems.....	40
SECTION 12 – TESTING	42
12.01 – Testing Main Sewers.....	42
12.02 – Testing Building Sewers	44
12.03 – Testing Pressure Sewers	45
12.04 – Manhole Testing.....	45
SECTION 13 – TELEVISION INSPECTION.....	46
13.01 – Inspection of Main Sewers	46
13.02 – When Tested.....	46
SECTION 14 – CLEANING	47
14.01 – Cleaning	47
14.02 – Discharge of Cleaning Water	47
SECTION 15 – SITE CLEANUP AND RESTORATION.....	48
15.01 – Site Cleanup and Restoration	48
INFORMATION BULLETIN.....	49
SECTION 16 – REQUIREMENTS FOR ISSUANCE OF SEWER CONSTRUCTION PERMITS.....	50
16.01 – Property to be Served by USD	50
16.02 – Insurance Requirements	50
16.03 – License Requirements.....	50
16.04 – Bond/Deposit Requirements.....	50
16.05 – Fees and Charges	50
16.06 – Permit Holder Deposit	52
16.07 – Developer Deposit.....	52
16.08 – Submission of Data for Main Sewers	52
16.09 – Submission of Data for Building Sewers.....	54
16.10 – Waste Discharge Report/Permit	55
16.11 – Easement Requirements	55
16.12 – City Building Permit.....	55
16.13 – Encroachment Permit.....	55
16.14 – Minimum Requirements for Digital Submittal	56
SECTION 17 – MISCELLANEOUS REQUIREMENTS.....	60
17.01 – Repair or Relocation of Existing Main Sewer or Appurtenances	60
17.02 – Connection or Adjustments to Existing Main Sewers or Appurtenances	60
17.03 – Repair, Relocation or Connection to Existing Building Sewers.....	61
17.04 – Use of Existing Building Sewers	61
17.05 – Abandonment.....	61

17.06 – Number of Building Sewers Required.....	61
SECTION 18 – REQUIREMENTS PRIOR TO START OF CONSTRUCTION.....	63
18.01 – Permit.....	63
18.02 – Staking and Cut Sheets.....	63
18.03 – Inspection.....	64
SECTION 19 – APPROVAL AND ACCEPTANCE OF CONSTRUCTION.....	65
19.01 – Main Sewers.....	65
19.02 – Building Sewers.....	65
19.03 – Payment.....	65
SECTION 20 – SPECIFICATIONS AND DETAILS.....	66
20.01 – Materials and Methods of Construction.....	66
20.02 – Construction Details.....	66
SECTION 21 – DESIGN AND POLICY STANDARDS FOR MAIN SEWERS.....	67
21.01 – Pipe Materials.....	67
21.02 – Pipe Material Changes.....	67
21.03 – Size and Slope.....	67
21.04 – Alignment.....	67
21.05 – Cross Connection.....	67
21.06 – Grade.....	67
21.07 – Grade Stakes.....	68
21.08 – Design depth.....	68
21.09 – Minimum Pipe Cover.....	68
21.10 – Trench Intersections.....	68
21.11 – Horizontal Utility Clearance.....	68
21.12 – Crossing Storm Drains.....	68
21.13 – Crossing Water Mains.....	69
21.14 – Structure Locations.....	69
21.15 – Main Locations.....	69
21.16 – In and Out Elevations at Manholes.....	69
21.17 – Maximum Deflection at Manholes.....	70
21.18 – Building Sewer Connection at Manholes.....	70
21.19 – Manhole Rim Elevations.....	70
21.20 – Connection to Existing Manhole.....	70
21.21 – Connections Between Main Sewers.....	70
21.22 – Drop Manholes.....	70
21.23 – Bolt-down Manholes.....	70
21.24 – Easement Width Requirements.....	70
21.25 – Easement Paving Requirements.....	71
21.26 – Easement Access Requirements.....	71
SECTION 22 – DESIGN AND POLICY STANDARDS FOR BUILDING SEWERS.....	72
22.01 – Size and Slope.....	72
22.02 – Pipe Material.....	72
22.03 – Alignment.....	72
22.04 – Building Plumbing (Building Drain) Location.....	72
22.05 – Grade.....	73
22.06 – Grade Stakes.....	73
22.07 – Curb Marking.....	73
22.08 – Connection to Existing Main Sewers.....	73
22.09 – Elevation at Connection to Main Sewers.....	73
22.10 – Connection to Existing Building Sewers.....	74
22.11 – Connection to Building Drain (Plumbing Kick-out).....	74

22.12 – Clearances.....	74
22.13 – Parallel to Footing.....	74
22.14 – Crossing Storm Drains.....	74
22.15 – Crossing Water Mains.....	75
22.16 – Minimum Pipe Cover.....	75
22.17 – Trench Intersections.....	75
22.18 – Horizontal Utility Clearance.....	75
22.19 – Structure Type and Location.....	75
22.20 – Backwater Devices.....	76
22.21 – Number of Building Sewers Required.....	76
22.22 – Private Pumping Stations.....	76
SECTION 23 – STANDARD DETAILS	77
Detail 1 – Standard Manhole	
Detail 2 – Trunk Manhole	
Detail 3 – Standard Drop Manhole	
Detail 4 – Special Manhole Base for Dead End Manholes in Cul-de-sacs	
Detail 5 – Private Control Manhole Types “A” & “B”	
Detail 6 – Private Control Manhole Type “C”	
Detail 7 – Manhole Frame and Cover	
Detail 8 – Bolt-down Manhole Frame and Cover	
Detail 9 – Private Manhole Frame and Cover	
Detail 10 – Private Control Manhole Frame and Cover	
Detail 11 – 36” Diameter Manhole Frame and Cover	
Detail 12 – Riser	
Detail 13 – Riser Frame and Cover for 6”, 8” & 10” Diameter Pipe	
Detail 14 – Building Sewer Details	
Detail 15 – Building Sewer Cleanout to Grade	
Detail 16 – VCP Sanitary Sewer/Storm Drain Crossing	
Detail 17 – Sanitary Sewer/Water Main Crossing	
Detail 18 – Sewer Pipe Installation	
Detail 19 – Three Compartment Sand and Grease Interceptor	
Detail 20 – Two Compartment Sump	
Detail 21 – Private Pumping Station Plan and Elevation Section	
Detail 22 – Private Pumping Station Connection to Main and Notes	
Detail 23 – Mobile Holding Tank Disposal Facility	
Detail 24 – Repair Coupling for VCP 15” Diameter and Larger	
Detail 25 – Overflow Device	
Detail 26 – Standard Pipe Casing	
INDEX	78

SECTION 1 - INTRODUCTION

1.01 INTRODUCTION

The STANDARD SPECIFICATIONS for sanitary sewers shall govern requirements, design and all work in connection with main and building sewer construction within the Union Sanitary District of Alameda County, California. District Information Bulletin, applicable portions of the latest version of the "Uniform Plumbing Code" not in conflict with these Specifications, and all Ordinances of the District shall be considered a part of these Specifications. All plans, profiles, cut sheets, easement documents and specifications shall conform to the Standards established herein.

Special Provisions, specifications addenda, and/or notes on the plans shall be provided when deemed necessary, and shall be considered as part of the specifications for the work.

SECTION 2 - DEFINITIONS AND TERMS

2.01 DEFINITIONS AND TERMS

For the purpose of these specifications, the following words, and abbreviations shall be defined as follows:

ABANDONMENT - The permanent removal of main and/or building sewers from service.

BUILDING PLUMBING (BUILDING DRAIN) - The lowest piping of a gravity drainage system which receives the discharge from waste and other sewer drainage pipes inside the building and conveys it to the building sewer.

BUILDING SEWER - A Building Sewer shall refer to any existing or proposed sewer for private use. It extends from the main sewer to within 30 inches or less of the building or house to be served. It is subject to inspection and approval by the Union Sanitary District and when so approved, becomes the maintenance responsibility of the property owner, per Resolution No. 5, Section 5, dated December 12, 1949. Also referred to as a lateral or house sewer.

CALTRANS - Shall mean State of California, Business and Transportation Agency, Department of Transportation.

CONTRACTOR - Company or individual authorized by the Union Sanitary District to perform work as called for by issuance of a sewer construction permit.

DEFLECTION - The changing in alignment or grade by movement of a pipe or joint. In the case of Flexible Pipe, it also means the outward movement of the sides of the pipe and the inward movement of the top and bottom of the pipe.

DEFLECTOMETER - Instrument used to determine the acceptability of deflections within Flexible Pipe. Also referred to as a mandrel.

DEVELOPER - Any public agency, private company, or individual who proposes the development of property which requires construction of sanitary sewers.

DISTRICT - Shall mean Union Sanitary District of Alameda County, California.

ENGINEER - District Engineer of the Union Sanitary District or his/her authorized representative(s).

FIXTURE UNIT - The unit equivalent of plumbing fixtures as tabulated in the latest version of the Uniform Plumbing Code.

FLEXIBLE PIPE - Sewer pipe made of Acrylonitrile-Butadiene-Styrene (ABS), Poly Vinyl Chloride (PVC), or High Density Polyethylene (HDPE).

HOUSE SEWER – See Building Sewer.

LAYERING – CADD file layer names.

LATERAL – See Building Sewer.

MANDREL – See Deflectometer.

MAIN SEWER - A main sewer shall refer to any existing or proposed sewer dedicated to public use within the public right of way or easement. It is subject to inspection and approval by the Union Sanitary District and when accepted, becomes the maintenance responsibility of the Union Sanitary District, Per Resolution No. 5, Section 5, dated December 12, 1949.

PIPE (SEWER) EMBEDMENT - Earth or other special material used to replace material removed from trenches during construction from the sewer subgrade to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the pipe barrel.

PLANS - Drawings approved by the Engineer for construction in the Union Sanitary District.

PRIVATE SEWER – The portion of the sewer main, including manholes, or building sewer located within private property, unless dedicated to the public with an easement. Maintenance responsibility of private sewers is with the owner of the private property.

RELATIVE COMPACTION - Refers to the Compaction Test No. 216 or 231 of the State of California, Caltrans, Standard Specifications.

RIGID PIPE - Sewer pipe made of Vitrified Clay (VCP), Ductile Iron (DIP), or Cast Iron (CISP).

SEWER SUBGRADE - Is defined as being six (6) inches below the exterior bottom of the pipe.

SPECIFICATIONS - Union Sanitary District's "Standard Specifications and Information Bulletin" available at the District Office.

STANDARD DETAILS - Detailed standard drawings of approved construction in the Union Sanitary District.

TRENCH (SEWER) BACKFILL - Earth or other special material used to replace material removed from trenches during construction above the pipe embedment.

WINZIP – An IBM PC file compression utility (not used for Apple computers)

2.02 ABBREVIATIONS

ANSI - American National Standards Institute

ASTM - American Society for Testing Materials

AWWA - American Water Works Association

CADD – Computer Aided Drafting and Design

DWG – Standard AutoCAD drawing file format

DXF – Standard CADD drawing file exchange format

GIS – Geographic Information System

NAD83 – North American Datum 1983 used for horizontal ground control

NAVD88 – North American Vertical Datum 1988 used for vertical ground control

UPC - Uniform Plumbing Code

2.03 PIPE TYPES

ABS - Acrylonitrile-Butadiene-Styrene Pipe

CISP - Cast Iron Soil Pipe

DIP - Ductile Iron Pipe

PVC - Poly Vinyl Chloride Pipe

VCP - Vitrified Clay Pipe

HDPE – High Density Polyethylene

SECTION 3 - SCOPE OF WORK

3.01 SCOPE

The work shall include the furnishing of all materials, labor, tools, implements and equipment necessary to construct the sewers with all appurtenances, complete and ready to operate. All construction shall be done in strict accordance with the approved Plans and the provisions of these Specifications unless otherwise authorized by the Engineer.

3.02 GUARANTEE OF WORK

All work performed and materials used shall be guaranteed for a period of one (1) year after acceptance of the work by the District. A Surety Bond may be required to be filed with the District.

3.03 INDEMNIFICATION

Contractor shall defend, indemnify and hold harmless the District, and each of its directors, officers, employees, and agents from and against any and all liability, including but not limited to, penalties, fines, costs, losses, damages, expenses, causes of action, claims or judgments, including attorney's fees and expert witness fees (collectively "Claims") resulting from:

- (a) any alleged or actual infringement or violation of any patent or patent right arising in connection with the performance of the Work and anything done there under;
- (b) any injury to or death sustained by any person (including Contractor's own employees) or damage to property of any kind, which injury, death or damage arises from or in any way connected with the Contractor's performance of the Work;
- (c) any breach by Contractor of any of the obligations and covenants, and any other terms and conditions of the permit;
- (d) any violation by Contractor or its subcontractors of one or more occupational safety and health standards, regulations, or orders, where the Contractor or its subcontractor is found to be the "Causing Employer" as defined by Title 8, CCR Section 336.10. Contractor or its subcontractor shall have the right to appeal such citations at their sole expense. The District shall provide reasonable cooperation to Contractor in its appeal of any Citations. In the event Contractor or subcontractor either fails to timely appeal the Citations and/or Citations are upheld after an appeal hearing, Contractor shall promptly pay the fines that were assessed against the District.

Contractor's aforesaid obligation of indemnity and defense shall not extend to that portion of the Claims that is caused by the sole negligence or willful misconduct of the District its directors, officers, employees or agents These obligations of defense and indemnification shall extend to Claims asserted after the completion of the Work.

3.04 SAFETY

The Contractor shall be solely and completely responsible for conditions of the job site, including the safety of all persons (including employees) and property during the performance of

the work. This requirement shall apply continuously and not be limited to normal working hours. Safety provisions shall conform to Cal-OSHA and all other applicable federal, state, county, and local laws, ordinances, codes, and regulations. Job site safety shall include confined space entry, traffic control, protection of public, above ground and below ground utility hazards and all incidental hazards. Where any of these are in conflict, the more stringent requirement will be followed. The Contractor's failure to thoroughly familiarize himself/herself with the aforementioned safety provisions shall not relieve him/her from compliance with the obligations and penalties set forth therein.

SECTION 4 - SITE PREPARATION

4.01 SITE PREPARATION

Site preparation shall consist of removing, and properly disposing of, all objectionable material such as fences, trees, brush, debris, etc., from the construction site which would interfere with the prosecution of the work.

On District contract jobs, approval must first be obtained from the Engineer to remove items that cannot practicably be replaced in kind, such as trees and limbs.

4.02 CONTAMINATED MATERIALS

In the event that soil and/or groundwater contamination is encountered, Contractor shall comply with all applicable federal, state, and local laws and regulations pertaining to the work performed during the dewatering and disposal of contaminated soil and/or groundwater. A permit from USD will be required if the Contractor wants to dispose of treated groundwater into USD's sewer.

SECTION 5 - SEWER PIPE LINES

5.01 SEWER CONSTRUCTION MATERIALS

All sewer construction materials proposed to be used shall be new materials approved by the Engineer, prior to start of construction.

Where material specification numbers are used herein, they shall refer to the latest revision thereof.

For the purpose of these specifications, all pipe materials are classified as either "rigid" or "flexible."

5.02 PIPE MATERIALS

A. RIGID PIPE AND FITTINGS

Rigid pipe and fittings may be used only under prior approval of the Engineer to accommodate special circumstances. Rigid pipe, fittings, and joint materials specified herein consist of Vitrified Clay Pipe (VCP), Ductile Iron Pipe, (DIP), and Cast Iron Soil Pipe (CISP). All materials incidental to rigid pipe installations shall be supplied by the Pipe Manufacturer. All rigid pipe required in odd lengths shall be cut using a proper cutting tool and guide that insures true line cut on planes perpendicular to the pipe axis. No bevel cuts for pipeline alignment will be permitted.

1. VITRIFIED CLAY PIPE (VCP) AND FITTINGS

Vitrified clay pipe and fittings shall conform to ASTM Designation C-700. Mechanical type joints having resilient properties conforming to ASTM Designation C-425 shall be used and installed. The pipe shall be tested during manufacture in accordance with ASTM Designation C-301.

2. DUCTILE IRON PIPE (DIP) AND FITTINGS

Ductile iron pipe and fittings shall conform to ANSI Designation A21.51 minimum pressure Class 350 for pipe 12 inches and smaller in diameter and minimum pressure Class 250 for pipe greater than 12 inches in diameter.

- a. Bell and spigot joint assemblies shall conform to the requirements of Federal Specification WW-P-421c, Section 3.1.2 as it applies to Type II, Grade B or C pipe.
- b. Standardized mechanical joint assemblies shall conform to the applicable requirements of ANSI Standards for the pipe specified and ANSI Standard A21.11.
- c. Any ductile iron pipe used in gravity sewer application or in pressure sewer applications where air and gasses can accumulate shall be lined. Lining shall be with high density polyethylene, ceramic epoxy, or glass as specified herein.
 1. HDPE Lining shall be factory applied, certified and tested for absence of holidays and pinholes. Lining shall be minimum 40 mils thick. Lining shall be light colored for improved video inspection purposes.

2. Ceramic epoxy lining shall be Protecto 401 as manufactured by Induron Coatings or equal. Ceramic epoxy shall be applied 40 mil thick.
3. Glass lining shall be 2 dual layer system such as Ferroch MEH-32, Vitco SG-14 or equal. Glass lining shall be a minimum 10 mils thick.

Linings shall be applied under pipe factory supervision in accordance with liner manufacturers' published requirements. Liners shall be spark tested at voltage of 60 V per mil thickness. Pinholes and holidays will be cause for pipe rejection.

- d. Exterior of ductile iron pipe and fittings shall be coated with standard bituminous coating.
- e. The surfaces of all buried ductile iron pipe and fittings shall be encased with two layers of 8-mil minimum thickness polyethylene, tube form. Both ends of the tube shall be thoroughly sealed with 10-mil polyethylene tape to form a continuous and all-encompassing layer of polyethylene between the piping and surrounding earth or backfill material. Polyethylene material shall conform to the requirements of ANSI/AWWA C105/A21.5. Excess slack width in the polyethylene tube shall be taken up to make a snug, but not a tight fit, and secured with a adhesive tape wrapping around the pipe at the quarter points of each pipe length. Any rips, punctures or other damage to the polyethylene sleeve shall be repaired with 10-mil polyethylene tape or a short length of polyethylene tube cut open, wrapped around the pipe and secured in place with 10-mil polyethylene tape.

3. CAST IRON SOIL PIPE (CISP) AND FITTINGS

Cast iron soil pipe and fittings shall conform to ASTM A-74 or Cast Iron Soil Pipe Institute "Standard No. 301". Joint couplings shall be "NO-HUB" couplings, except where otherwise approved by the Engineer.

B. FLEXIBLE PIPE AND FITTINGS

Flexible pipe, fittings and joint materials specified herein consist of Acrylonitrile-Butadiene-Styrene (ABS), Polyvinyl Chloride (PVC), and High Density Polyethylene (HDPE). All materials incidental to flexible pipe installations such as gaskets, joint lubricants, cements, etc. shall be supplied by the pipe manufacturer. All flexible pipe required in odd lengths shall be cut using a proper cutting tool and guide that insures true line cut on planes perpendicular to the pipe axis. No bevel cuts for pipeline alignment adjustments will be permitted. All flexible pipe for new construction shall be solid wall pipe.

1. ABS SOLID PIPE

ABS pipe shall only be used for building sewers. All ABS pipe and fittings shall be solid wall pipe manufactured in accordance with ASTM Designation D-2751, minimum wall thickness SDR 26, and tested in conformance with the requirements of paragraphs under Section 7 and 10 of said ASTM D-2680, for SDR 26 pipe.

Cement used for non-gasketed ABS pipe shall conform to ASTM Designation D-2295. Jointing of wet pipe is not allowed. No primer shall be used in the pipe installation. Jointing shall be accomplished by applying a coating of cement to the inside of the socket, and to the outside of the spigot end of the pipe to be joined in sufficient quantity that when the spigot is fully inserted into a socket, a bead of excess cement will form

around the entire circumference of the outside juncture of said spigot and socket. Excess cement shall then be removed.

2. PVC SOLID WALL PIPE

All PVC solid wall pipe and fittings shall be in accordance with the requirements for SDR 26 sewer pipe as stated in ASTM Designation D-3034, minimum wall thickness of SDR 26, ASTM Designation F-789 Type PS-46, or the requirements for PVC pressure pipe. Pipe joints and fittings shall be factory assembled, integral wall bell and spigot configuration, compatible with the pipe.

Gasketed PVC Pipe shall have a solid cross section rubber ring gasket. The gasket shall be securely attached to the pipe to prevent displacement of the gasket when installed in the field. All rubber ring gaskets shall be in accordance with ASTM Designation F-477. Lubricant used for field assembly of gasketed PVC Pipe shall have no detrimental effect on the gasket, joint, fitting or pipe and shall be as recommended by the manufacturer.

Cement used for non-gasketed PVC Pipe shall conform to ASTM Designation D-2564. Jointing of wet pipe is not allowed. Jointing of pipe shall be accomplished by applying a coating of cement to the inside of the bell and the outside of the spigot. The cement shall be applied in sufficient quantity to produce a bead of cement around the entire circumference of the pipe joint. Excess cement shall then be removed.

3. PVC Pressure Pipe

Where PVC pressure pipe is required, PVC pressure pipe shall conform to the requirements of AWWA C-900 minimum Class 150 for Pressure Pipe manufactured in sizes from four (4) inches to twelve (12) inches in diameter and AWWA C905 Class 165 for sizes 14 inches to 24 inches in diameter. PVC pressure pipe shall be furnished in Ductile Iron Pipe equivalent outside diameters with rubber gaskets, separate couplings, or approved equal. Thrust restraint shall be provided at valves and changes of direction for pressure flow applications.

1. HDPE Pipe

All HDPE pipe shall be solid wall, butt-fused pipe conforming to AWWA C906 and ASTM D-3035 and shall meet the minimum cell classification of 345434 E for gravity sewers or 345434 C for pressure sewers as described in ASTM D3350. HDPE pipe shall meet the requirements of TYPE III, Class B, category 5 grade P34 material as described in ASTM D-1248. The pipe may contain no more than 10 percent reworked resin gathered from within the manufacturer's own plant from resin meeting these specifications. Pipe color for gravity sewer application shall be natural gray. Pipe color for pressure sewer applications may be natural gray or black. Wall thickness shall be no less than DR 21.

The pipe shall be marked at 5-foot intervals or less with a coded number that identifies the manufacturer, SDR, size, material, machine, date and shift on which the pipe was extruded.

Any pipe, which has cuts or abrasions in the pipe wall exceeding 10 percent of the wall thickness, shall be removed from the site.

The pipe shall be joined using the butt fusion method in strict accordance with the pipe manufacturer's recommendations and ASTM D2657. The fusion equipment shall be

capable of meeting all conditions recommended by the pipe manufacturer, including, but not limited to, fusion temperature, alignment and fusion pressure.

Fittings shall conform to ASTM D-3261. Electro-fusion fitting may be used provided approval is granted in advance by the Engineer.

5. STORAGE

- a. Pipe shall be stored if possible at the job site in unit packages provided by the manufacturer. Caution shall be exercised to avoid compression, damage or deformation to bell ends of the pipe and barrel.
- b. When unit packages of flexible pipe are stacked, insure that weight or upper units do not cause deformation to pipe in lower units.
- c. Flexible pipe unit packages shall be supported by racks or dunnage to prevent damage to the bottom during storage. Supports shall be spaced to prevent pipe bending.
- d. When long-term storage with exposure to direct sunlight is unavoidable, flexible pipe shall be covered with an opaque material while permitting adequate air circulation above and around the pipe as required to prevent excessive heat accumulation.
- e. Flexible pipe shall not be stored close to heat sources or hot objects such as heaters, boilers, steam lines, engine exhaust, etc.
- f. Gaskets, if required, shall be protected from excessive exposure to heat.

6. DEFLECTION

The inside diameter of an installed section of flexible pipe shall not be allowed to deflect more than five percent (5%) of the base inside diameter (as defined in ASTM D3034) following 30 days after installation. Deflection testing conducted during daily installation and any time prior to 30 days after installation, shall be based on an allowable deflection of 3-1/3 percent of the base inside diameter. The testing mandrel sizes for PVC SDR 26 pipe are shown in the following table. For flexible pipe materials other than PVC SDR 26, the mandrel diameter shall be calculated based on the minimum inside diameter according to manufacturer’s published information.

Nominal Diameter (inches)	Pipe Specification	Base Inside Diameter (inches)	96-2/3 Percent Mandrel Diameter ⁽¹⁾ (inches)	95 Percent Mandrel Diameter ⁽²⁾ (inches)
8	PVC SDR 26	7.488	7.24	7.11
10	PVC SDR 26	9.342	9.03	8.87
12	PVC SDR 26	11.102	10.73	10.55
15	PVC SDR 26	13.575	13.12	12.90
18	PVC SDR 26	16.570	16.02	15.74

⁽¹⁾ Use for testing less than 30 days after installation

⁽²⁾ Use for testing 30 days or more after installation

Flexible pipe deflection shall be checked by means of a 9-arm “go – no go” mandrel pipe deflection gauge. The mandrel shall have pulling rings at each end and shall be pulled

by hand through the sewer without the aid of mechanical pulling devices. The pipe deflection shall be checked in the presence of the Engineer after the placement and compaction of all trench backfills, but prior to installation of aggregate base and/or asphalt concrete.

The mandrel deflection gauge shall be fabricated to permit passage through installed sections of pipelines within the specified tolerances for flexible pipe. Any section or sections of flexible pipe that does not permit deflection gauge passage will not be accepted and said section or sections shall be properly repaired or replaced and rechecked as directed by the Engineer.

7. MISCELLANEOUS REQUIREMENTS

- a. Wyes or tees for buildings sewers or lateral connections shall be completed using in line bell and spigot type fittings molded from resins specified. Exception to this is when a saddle-type fitting is authorized on the plans, or as directed by the Engineer in the field. Fittings and taps that protrude into the sewer main will not be allowed.
- b. Fittings shall be sized to receive type of pipe specified for building sewer lateral. Installation of fittings will be in accordance with manufacturer's recommendations.
- c. A water stop specified by the pipe manufacturer and approved by the District shall be installed at all manhole connections. The water stop shall be placed in the manhole base and centered under the manhole wall. The water stop shall be firmly fitted around the pipe exterior. Said water stop may also consist of a manhole coupling with rubber sealing rings cast into the structure base. No rubber boot type connections are allowed. The water stop shall consist of at least two continuous circles of contact such as two O-rings or a Calder coupling with two stainless steel bands.

C. OTHER PIPE

Other pipe materials may be used for sewer installation provided approval by the Engineer is granted.

The pipe shall be joined with couplings as furnished with the pipe by the manufacturer, and installed as specified by the manufacturer.

5.03 PIPE COUPLINGS

Pipe couplings (such as Calder couplings) shall be used to join pipes of unlike materials and to join pipes of like materials when a splice is made. Pipe couplings shall be molded PVC with Type 316 stainless steel shear collar. Pipe couplings shall be fastened on each end with Type 316 stainless steel worm-gear bands. Couplings shall be installed as recommended by the coupling manufacturer.

5.04 SADDLE

A tee-branch saddle fitting fabricated of material approved by the Engineer and with a flange which will prevent the saddle from entering the main sewer beyond its inside surface. The flange shall have a curvature designed for the size main on which it is to be used.

The saddle shall create an airtight connection and at the option of the Engineer may require air testing.

5.05 EMBEDMENT

All pipe shall be embedded and backfilled as specified with extra care taken in compaction of said embedment and backfills as specified in Section 9 of these Specifications.

5.06 STAINLESS STEEL BANDS

Stainless steel bands shall be ASTM A-167, Type 316. Any fitting or coupling using stainless steel bands shall have the area of the band wrapped twice with 10 mil plastic tape.

SECTION 6 - PORTLAND CEMENT CONCRETE AND MORTAR

6.01 CONCRETE

Concrete shall consist of a mixture of Type II Portland Cement, sand, fine aggregate, coarse aggregate and water. The proportions of the water, sand and aggregate shall be regulated so as to produce a plastic, workable and cohesive mixture yielding the strength indicated. Unless noted otherwise, all concrete shall be Class "A".

A. CLASS "A"

Class "A" concrete shall contain 564 pounds (6 sacks) of Portland Cement per cubic yard and shall have a minimum 28-day compressive strength of 4,000 psi in accordance with ASTM C-39.

B. CLASS "C"

Class "C" concrete shall contain 376 pounds (4 sacks) of Portland Cement per cubic yard and shall have a minimum 28-day compressive strength of 2,500 psi in accordance with ASTM C-39.

All material required, and the procedure of mixing, shall meet the requirements set forth in Section 90 of Caltrans State Standard Specifications, except that 3/4 inch maximum size aggregate shall be used and slump ranges of three (3) to four (4) inches for Class "A" concrete and four (4) to eight (8) inches for Class "C" concrete shall be maintained.

No admixtures will be permitted unless authorized by the Engineer.

Cement and aggregates shall be stored in such a manner as to prevent deterioration or intrusion of foreign matter.

Mixed concrete shall be used before initial set and in no case will retempering with additional water be permitted.

6.02 MORTAR AND GROUT

The dry materials used for mortar shall be thoroughly mixed with sufficient clean water to produce a uniform, plastic, workable and cohesive mixture.

Sand for mortar and grout shall be clean, dry, well-graded sand, free of organic or other deleterious matter, silt or other objectionable inorganic matter, and shall be of such size as determined by laboratory sieves, conforming to the following gradation.

Sieve Size	Percent Passing
3/8-inch sieve	100
1/4-inch sieve	100 - 95
No. 20 sieve	85 - 50
No. 100 sieve	15 - 0

Cement shall be Type II Portland Cement. An industrial grade all purpose non-shrinking cement such as "All Crete" or "Speed Crete" may be used.

No admixtures shall be used in the mortar or the grout unless otherwise specified or approved by the Engineer.

Mortar shall be composed of cement and sand proportioned and mixed as specified herein. Type "A" mortar shall be used unless Type "B" is specified by the Engineer.

A. TYPE "A"

Type "A" shall consist of one part by volume of cement and two parts by volume of sand.

B. TYPE "B"

Type "B" shall be a case basis, mixed and used in accordance with manufacturer's recommendations.

Mixed mortar shall be used before initial set and in no case will retempering with additional water be permitted.

SECTION 7 - SEWER PIPE AND STRUCTURE INSTALLATION

7.01 SEWER PIPE LAYING

A. CONSTRUCTION STAKING

All main sewers and building sewers shall be staked in the field in accordance with the requirements of the Union Sanitary District. The grades and alignment of the sewer so staked shall be approved by the Engineer prior to start of sewer construction. (See Standard Specifications Sections 18.02, 21.07 and 22.06 for staking requirements and submission of cut sheets.)

B. ALLOWABLE DEVIATION OF ALIGNMENT AND GRADE

The horizontal deviation of the sewer from the line shown on the Plans shall be not more than three (3) inches. The sewer grade shall not deviate from the profile shown on the Plans, and the grade shall be maintained during and after backfilling operations. Sewer grades with deviations exceeding ½ inch shall be removed and replaced at Contractor's expense. If deviations less than 1/2 inch from the design grade occurs, pipe joints may be deflected to bring the invert back to grade. Grade corrections shall be made gradually to prevent sags in the pipe invert at low spots. Pipe shall be installed to be free draining (no sags) between any two points. No reverse (adverse) grade will be allowed.

C. LASERS

When laying main sewers, unless otherwise approved by the Engineer, the contractor shall use a commercial laser grade setting system. When using a laser, the following requirements and conditions must be met:

1. The Contractor shall have the responsibility of providing an instrument operator who is qualified and trained in the operation of the laser and said operator shall adhere to the provisions of the State of California Construction Safety Orders issued by the Division of Industrial Safety. Attention is particularly directed to Section 1514, 1800 and 1801 of said orders for applicable requirements.
2. When using a laser, the laser shall be connected firmly to a tripod, set firmly on compacted soil. The laser height of instrument shall be taken from one (1) offset hub and checked with at least two (2) more hubs, until 2 or more hubs show consistent readings or until readings coincide. This shall be done every time the laser is set up, or disturbed.
3. The laser and level instruments shall be properly calibrated within six (6) months prior to use. A laser or level instrument found to be out of calibration or without records showing it has been calibrated within the last six months, shall be removed from the job site until it has been properly calibrated.

D. GRADE LINE

When laying pipe for building sewers, in lieu of a laser grade setting system, the Contractor may use a grade line. When laying the pipe, except where vertical curves are shown on the Plans, or otherwise authorized by the Engineer, the Contractor shall use a grade line with at least two (2) adjacent runs up at all times in order to detect any variation from a straight

grade. The grade line must be established over the center of the trench in vertical trenches and over the center of the pipe in V-type trenches during the laying operations, and grade line shall be maintained up until the pipe grade is checked by the Engineer.

The grade line shall be accurately and securely fastened at each staked station to securely erected batter boards and kept taut at all times.

The measuring pole shall be a solidly constructed straight pole with a metal foot at one end at right angles to the pole. The batter board construction, string line and measuring pole construction shall be approved by the Engineer prior to start of sewer pipe laying.

In caving ground and in other circumstances when the above is not practicable, and when so authorized by the Engineer, the pipe must be checked by surveying instruments under the direction of a Registered Civil Engineer or Land Surveyor who shall accept the responsibility for the pipe being installed on the proper grade.

E. SEWER PIPE PLUGS

Sewer pipe stubs, or other open ends, which are not to be immediately connected, shall be plugged or capped with a standard watertight plug or cap as approved by the Engineer for use in the particular installation. The plugs or caps may only be removed when so authorized by, and in the presence of, the Engineer.

F. JOINT DEFLECTIONS AND MINIMUM RADIUS

When approved by the Engineer, curved sewers shall be in conformance with the following requirements.

1. RIGID PIPE

The deflection in the joint between any two successive pipe sections shall not exceed 75% of the maximum allowable deflection as recommended by the pipe manufacturer. For rigid pipe, two (2) foot minimum pipe lengths may be supplied or pipe may be cut, if approved joint material is available, to install short radius curves and conform with the joint deflection limitations. When short lengths are to be used, it shall be so shown on the Plans.

2. FLEXIBLE PIPE

For flexible pipe, horizontal curves shall be achieved without joint deflection. Flexible pipe horizontal curves shall be achieved by bending the pipe barrel to the required radius and securing the bent pipe barrel with stake restraints prior to backfilling. The minimum allowable bending radius is shown in the following table.

Pipe Diameter (inches)	Minimum Radius (feet)
4	100
6	150
8	200
10	250
12	300
15	350
18	450

G. VERIFICATION OF EXISTING SEWER OR STRUCTURE

Where connection is to be made to an existing sewer or structure, said existing sewer or structure shall be uncovered and checked for location and elevation prior to submitting cut sheets. Any discrepancy between the Plans and field information shall be reported immediately to the Engineer.

H. COMMENCEMENT OF NEW SEWER PIPE LINE

Unless otherwise authorized by the Engineer, the laying of the pipe in finished trenches shall be commenced at the lowest point of the project, with the spigot ends abutting and pointing in the direction of the flow. The joints shall be carefully centered so that when laid to proper grade and alignment as designated on the Plans, they will form a sewer with a uniform invert.

I. SEWER PIPE LINE THROUGH MANHOLES

Except when precast manhole base blocks are used, sewers shall be laid continuously through proposed manhole locations on all straight runs and at angle points. When excavation is made below the pipe for manhole construction, care must be taken that the pipe spanning this area is firmly supported.

J. FLEXIBLE COUPLINGS AT MANHOLES

For rigid pipes, a flexible pipe coupling, such as a calder coupling, shall be installed at a point 6 to 12 inches outside of the manhole base block on both upstream and downstream sides. In all cases, the flexibility of the coupling must be maintained by keeping all concrete away from the joint or coupling. A bell joint is not acceptable for this requirement.

K. GROUND TO BE FILLED

In ground to be filled, fill shall be placed up to 3 feet above where the outside of the pipe would be and laterally to a width of the pipe outside diameter plus six (6) feet centered on where the pipe would be, and compacted prior to the construction of the sewer. The compaction requirements, as specified by the Agency governing the fill, shall be considered adequate except that not less than 90% relative compaction per ASTM D-1557 "Modified Proctor" shall be achieved. Evidence of these results in the areas concerned shall be furnished to the District (from an approved testing laboratory) prior to construction of the affected sewer.

L. HANDLING OF PIPE

Pipe shall be protected during handling against impact shocks. Prior to making pipe joints, all surfaces of the portion of the pipe to be joined shall be cleaned, dried, primed or otherwise prepared as called for in these Specifications. The interior of all pipe shall be kept free from all dirt and foreign matter as the work progresses.

At the close of each day's work, and at such other times when the pipe is not being laid, the ends of all open pipes shall be closed with a water tight plug or cap. Any modification of this requirement must be approved by the Engineer.

M. FIELD CUTTING PIPE

Unless otherwise permitted by the Engineer, pipes that must be cut in the field shall be cut with mechanical cutters or as recommended by the pipe manufacturer.

7.02 SPLICE

When a pipe is to be spliced into an existing sewer, the sewer shall be exposed and then mechanically cut at right angles to the pipe barrel, with sufficient length removed so that a pipe section with plain ends can be joined to the cut pipe with approved couplings to form an airtight joint. All work shall be done in the presence of the Engineer. Care must be taken to fill all voids under and around the pipe splice with Type "B" Import material to properly support the new pipe and prevent any settlement of the spliced section.

7.03 MANHOLE

Manholes shall be sound watertight structures, constructed as shown on the Standard Details or on the Plans in the case of special structures. The type of manhole and its location is to be shown on the Plans. The manhole shall be constructed to the rim elevations shown on the Plans.

A. MANHOLE BASE BLOCK

The base block shall be poured using Class "A" concrete and in accordance with the design shown on the Standard Details. Precast base blocks may be used for standard manholes approved by the Engineer and City jurisdiction. Precast base blocks may not be used for trunk manholes.

The concrete pour shall be made only on dry, firm undisturbed ground or on "rock ballast" placed on undisturbed ground. If the pour is on filled ground, the ground shall be compacted to a 95% Relative Compaction per ASTM D-1557 "Modified Proctor." The concrete shall be placed with a continuous pour deposited in such a manner that segregation of material does not occur. Once deposited, the concrete shall be consolidated with mechanical vibrators so as to secure a dense watertight mass.

An approved metal form ring shall be used so that a level keyed slot is formed in the fresh concrete to receive the pre-cast manhole shaft section.

When the sewer pipe has been laid through the proposed manhole, the top half of the sewer pipe shall be removed to within one (1) inch longitudinally of the inside wall of the manhole and the cut finished with mortar as specified by the Engineer.

The width of opening at the top of base block shall be the inside diameter of the pipes in the manhole.

In angle point manholes and in junction manholes, the pipes shall be joined by smooth curves, warped to conform to the lower half of the pipe. In all cases, the upper portion of the manhole channel from the mid-point of the pipes in the manhole to the top of the base block shall be constructed vertically.

When the manhole channel is not completed in the original pour, it shall be finished smooth by use of mortar with per Section 6.02. Before application of the mortar, the existing

concrete surface shall be thoroughly cleaned and roughened to secure a firm bond. All channels shall be troweled smooth so that a smooth uninterrupted surface is achieved. The top of the base block shall be troweled to slope towards the channel at an approximate slope of one (1) inch in six (6) inches.

B. MANHOLE SHAFT AND PRECAST BASE BLOCK

The manhole shaft shall be composed of precast concrete sections. These sections shall be installed plumb and aligned so that the steps are in a straight vertical line. Unless otherwise required by the Engineer, the steps shall be aligned horizontally forty five (45) degrees away from the direction of the flow of the sewer main on the upstream side.

Precast concrete sections shall be in accordance with the Standard Details and shall conform to the requirements of ASTM Designation C-487 except that Type II or Type V Portland Cement shall be used. The cone section shall be concentric unless eccentric is allowed by the Engineer.

Unless otherwise directed by the Engineer, manholes to be installed in all proposed City streets and paved Public Easements will be constructed with standard cone section per Standard Detail Sheets. In these cases, the neck rings and cast rings shall be installed after the street section has been completed.

Joints between precast sections shall have a "Ram-Nek" flexible plastic gasket installed between the tongue and groove joint to make a watertight joint. After the shaft is in place, the joint shall be trimmed smooth with a sharp tool on the inside of the manhole.

Manhole sections will be ordered without steps when the distance between the top rim and top of base block is less than four (4) feet. Precast manhole base blocks, when allowed by the Engineer and city jurisdiction for standard manholes, shall have a standard pipe bell cast into the base block. Rubber boot type connections are prohibited.

C. DROP CONNECTIONS

When a drop connection is shown on the Plans, it shall be included as part of the manhole construction. The drop shall be made with approved fittings outside the manhole shaft as shown on the Standard Details. The lowest pipe shall be constructed into the base block by aforementioned channeling procedures. The base block shall be enlarged to encase these lower fittings.

After the manhole shaft is in place, the upper pipe run shall be constructed through the precast wall, flush with the inner wall. The hole between the pipe and the precast section shall be mortared to a watertight condition. This pipe and drop shall then be encased in concrete to the point where the upstream sewer trench is of normal width and depth.

D. MANHOLE CASTINGS

Manhole frame and cover shall be Class 30 cast iron designed as shown on the Standard Details and conforming to ASTM Designation A-48. Manufacture's name, initials or logotype shall be cast in the frame and cover. The bearing surfaces of the frame and cover shall be machined and the cover shall seat firmly without rocking. Before leaving the foundry, all casting shall be protected with an asphalt coating as follows:

1. The surface to be protected shall be clean, uncoated cast iron free of oil, grease, scale or rust.
2. The casting shall be painted with asphalt paint or as an alternative the entire casting shall be dipped in asphalt paint.

The manhole frame and cover shall be permanently set when so authorized by the Engineer.

The frame shall be centered on the manhole shaft and laid on mortar to final grade. The mortar shall be neatly struck.

E. MANHOLE STEPS

Steps shall be installed in the manhole cone and barrel sections by the manhole manufacturer before being shipped to the job site unless the manhole is specifically ordered without steps.

Steps for manholes shall be made of Copolymer Polypropylene that encapsulates a 1/2" grade 60 steel reinforcing rod. This step shall conform to ASTM Designation C-478, Paragraph 16.

The steps shall be PS2-PFS manhole steps as manufactured by M.A. Industries Inc. (800-241-8250), P-13938 as manufactured by Lane International Corporation (800-666-0076), or approved equal.

F. MANHOLE COLLAR

Unless otherwise specified by the Engineer, a concrete collar shall be poured around the frame and shaft so as to securely anchor the frame to the shaft. (See the Standard Details)

G. MANHOLE LINERS

All trunk manholes and drop manholes shall be lined with 65 mil thickness PVC liner embedded into the manhole concrete at time of pour. Standard manholes shall be lined where required by the Engineer. Liner shall be T-lock as manufactured by Ameron or approval equal. Liner shall extend from the bottom of the grade rings to the top of the bench wall shelf.

Joints in liner shall be heat welded with strips of PVC, same thickness as liner. Liner and joints shall be spark tested in the presence of the Engineer. Spark testing shall be performed at minimum 15,000 volts with a Tinker and Razor Holiday Detector, or approved equal. Any holidays or pinholes shall be patched by thermal welding strips over the pinhole and the area patched shall be retested. The manhole will not be accepted until it is holiday and pinhole free.

7.04 RISER (Main Sewer Only)

A. RISER SHAFT

The riser shaft shall be a straight piece of pipe joined to the main by means of a 45° bend fitting, with both shaft and fitting joined in the same manner, as required in the pipe laying section of these Specifications.

The shaft shall be installed at a 45 degree angle and so positioned that the 45° bend fitting is located at the station shown on the Plans. The shaft will be cut smoothly at a 45 degree angle so that the highest point will extend to within two (2) inches of the casting cover. The exposed end of the shaft shall be temporarily sealed to prevent dirt or debris from entering into the sewer until such time as the frame and cover are permanently installed.

B. RISER CASTINGS

The riser frame and cover shall be Class 30 Cast Iron designed as shown on the Standard Details and conforming to ASTM Designation A-48. Manufacturer's name, initials or logotype shall be cast in frame and cover. The cover shall seat firmly without rocking. Before leaving the foundry, all castings shall be cleaned and coated with asphaltic material.

The frame shall be centered on the riser shaft opening so that the pipe does not touch the frame. When the frame has been set to final grade, a concrete block shall be poured around the frame.

The riser frame and cover shall be permanently set when so authorized by the Engineer.

7.05 CLEANOUT TO GRADE (Building Sewer Only)

A wye-branch fitting, with branch the same diameter as the building sewer, shall be installed so that it opens in a direction opposite to the flow of the sewer, vertically above the pipe barrel. Necessary fittings and pipe, of the same diameter as the building sewer, shall be used to bring the "cleanout" vertically to ground surface and an approved box and cover installed, all as shown on the Standard Details.

Cleanouts shall be constructed as shown on the Standard Details and in locations shown on approved plans. A transition coupling and cleanout shall be provided and installed at the property line.

The vertical pipe shall be plugged below subgrade of surface in improved areas and sufficiently below the ground surface in unimproved areas so as to be protected during final site preparation. After surface work is complete, the riser pipe will be extended to finished grade, capped with an airtight threaded body and cap plug and protected with an approved cleanout box per Standard Details.

7.06 TWO-WAY CLEANOUT TO GRADE (Building Sewer Only)

A two-way fitting with a riser pipe, both of the same diameter as the building sewer, shall be installed vertically above the pipe barrel. The "two-way cleanout to grade" will be brought to finished grade, capped with an airtight threaded body and cap and protected with an approved cleanout box per Standard Details.

When a plastic two-way fitting is used, a six (6) inch long plastic stub must be installed into the downstream bell of the two-way fitting in order to permit a proper coupling to be made with other types of material used for the building sewer.

7.07 TEST WYE (Building Sewer Only)

A wye-branch fitting, with branch the same diameter as the building sewer, shall be installed so that it opens in a direction opposite to the flow of the sewer vertically above the pipe barrel. The test wye shall not be removed after testing, but shall be capped with an airtight threaded body and cap and left in place. Rubber caps shall not be used.

7.08 SEWER THROUGH CASING

Unless otherwise required by the Engineer, when main sewer pipe cannot be installed by open cut methods, it must be installed in a casing as shown on the Plans.

Pipe casing size, material and thickness will be as specified on the Plans.

The casing material will be delivered to the job site with ends fabricated to a true right angle with the axis of the pipe to facilitate accuracy of jacking.

Welded Steel Pipe Casing shall conform to ASTM Designation A-53 Grade B, A-139 grade B or A-252 Grade 2.

Where approved by the Engineer, 4 inch and 6 inch pipes can be bored; larger diameters require casing. The minimum inside diameter of the pipe casing shall be eight (8) inches greater than the maximum outside diameter of the sewer to be installed therein, with a minimum outside diameter of thirty (30) inches for any casing unless otherwise approved by the Engineer.

The casing sections shall be joined by a continuous watertight weld.

The jacking pits shall be excavated and backfilled in accordance with Section 8 and 9 respectively, of these specifications. A submittal for, and inspection of, the jacking pit installation shall be required prior to the start of the jacking operation.

The guide rails for the jacking machine shall be accurately set and checked by a licensed surveyor, so that the casing, while being jacked, will be guided to correct line and grade to enable the sewer pipe to be centered in the casing.

The front of the casing pipe shall be provided with mechanical arrangements or devices that will positively prevent the auger from leading the pipe so that no unsupported excavation is ahead of the pipe. The auger and cutting head arrangement shall be recessed to prevent the flowing of material from the face of the casing into the casing. The auger and cutting head arrangement shall be removable from within the pipe in the event an obstruction is encountered.

The Contractor shall be responsible for surface subsidence and damage or disturbance to adjacent property and facilities that may result from the Contractor's Construction method. In the event that loose material is encountered and cave-ins occur or are anticipated, all jacking will be discontinued, approved shoring shall be provided and all voids filled by pressure grouting.

It is recommended that the Contractor make frequent checks on the casing grade during installation. Grade stakes, indicating pipe invert elevations, shall be located at both ends of

proposed casing.

Voids created between the outside of the casing wall and surrounding earth shall be filled with grout.

When the casing has been completed, and before the sewer is installed, it shall be inspected and approved by the Engineer. Pipe material as shown on the Plans shall then be joined and installed on proper grade through the casing.

The sewer pipe shall be securely supported through the casing as shown on the Standard Details. After the sewer pipe is installed, it shall be given a preliminary air test in the presence of the Engineer (see Section 12 of these Specifications) and internally inspected by closed circuit television (see Section 13 of these Specifications). After the test is satisfactorily completed, and the television inspection favorably reviewed, the annular space between the pipe and the casing shall be filled with dry sand mechanically blown in or filled with grout so as to completely fill all voids after which the space between the end of the casing and the pipe shall be sealed to a watertight condition. The pipe shall be anchored and secured to prevent movement during the filling of the annular space.

7.09 SEWER THROUGH BORE

Unless a casing is required by the Engineer, building sewer pipe that cannot be installed by open cut methods shall be bored.

When a sewer pipe is to be installed in a bored hole, the hole shall be bored by use of a machine which will cut a true circular bore to the required line and grade. Bored tunnels shall be no more than two (2) inches larger in diameter than the maximum outside diameter of the sewer pipe to be placed therein.

When the bore has been completed and before the sewer is installed, it shall be inspected and approved by the Engineer. Ductile Iron Pressure Pipe, or PVC Pressure Pipe (AWWA C-900, Class 150), shall then be joined and installed through the bore.

After the sewer pipe is installed, it shall be given a preliminary air test in the presence of the Engineer (see Section 12 of these Specifications) and internally inspected by closed circuit television (see Section 13 of these Specifications).

7.10 REHABILITATION OF BUILDING SEWERS USING PIPE-BURSTING

A. GENERAL

Building sewers in poor condition due to cracked pipe or joints, leaking joints (infiltration), or root intrusion may be rehabilitated using the pipe-bursting method, if approved in advance by the District. Certain conditions, such as building sewers with insufficient grade, sags, or in close proximity to other utilities may not be suitable for rehabilitation using the pipe-bursting method. This specification is intended for rehabilitation of 4-inch or 6-inch diameter building sewers only.

Approval of the pipe-bursting method by the District can only be made after reviewing the pre-rehabilitation television inspection tape, which is a required submittal item. Approval of the submittal by the District does not imply that the proposed pipe-bursting installation is appropriate for the specific location being proposed for installation. The Contractor is

completely responsible for all elements of the pipe-bursting installation, including safety of installation, conflicts or damage to: utilities, property improvements, sidewalks, driveways, curbs, gutters, pavement, and equipment, or installation problems caused by existing building sewer pipe materials, subsurface conditions, or access restrictions.

B. DESCRIPTION

Pipe-bursting rehabilitation consists of splitting and expanding the existing pipe and simultaneously pulling, or pushing, a new high-density polyethylene (HDPE) pipe into the resulting void. The method requires the excavation of two pits. The insertion pit shall be used to insert the pipe splitting device followed by the new pipe. The exit pit shall be used to receive the splitting device and new pipe through the existing building sewer. After insertion, a cleanout to grade shall be installed at the property line and the new pipe shall be connected to the existing pipe.

C. SUBMITTALS

1. Minimum pipe-bursting experience requirements: The Contractor shall have completed a minimum of two pipe-bursting projects within the last two years. Submit short project descriptions and references (name and phone numbers of property owners or construction inspectors) for two projects.
2. A letter signed by the property owner authorizing the installation of the building sewer using the pipe-bursting method. The letter must also acknowledge that the pipe-bursting procedure and limitations have been explained to the property owner by the Contractor.
3. Pre-rehabilitation television inspection tape: The Contractor shall inspect the building sewer using a CCTV camera and provide a VHS or DVD-format video and inspection report for each building sewer. The tape shall show the footage of the camera and shall include the complete length of the building sewer to be replaced. Prior to television inspection, the existing pipe must be clean of all debris and must be wet so that sags can be easily detected. The television inspection shall be completed in the presence of the District representative. If approved by Engineer, the television inspection may be completed without a District representative if the inspection videotape adequately documents the location of the work.
4. Post-rehabilitation television inspection tape. The television inspection shall be completed in the presence of the District representative. If approved by Engineer, the television inspection may be completed without a District representative if the inspection videotape adequately documents the location of the work.

D. EQUIPMENT

The pipe-bursting equipment may be either hydraulic, pneumatic, or the cone cracking type. The bursting head shall be specially designed to force its way through the existing pipe materials by fragmenting the pipe and compressing the old pipe section into the surrounding soil as it progresses. The head shall be designed to produce a maximum opening dimension of 1 inch (diameter) larger than the outside diameter of the new HDPE pipe. The pipe-bursting system shall be used to replace the existing building sewer with the same nominal size pipe. The system shall not be used to increase the size of the building sewer.

E. PIPE

The HDPE pipe shall be as specified in Section 5.02 of these Standard Specifications.

F. UTILITIES

At least 48 hours prior to excavation, the Contractor shall call Underground Services Alert (USA) at (800) 642-2444. The Contractor shall request utility markings for the entire reach of the proposed pipe burst. The Contractor shall pothole all utilities crossing the proposed pipe burst to determine the clear distance between each utility and the existing building sewer. Utilities with less than 12 inches of clearance or water mains and services with less than 24 inches of clearance shall be left exposed during the pipe-bursting installation.

G. INSTALLATION

1. After coordinating with the property owner and residents, plug existing building sewer or provide by-pass pumping system to prevent sewage spills. Dumping or free flow of sewage within the excavation or on public or private property, gutters, streets, and storm drain facilities is prohibited.
2. The insertion pit shall be large enough so that HDPE pipe can be installed without exceeding the minimum bending radius. The minimum bending radius shall be 20 times the outside diameter of the pipe or as recommended by the pipe manufacturer, whichever value is larger.
3. After installation, the Contractor shall allow a minimum of four (4) hours for relaxation due to tensile stressing and to allow the pipe to thermally acclimate with the soil prior to installing final connections to main sewer or building sewer. Temporary connections can be installed sooner to reinstate sewage flows.
4. Any installed pipe, which has cuts or abrasions in the pipe wall exceeding 10 percent of the wall thickness, shall be cut out and removed from the site.
5. After final cleaning of the building sewer, water shall be introduced into the new pipe section and the post-rehabilitation television inspection shall be completed and the tape or DVD submitted to the District for approval.

H. CONNECTIONS

A cleanout to grade, including box and cover, shall be installed at or near the property line as shown on the Standard Details. Connections shall be completed using flexible couplings with Type 316 stainless steel bands.

SECTION 8 - EXCAVATION

8.01 DEFINITION

Excavation shall mean all of the below ground-surface work (including cutting of pavement; control of ground water, storm water and other extraneous water; removal, handling, stockpiling and/or proper disposal of removed material and water) necessary to prepare a firm, dry bed for the sewer line and structures.

The Contractor shall be solely and completely responsible for conditions of the jobsite, including safety of all persons and property during performance of the Work. This requirement shall apply continuously and not be limited to normal working hours. Safety provisions shall conform to U.S. Department of Labor (OSHA), the California Occupational Safety and Health Act (CalOSHA), and all other applicable Federal, State, County, and local laws, ordinances, codes, including but not limited to the requirements set forth below, and any regulations that may be detailed in other parts of these Standard Specifications. In the event of conflicting requirements, the most stringent requirement as it pertains to the Contractor's safety responsibility, shall be followed by the Contractor.

The excavation shall be made to enable the sewer to be laid to the grade and alignment designed on the Plans.

8.02 OPEN TRENCHING

The excavation for sewers shall be made by open trenching except where tunneling is necessary. Existing pavement shall be saw cut and replaced in accordance with Section 10. The walls of the sewer trench shall be vertical in the region between the bottom of the trench and the top of the sewer pipe. In this region, at least six (6) inches but not more than twelve (12) inches of clearance shall be maintained between the outer wall of the pipe barrel and the embankment or shoring, unless otherwise approved by the Engineer.

The trench shall be excavated to a level section and to such elevation as will give a uniform bearing and true flow line elevation when the sewer pipe is laid. All loose dirt in the bottom of the trench must be removed.

A. MUD OR OTHER SOFT OR SPONGY MATERIAL

Where mud or other soft or spongy material incapable of proper pipe support is encountered, it shall be excavated to a minimum depth of twelve (12) inches below sewer subgrade. Limits of the material to be removed shall be designated by the Engineer in the field. However, this does not relieve the Contractor of the requirements of these Specifications, including, but not limited to, allowable deviation of alignment and grade.

B. ROCK

Where rock is encountered, the trench shall be excavated to a minimum depth of three (3) inches below the sewer subgrade and backfilled to sewer subgrade with Type "B" Import, thoroughly compacted to grade before the sewer pipe is laid.

C. OVER EXCAVATED AREAS

Over excavated areas in the trench bottom where "Type B" Import bedding will be placed, shall be restored to sewer subgrade with "Type B" Import, thoroughly compacted before the

sewer pipe is laid. (Exception to this requirement is for private sewer lateral trenches in unpaved private property from the property line to the building, where gravel, crushed rock or sand may be placed).

D. COMPACTION

In all the above situations, the compaction shall be achieved by mechanical means. Water settling, flooding, jetting, and other water consolidation methods are expressly prohibited.

E. BRACING AND SHORING

The contractor shall at all times furnish, install, and maintain sufficient bracing and shoring in trenches to insure safety of the workmen and to protect and facilitate the work. When practical, all such bracing and shoring shall be removed from the trench as the backfilling proceeds.

F. BLASTING

In the event that blasting is necessary in excavation, special permission, in writing, must be obtained from the Agency having jurisdiction over the issuance of blasting permits before any blasting will be permitted. Such permission shall in no way relieve the Contractor of the responsibility for obtaining any permits or licenses required by State Law or Local Ordinance.

G. SEWER SUBGRADE

The sewer subgrade shall be kept dry at all times and precautions shall be taken that no storm water is allowed to enter the excavation prior to backfilling. The Contractor shall, at all times, have on the job, sufficient pumping machinery for immediate use. Water shall be disposed of in accordance with the requirements of the agency having local jurisdiction, and in such a manner as to cause no damage to public health or safety, or to public or private property.

H. EXCAVATION MATERIAL

Material excavated in streets and roadways and required for backfill, shall be laid along side the trench and kept trimmed up so as to cause as little inconvenience as possible to public travel.

Free access must be provided to all fire hydrants, water gates, meters and private drives, and means shall be provided so that water can flow in the gutters uninterruptedly.

All materials excavated in streets and roadways and not required for backfill, shall be immediately removed and properly disposed of by the Contractor. No surplus material shall be dumped on private property.

I. OPEN TRENCH PERMITTED

The Engineer will specify the amount of open trench permitted at any one time. In general, the length of trench open at any time shall be limited to 100 feet in business areas; 250 feet or one block (whichever is less) in residential areas; and 1,000 feet in undeveloped areas.

No trench shall be allowed to remain open outside of work hours. At the end of a work day the trench shall be backfilled or secured with steel plates.

J. CONTRACTORS RESPONSIBILITY

It shall be the responsibility of the Contractor to conform to all the requirements of all permits obtained from all Agencies and to make the construction site safe against injury to people and/or livestock by erection of adequate posted barricades and/or temporary fences.

K. GROUNDWATER

The Contractor shall keep excavations free from water during construction. Groundwater shall be controlled to prevent sloughing or erosion of trench walls, softening of the bottom of excavations, or formation of "quick" conditions. The static water level shall be drawn down to a sufficient depth below the bottom of excavations to maintain the undisturbed state of natural soils and allow the placement of any fill to the specified density. Dewatering systems shall not remove natural soils. The Contractor shall control surface runoff to prevent entry or collection of water in excavations.

The Contractor shall obtain any and all permits required in conjunction with the installation and removal of the dewatering system and shall meet all permit requirements.

The Contractor shall contact the local drainage authority for discharge requirements. The Contractor shall dispose of water from dewatering operations so as not to cause injury or damage to adjacent property and shall at all times remain in compliance with the requirements of the local drainage authority.

SECTION 9 - TRENCH BACKFILLING

9.01 TRENCH BACKFILLING

Trench backfilling shall consist of all materials placed in an excavation in the process of constructing a sewer line and/or appurtenances. No backfill shall be deposited over a sewer line and/or appurtenances until pipe laid has been inspected and approved by the District for backfilling operations.

9.02 PIPE FOUNDATION - (If Required by Engineer)

Pipe foundation shall be that portion of the trench which is nine (9) inches below the sewer subgrade. This portion of the trench shall be backfilled with "Rock Ballast" thoroughly compacted to achieve a firm, dry bed for the sewer pipe or structure. Locations of the "Rock Ballast" will be designated by the Engineer in the field. However, this does not relieve the Contractor of the requirements of these Specifications, including, but not limited to, allowable deviation of alignment and grade. Rock ballast shall be wrapped in non-woven geotextile fabric composed of polypropylene. The fabric shall be consistent with the physical characteristics of Mirafi: 140N, or approved equal.

ROCK BALLAST:

Rock Ballast shall be 1 1/2 by 3/4 inch gravel conforming to the following gradation.

Sieve Size	Percent Passing (by weight)
2-inch sieve	100
1 1/2-inch sieve	95-100
3/4 -inch sieve	5-30
3/8-inch sieve	5-20
No. 200 sieve	0-4

9.03 GEOTEXTILE FILTER FABRIC

If required by the Engineer, geotextile filter fabric shall be used to wrap pipe foundation and pipe embedment as specified herein and as indicated on the Standard Details. The requirement for geotextile filter fabric may vary depending on groundwater and soil conditions.

Geotextile filter fabric shall be a non-woven material consisting of polyester, nylon, polypropylene filaments formed into a stable network. The fabric shall be permeable, not act as a wicking agent, be inert to commonly encountered chemicals, be rot-proof, and resistant to ultraviolet light.

The geotextile fabric shall also conform to the following physical properties:

Property	Test value	Test method
Weight	5.4 oz/yd ² (min.)	ASTM D3776/D5261
Grab tensile strength	150 lb (min.)	ASTM D4632
Elongation at break	50% (max.)	ASTM D4632
Puncture strength	80 lb (min.)	ASTM D4833
Burst strength	300 psi (min.)	ASTM D3786
Apparent opening size	#70 (max.)	ASTM D4751
Permittivity	1.0 sec ⁻¹ (min.)	ASTM D4491

Property	Test value	Test method
UV resistance	70% (min.)	ASTM D4355

The geotextile fabric shall be Mirafi 160N, Linq Industrial Fabrics 150 EX, or equal.

9.04 PIPE EMBEDMENT

Pipe embedment shall mean that portion of the material placed within the trench from the sewer subgrade to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the pipe. "Sewer Subgrade" is defined in Section 2.

A. PIPE EMBEDMENT MATERIAL

1. IMPORT "TYPE A"

Shall be unwashed creek or bank gravel, crushed gravel, crushed rock, bank run rock or a mixture of these materials.

The material shall be free from roots, vegetable matter, or other deleterious substance and shall be of such nature and so graded that it will bind readily when watered and compacted to the requirement specified herein.

When tested in accordance with Section 6 of Caltrans, State Standard Specifications, the material shall meet the following requirements:

- a. The material shall be of such size that the percentage composition by weight, as determined by laboratory sieves, will conform to the following grading:

Sieve Size	Percent Passing (by weight)
1-inch sieve	100
¾-inch sieve	90 - 100
No. 4 sieve	35 - 100
No. 30 sieve	10 - 30
No. 200 sieve	2 - 9

- b. The material shall also have a minimum sand equivalent of 22 and a minimum resistance (R) value of 78.

2. IMPORT "TYPE B"

"Type B" Import shall be crushed rock (chips). This material shall contain at least 75% of the particles having one or more fractured faces. Not over 25% shall be pieces that show no such faces resulting from crushing. Rock will be designated by normal size.

When tested in accordance with Section 6 of Caltrans State Standard Specifications, the material shall meet the following requirements:

The material shall be of such size that the percentage composition by weight, as determined by laboratory sieves will conform to the following graduations:

Sieve Size	Percent Passing (by weight)
1-inch sieve	100
¾-inch sieve	90 - 100
No. 4 sieve	0 - 15
No. 200 sieve	0 - 4

In any of the subsequent sections of these Specifications where "Type B" Import is specified, "Type A" Import may be used if so authorized by the Engineer.

3. TRENCH EXCAVATION MATERIAL

Acceptable trench excavation material shall be that material which is free from vegetable matter and refuse and shall contain no concrete, stones or clods larger than 3/4 inch in diameter and shall contain sufficient fines so that all voids will be filled when compacted.

B. PIPE EMBEDMENT INSTALLATION

1. MAIN AND BUILDING SEWERS IN PUBLIC UTILITY AND U.S.D. EASEMENTS, PUBLIC RIGHT OF WAYS AND PAVED PRIVATE PROPERTY

a. RIGID PIPE

That portion of the pipe embedment from the sewer subgrade to outside bottom of the sewer pipe, shall be "Type B" Import graded so that the pipe can be laid to proper line and grade.

Remainder of embedment to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the pipe barrel shall be "Imported Material" and unless otherwise required by the Engineer, either Import "Type A", or Import "Type B" may be used.

For building sewers, a transition coupling and cleanout shall be provided and installed at the property line. The transition coupling pipe embedment shall be Type B imported from three inches below the outside bottom of the coupling to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the coupling.

b. FLEXIBLE PIPE

That portion from the sewer subgrade to the spring line of the pipe shall be "Type B" Import. This Import shall be installed in two (2) stages.

STAGE ONE - Shall be from the sewer subgrade to the outside bottom of the sewer pipe, the import shall be graded so that the pipe can be laid to proper line and grade.

STAGE TWO: - After the pipe has been installed to the proper line and grade, the remaining import shall be installed around the pipe from the outside bottom of the pipe to the spring line.

Remainder of embedment to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the pipe barrel shall be "Imported Material" and unless otherwise required by the Engineer, either Import "Type A", or Import "Type B" may be used.

For building sewers, a transition coupling and cleanout shall be provided and installed at the property line. The transition coupling pipe embedment shall be Type B imported from three inches below the outside bottom of the coupling to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the coupling.

2. BUILDING SEWERS IN UNPAVED PRIVATE PROPERTY FROM PROPERTY LINE TO BUILDING

a. RIGID PIPE

That portion of the pipe from the sewer subgrade to outside bottom of the sewer pipe, shall be "Type A" Import, "Type B" Import, or a material approved by the District such as sand or pea gravel, graded so that the pipe can be laid to proper line and grade.

A transition coupling and cleanout shall be provided and installed at the property line. The transition coupling pipe embedment shall be Type B imported from three inches below the outside bottom of the coupling to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the coupling.

b. FLEXIBLE PIPE

That portion from the sewer subgrade to the spring line of the pipe shall be "Type A" Import, "Type B" Import, or a material approved by the District such as sand or pea gravel. This Import shall be installed in two (2) stages.

STAGE ONE - Shall be from the sewer subgrade to the outside bottom of the sewer pipe, the import shall be graded so that the pipe can be laid to proper line and grade.

STAGE TWO - After the pipe has been installed to the proper line and grade, the remaining import shall be installed around the pipe from the outside bottom of the pipe to the spring line.

Remainder of embedment to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the pipe barrel shall be "Type A" Import, "Type B" Import, or Trench Excavated material.

A transition coupling and cleanout shall be provided and installed at the property line. The transition coupling pipe embedment shall be Type B imported from three inches below the outside bottom of the coupling to a point at least six (6) inches, but no more than twelve (12) inches above the outside top of the coupling.

9.05 TRENCH BACKFILL MATERIAL

Trench backfill material is considered to be all material placed in the trench between the pipe embedment and the road bed or ground surface.

A. BACKFILL IN PUBLIC RIGHTS OF WAY, UNION SANITARY DISTRICT EASEMENTS, PUBLIC UTILITY EASEMENTS, OR IN EXISTING OR FUTURE PAVED AREAS

The material, placement and compaction shall be done in accordance with the requirements and inspection of the City having jurisdiction there over.

B. BACKFILL IN EXISTING AND FUTURE UNPAVED PRIVATE PROPERTY AREAS

The material placed must meet the following requirements:

1. NATIVE BACKFILL

Unless otherwise shown on the Project Plans or Specifications or otherwise required by the Engineer, "Native Backfill" may be used provided that it is free from vegetable matter and refuse and shall contain no concrete, stones or clods larger than four (4) inches in diameter and shall contain sufficient fines so that all voids will be filled when compacted, and shall be so constituted that compaction requirements can be met.

It shall be compacted to the same degree of compaction as the adjacent ground or a minimum of 85% Relative Compaction per ASTM D-1557, whichever is greater.

2. IMPORTED BACKFILL

In areas where the excavated material does not meet the requirements for "Native Backfill", then material meeting the requirements for Import "Type A", or "Trench Excavated Material" under Section 9.03 may be used. It shall be compacted to the same degree of compaction as the adjacent ground or a minimum of 85% Relative Compaction, whichever is greater.

C. COMPACTION

The method the Contractor uses to meet compaction requirements is not specified except for the following limitations.

1. Compaction shall be achieved by mechanical means. Water settling, jetting, ponding, and other water compaction methods are prohibited. Compaction testing shall be done in accordance with the requirements of the City or other agency having jurisdiction.
2. For sloped trenches, or when heavy-impact compaction equipment is used, such as sheep-foot wheels and self-propelled compactors, the Contractor shall protect the pipe from being damaged during mechanical compaction. To provide this protection, the pipe shall be covered with a minimum of 30 inches of Type "A" import at the time of installation. The remainder of the backfill shall be in accordance with the requirements of the City or other agency having jurisdiction.

SECTION 10 - PAVING REPLACEMENT

10.01 DEFINITION

Paving shall mean that portion of the material in the trench, from the top of the backfill to the surface of the ground. It includes all lime or cement treated base material, rock, aggregate base, and surface pavement material.

10.02 PAVING IN PUBLIC RIGHTS-OF-WAY OR PUBLIC UTILITY EASEMENT

Paving in these areas shall be done in accordance with the requirements of the City or other Agency having jurisdiction there over.

10.03 PAVING IN UNION SANITARY DISTRICT EASEMENTS AND IN PRIVATE PROPERTY

Paving shall be replaced in kind unless otherwise shown on Plans or required by the Engineer.

All existing pavement at trench edges shall be saw cut to sound pavement and the exposed surfaces coated with tack coat applied in accordance with CalTrans Standard Specification 39-4.02 just prior to paving.

The pavement shall in all cases be removed to a minimum of three (3) inches outside of the excavation to permit proper keying of the restored pavement.

SECTION 11 - MISCELLANEOUS REQUIREMENTS

11.01. INSPECTION

A. CONFORMANCE TO THESE SPECIFICATIONS

All work done under these specifications shall be subject to rigid inspection and shall be performed to the satisfaction of the Engineer.

B. DOCUMENTS OF MATERIALS AND PERFORMANCE TESTS

The Contractor shall, at any time when requested by the Engineer, submit at his/her expense, properly authenticated documents of materials and performance tests as proof to the District of compliance with these Specifications.

C. ACCESS TO JOB SITE

The Engineer shall, at all times, have access to the work during construction, and the Contractor shall provide proper and safe facilities for such access and inspection.

11.02 ALTERATIONS

The Engineer reserves the right to increase or decrease the quantity of any item or portion of the work, and to make such alterations or deviations, additions or omissions from the approved Plans as may be determined during the progress of the work to be necessary and advisable for the proper completion thereof.

11.03 DEFECTIVE WORK AND/OR MATERIALS

All work which has been rejected shall be remedied, or removed and replaced by the Contractor in an acceptable manner.

All materials not conforming to these Specifications shall be considered as defective and all such materials, whether in place or not, will be rejected. They shall be removed immediately from the site of the work.

11.04 MANHOLE PROTECTION

Particular care must be taken to protect new and existing manholes from damage and to keep rock, dirt or debris from getting into the sewer.

On new manholes, or manholes that have had frame and cover removed, a steel cover of adequate strength, close fitted and well secured, shall be installed over the manhole opening until the frame and cover are permanently installed.

Ground or surface water must be kept out of existing sewers. Temporary plugs may be required by the Engineer to effect this protection.

When so indicated on the Plans or required by the Engineer, manholes in unpaved areas subject to future development will be protected by installation of a 3/4 inch plywood cover

installed directly on the manhole block. This cover will be close fitting (cut in two (2) pieces to facilitate installation down the manhole neck) and installed immediately after final inspection by the Engineer.

11.05 USE OF EXISTING BUILDING SEWERS

Existing building sewers disconnected from buildings that have been demolished, or moved, may be used for new buildings only when found by the Engineer to be in conformity with these Specifications. Full bore rodding and television inspection of the building sewer will be required as part of the review process.

11.06 BUILDING SEWER MARKING

Each building sewer shall be marked at the location where it passes under the property curb in the following manner:

A. NEW CURB

Where new curbs are constructed, a two (2) inch high letter "S" shall be impressed with an approved stamp into the fresh concrete on the curb so as to be clearly visible.

B. EXISTING CURBS

Where curbs already exist, a two (2) inch high letter "S" shall be neatly chiseled on the curb so as to be clearly visible.

11.07 MANHOLE MARKING

If deemed necessary by the Engineer, manholes located in easements will be marked with a District Marker. Marker will be supplied and installed by District Forces (at others expense.)

11.08 REPAIR OF DAMAGED SEWERS AND OTHER UTILITIES

A. NEW MAIN AND/OR BUILDING SEWERS

Main and/or building sewers not yet accepted by the District that are damaged during construction will be repaired by the Sewer Contractor in accordance with these Specifications and Standard Details. The work shall be done in the presence of and to the satisfaction of the Engineer. The portion of the pipe bedding from sewer subgrade to outside bottom of sewer pipe shall be satisfactorily installed before the pipe is laid.

B. EXISTING MAIN SEWER OR APPURTENANCES

Repairs or relocations of existing main sewers or appurtenances required by reason of damage, or conflict, will be performed by the District or by Contractors engaged by the District through a Contract or Encroachment Agreement.

Before any such work is started by District Forces, a standard District "Work Order" must be signed by the party or his/her agent, responsible for payment, authorizing the work by District Forces and agreeing to pay charges incurred. Upon completion of the work, the

District will bill the party responsible for payment thereof.

C. EXISTING BUILDING SEWERS

Except as noted below or otherwise agreed to by the District, all work involving repair or relocation of existing building sewers shall be done by private Contractors. Minimum inspection fees must be paid and a sewer construction permit issued prior to start of work. All work must be done per District Specifications and subject to District Inspection.

If such work is to be done by District Forces, a standard District "Work Order" must be signed by the party or his/her agent, responsible for payment, authorizing the work by District Forces and agreeing to pay charges incurred. Upon completion of the work, the District will bill the party responsible for payment thereof.

In event repair work is deemed necessary by the District, in its sole discretion, to alleviate a threat to the District's sewer system, and no "Work Order" is signed by the party or agent responsible for payment, or emergency repairs are undertaken by District, no approval and acceptance of construction will be issued by District until the reasonable cost of repairs are paid or arrangements appropriate to District are made for such reimbursement.

D. REPAIR OF OTHER AGENCY FACILITIES

Repair of other Agency utilities damaged during construction shall be made in accordance with the requirements of the Agency concerned.

11.09 CONNECTION OR ADJUSTMENTS TO EXISTING MAIN SEWERS OR APPURTENANCES

Except for work on sewers not yet accepted by the District, all work on existing main sewers shall be done by District Forces, including:

- A. Splice into Main Sewer (See Section 22.08).
- B. Stub into Existing Public Manhole (See Section 21.20)
- C. Rechanneling Existing Public Manhole.
- D. Installation of Plywood Cover Over Existing Public Manhole Base Block.

The charge for said work by District Forces is based on the District's current rate schedule. A sewer "work Request Form" signed by the Contractor shall be submitted and the charges as estimated by the District paid prior to issuance of a sewer construction permit. Refunds or additional billing will be made after completion of the work and will be based upon actual costs incurred.

The exact time that the work is to be done by District Forces must be arranged by the Contractor with the District Office (an inspector or an inspection coordinator) at least 48 hours (2 business days) in advance preceding the work day. Messages or voicemails are not acceptable. Work to be done by District Forces that, due to its' unusual character, is not listed on the rate schedule will be billed after the work is accomplished on the basis of actual costs. Before any such work is started by District Forces, a standard District "Work Order" must be signed by the party responsible for payment, authorizing the work by District Forces.

All work done by District Forces must be paid, or appropriate arrangements satisfactory to District made, prior to District accepting construction and reporting acceptance and approval to the Governing Municipality.

11.10 ABANDONMENTS

Abandonment of existing District facilities shall be performed by Contractors engaged by the District through a Contract or Encroachment Agreement.

A. MAIN SEWERS

Main sewer pipe that is required to be abandoned shall be abandoned by one of the following methods:

1. Filling with slurry. Slurry shall be a flowable mix containing a minimum of 1 sack cement, maximum of 1 ½ sack cement per cubic yard.
2. Removing the existing pipe.

B. BUILDING SEWER

Unless otherwise noted on the approved Plans, Union Sanitary District, at its own expense, will cap, at the property line, any building sewer serving a building that is to be moved or demolished. The Contractor shall notify the District to arrange for the capping of the building sewer.

If it is noted on the improvement plans that the building sewer is to be capped by the Contractor, the sewer shall be capped with an approved coupling and a watertight cap as close to the main as possible but in no case further from the main than property line. This work shall be done in the presence of and to the satisfaction of the Engineer.

C. MANHOLE

Castings and manhole body shall be removed to a minimum of two (2) feet below final street grade or existing ground elevation, whichever is lower. The castings shall be delivered to Union Sanitary District, 5072 Benson Road, Union City, California 94587.

Drainage holes shall be made at the bottom of the manhole and the channel shall be sealed to a watertight condition with concrete. The manhole shall then be filled and compacted with self-compacting material as approved by the Engineer and City jurisdiction. Entry into "live" District manholes is generally prohibited, but may be allowed if the Contractor secures an Encroachment Agreement from the District.

D. SEPTIC TANK

Every cesspool, septic tank, and seepage pit which has been abandoned or has been otherwise discontinued from further use, or to which no waste or soil pipe from a plumbing fixture is connected, shall have the sewage removed, the tank rinsed and emptied again, and be completely filled with earth, sand, gravel, concrete or other approved material.

Before filling of the cesspool, septic tank or seepage pit, drainage holes shall be made at the

bottom of the tank. The top cover or arch shall be removed before filling, and the filling shall not extend above the top of the vertical portions of the sidewalls or above the level of any outlet pipe until it has been inspected. After inspection, the cesspool, septic tank or seepage pit shall be filled to the level of the top of the ground.

11.11 GREASE AND OIL COLLECTION SYSTEMS

A. GENERAL

For the purposes of this specification section, a restaurant is any facility that prepares or serves food to non-family members. This includes full-service restaurants, fast food restaurants, take-out restaurants, recreation facilities, cafeterias for employees; grocery store take-out facilities, delicatessens, ice cream and yogurt shops, etc.

All restaurants shall be equipped with grease interceptors and/or grease traps designed to limit the discharge of grease and oil to the District’s sewer system. The size and type of restaurant shall dictate the size of the grease trap or grease interceptor required. The minimum sizes specified are subject to review and approval by the Engineer.

B. GREASE INTERCEPTORS

Fast food restaurants, grease intensive restaurants with a seating capacity of 50 seats or more, and/or restaurants with a seating capacity of 70 seats or more shall have an outside grease interceptor installed with the minimum liquid capacity indicated below.

Restaurant Seating Capacity	Minimum Grease Interceptor Capacity
50 to 69 ⁽¹⁾	1,250 gallons
70 to 125	1,500 gallons
126 to 150	2,000 gallons
151 or more	3,000 gallons

⁽¹⁾ Grease intensive restaurant

Designation as a grease intensive restaurant shall be as determined by the District Engineer. In given situations, or applications, the next larger size may be required due to the nature of the usage. Examples are Mexican, Indian and Chinese restaurants or buffets. Non-grease intensive restaurants shall typically include delicatessens, bakeries/donut shops, ice cream/frozen yogurt shops, pizza parlors and other restaurants with limited cooking that do not contain deep fryers, or grills. Those facilities that have less than 20 seats, but are similar to fast food shall have a minimum 1,250 gallon interceptor. The presence of floor drains in food service areas shall require the installation of a minimum 1,000 gallon grease interceptor. Grease interceptors shall be three-compartment interceptors as shown in the Standard Details and shall be manufactured by Jensen Precast, or approved equal.

C. GREASE TRAPS

Restaurants with a seating capacity of less than 50 seats and/or non-grease intensive restaurants with a seating capacity of less than 70 seats that do not have an outside grease interceptor shall have an under-the-counter grease trap with a minimum grease storage capacity shown below.

Restaurant Seating Capacity	Minimum Grease Trap Capacity
29 or less	100 pounds
30 to 49	200 pounds
50 to 69 ⁽²⁾	200 pounds

⁽²⁾Non-grease intensive restaurant

Designation as a grease intensive restaurant shall be as determined by the District Engineer. In certain applications, multiple 100 lb. grease traps may be required to satisfy the capacity for that location at the point source (pot sink, prep. sink, wok range, etc.). Butcher markets with associated food service and cooking onsite shall have a minimum 200 lb. grease trap.

D. CONNECTIONS

All kitchen area mop, pot, and prep sinks shall be connected to the grease trap or interceptor. All Kitchen floor drains shall be connected to the interceptor.

E. DISHWASHERS

Dishwashers shall not be connected to any grease trap or grease interceptor.

F. GARBAGE DISPOSALS

Garbage disposals or grinders are prohibited at all restaurants.

G. OTHER REQUIREMENTS

Grease interceptors shall also be required at commercial car washes, commercial trash compactors, trash enclosures, and at other commercial and industrial establishments as deemed necessary by the District. For commercial car washes, a two-compartment sump followed by a three-compartment grease interceptor is required. For garbage enclosures, a two-compartment sump or connection to a grease interceptor, if available, is required. For commercial trash enclosures, an interceptor is required. Grease interceptor sizing shall be as determined by the District Engineer, and shall be no less than 1,000 gallons.

SECTION 12 – TESTING

12.01 TESTING MAIN SEWERS

The Contractor shall, in the presence and under the direction of the Engineer, test the air tightness of all main sewer lines. The test will be made between each adjacent structure and between the most upstream structure and dead-end. The air test will be made only after all other utilities and the curb and gutter have been installed and before any street base rock has been oiled.

A. WHEN TESTED

1. In areas to be left unpaved, the air test shall be made after the backfill is satisfactorily compacted.
2. In areas to be paved, per Improvement Plans, when the outside top of the sewer is less than three (3) feet below the top of backfill, the air test shall be made after the "base rock" portion of the paving is satisfactorily compacted and before any street base rock has been oiled.
3. In areas to be paved, per Improvement Plans, when the outside top of the sewer main is three (3) feet or more below top of backfill, the air test shall be made after all other utilities and the curb and gutter have been installed and the "sub-base" material portion of the paving is satisfactorily compacted.

The air test as noted in 1, 2 or 3 above is considered the "official test". However, preliminary air testing is strongly recommended and may be conducted by the Contractor at any time prior to the "official test".

B. EQUIPMENT

The Contractor shall furnish all necessary equipment, including but not limited to: an air compressor, air hoses, blank plug, test gauge, test plug, stopwatch, and personnel for conducting the test.

C. AIR TEST PROCEDURE

1. Air shall be slowly fed into the plugged pipe until the internal air pressure reaches 4.0 pounds per square inch greater than the average back pressure of any groundwater that may submerge the pipe.

At least two minutes shall be allowed for temperature stabilization before proceeding further.

2. The rate of air loss shall then be determined by measuring the time interval required for the internal pressure to decrease from 3.5 to 2.5 pounds per square inch greater than the average back pressure of any groundwater that may submerge the pipe.
3. Air testing sewer mains, particularly larger diameter mains, can be very dangerous due to the very large forces developed. The Contractor shall be fully responsible and take all precautions necessary to ensure the safety of their workers. All plugs shall be adequately braced to support the full load developed. No workers shall be allowed in the

excavation or manhole while the line is under pressure. The Contractor shall make provisions for reading the pressure at the ground surface and for safely releasing the air pressure without entering the manhole or excavation.

D. AIR TEST REQUIREMENTS

1. The pipeline shall be considered acceptable, when the total time interval for the pressure drop from 3.5 to 2.5 pounds per square inch meets or exceeds the calculated test time based on the following table. This table is based on a rate of 0.0015 cubic feet per minute per square foot of internal pipe surface when tested per ASTM C-828. At the Inspector's option, the test may be conducted for a pressure drop of 3.5 to 3.0 pounds per square inch and 1/2 of the time shown.

Minimum Test Time for 1 PSI Pressure Drop

Pipe Diameter, inches	Test Time, (seconds/ft x feet)	Minimum Test Time, (minutes:seconds)
4	0.379	3:46
6	0.853	5:40
8	1.517	7:33
10	2.370	9:26
12	3.413	11:20
15	5.333	14:10
18	7.679	17:00
21	10.452	19:50
24	13.651	22:48
27	17.277	28:51
30	21.330	36:37
33	25.809	43:01
36	30.715	51:17
39	36.048	60:11
42	41.807	69:48

2. If the pipe installation fails to meet these air test requirements, the Contractor shall determine the source or sources of leakage, and he shall repair or replace all defective materials or workmanship in accordance with these Specifications and in the presence of the Engineer. The completed pipe installation shall meet the requirements of this test.

E. MANDREL OR DEFLECTOMETER TEST

Mandrel test for flexible pipes shall also meet the requirements specified in 5.02.B.6.

1. FLEXIBLE PIPE LESS THAN 18" IN DIAMETER

Upon completion of the air test, the Contractor shall pull a mandrel or deflector, approved by the Engineer, through the installed flexible pipe. This test shall be performed without mechanical pulling devices. Mandrel shall not be tampered with.

2. FLEXIBLE PIPE 18" OR GREATER IN DIAMETER

At the end of each working day, or as directed by the Engineer, the Contractor shall pull an approved Mandrel or Deflectometer through the portion of the pipe specified by the Engineer. This section of pipe will have pipe embedment fully in place and compacted per these specifications plus at least four feet of backfill in place with a minimum of 85% relative compaction per ASTM D-1557. This shall be a preliminary test only to insure the integrity of the pipe at the time of installation. The Mandrel test for acceptance shall be performed after the air test as described in Section 12.01.

12.02 TESTING BUILDING SEWERS

The Contractor shall, in the presence and under the direction of the Engineer, test the air-tightness of all building sewer lines. The test will be made between the cleanout to grade at the property line, "test-wye" or manhole and the most upstream dead-end at a point not more than five (5) feet outside the building line (see A-2 below for exception). Note that actual connection of the building sewer to the building plumbing will not be permitted until the main sewer to which it connects has been accepted for use by the District and the herein described testing has been satisfactorily completed. Entry into "live" District manholes requires an Encroachment Agreement from the District.

A. WHEN TESTED

1. In all areas, the official air test shall be made after the backfill is satisfactorily compacted, base rock installed and all other underground utilities, private and public, installed.

Preliminary air testing is strongly recommended and may be conducted by the Contractor at any time prior to the "official test".

2. Exception to 1 above is when a water test is authorized by indication on the Plans or as directed by the Engineer in the field. In these cases, the following procedure will be used: After the building sewer has been laid, and the pipe bedding installed to the satisfaction of the Engineer, the sewer shall be filled with water in the presence of the Engineer. Any and all leaks shall be found and repaired by the Contractor in accordance with these Specifications, after which the sewer trench shall be immediately backfilled.

B. EQUIPMENT

Same as for main sewers

C. PROCEDURE

Same as for main sewers

D. REQUIREMENTS

Same as for main sewers

E. MANDREL OR DEFLECTOMETER

Upon completion of the air test, the Contractor shall pull a mandrel or deflectometer approved by the Engineer between manholes on sewer lines six (6) inches in diameter and

larger. This test shall be performed without mechanical pulling devices,

12.03 TESTING PRESSURE SEWERS

This section is intended to be used for small diameter private pressure sewers 4 inches in diameter or less with normal operating pressures of 10 psi or less. The same procedure as described in "Testing Main Sewers" shall be used except that no air loss will be permitted in time period computed for a gravity sewer of same size and length.

The pressure used will be determined by the Engineer and will be equal to 1 1/2 times the maximum pressure the sewer will be expected to withstand in actual use.

12.04 MANHOLE VACUUM TESTING

All manholes shall be vacuum tested. Vacuum test procedures and requirements shall be as follows:

1. After completion of the manhole barrels but prior to backfilling, sealing of PVC liner seams and installing grade rings, all openings in the manholes are sealed with plugs and a rubber ring "donut" type plug inserted inside the opening of the cone.
2. A small vacuum pump is attached to a hose connected to the plug and 4 psi (8 in. Hg) of vacuum applied.
3. The vacuum is permitted to stabilize at 3.5 psi (7 in. Hg) for 1 minute; then the test is begun.
4. The manhole must maintain vacuum such that no greater than 0.5 psi (1 in. Hg) of vacuum is lost during the specified test period. The specified test period is as follows:

Manhole depth (feet)	Test period (minutes)
0 - 5	4.5
5 -10	5.5
10 - 15	6.0
Greater than 15	6.5

5. Manholes that fail the test shall be corrected as required and retested.
6. A vacuum regulator shall be provided on the vacuum pump such that no greater than 10 psi (20 in. Hg) can be applied to the manhole during the test. All manholes that do not meet the leakage test, or are unsatisfactory from visual inspection, shall be repaired to the satisfaction of the Engineer.

SECTION 13 - TELEVISION INSPECTION

13.01 INSPECTION OF MAIN SEWERS

Television inspection of sewer mains is required to be inspected with District television equipment operated by District Forces. The cost of initial television inspection is considered to be included in the permit fees. Any subsequent reinspection shall be at the cost of the permit holder.

13.02 WHEN TESTED

After final air testing and mandrel testing in conformance with Section 12.

Any portion of the sewer found not to be in conformance with these Specifications must be corrected by the Contractor. Sewers so corrected shall be re-tested and inspected in accordance with the requirements of these Specifications.

SECTION 14 - CLEANING

14.01. CLEANING

After the sewers have satisfactorily passed the tests required in Section 12, structures, backfilling and final paving are completed, the Contractor, in the presence of the Engineer, shall clean each section of the sewer in the following manner:

A. SEWERS EIGHT (8) INCHES THROUGH TWELVE (12) INCHES IN DIAMETER

A heavy rubber ball, such as the "Wayne Ball" or approved equal, shall be inflated with air so that it will fit snugly into the sewer pipe to be cleaned. The ball shall be placed in the last (upstream) structure on the line and water introduced into the structure back of the ball. The ball shall be passed through the sewer pipe with only the pressure of the water behind it.

The rate at which the ball is allowed to pass through the sewer pipe shall be controlled by a rope attached to the ball at all times. Care must be taken not to feed the ball too rapidly, as the debris flushed out ahead of the ball must be removed at each structure.

High pressure hydraulic cleaning or jetting may be allowed with the prior approval of the District Engineer.

B. SEWERS FIFTEEN (15) INCHES IN DIAMETER AND LARGER

The Engineer shall visually inspect the sewer and if in his/her opinion cleaning is necessary, the Contractor shall clean the sewer to the satisfaction of the Engineer. District may clean the sewer in these sizes at Contractor's request and at his/her expense.

High pressure hydraulic cleaning or jetting may be allowed with the prior approval of the District Engineer.

C. FOUR (4) INCH AND SIX (6) INCH BUILDING SEWERS

When in the opinion of the Engineer, the sewer is not clean it shall be flushed or otherwise cleaned so as to properly serve its intended function.

High pressure hydraulic cleaning or jetting may be allowed with the prior approval of the District Engineer.

14.02 DISCHARGE OF CLEANING WATER

Unless otherwise authorized by the Engineer, water used for cleaning the lines shall not be permitted to be discharged into the existing sewer system.

SECTION 15 - SITE CLEANUP AND RESTORATION

15.01 SITE CLEANUP AND RESTORATION

Surplus pipeline material, tools, remaining material from site preparation, etc., shall be removed by the Contractor, and all dirt, broken pavement, rubbish and excess earth from excavation shall be hauled to an approved disposal site provided by the Contractor and the construction site left clean, to the satisfaction of the Engineer.

Replaceable items such as fences, signs, landscaping, etc., requiring removal during construction operations must be replaced in kind by the Contractor at his/her expense or disposed of as noted on the Plans. Any driveway areas or other improvements requiring removal and/or excavation will be restored to a condition equivalent to their original condition all to the satisfaction of the Engineer.

On District contract jobs, the value of and the responsibility for damage to objects that cannot be replaced in kind must be negotiated between the Contractor and the District before the removal of those objects.

INFORMATION BULLETIN

This Bulletin is published for the information and guidance of those concerned with the regulations and requirements for design of sanitary sewers in Union Sanitary District, Alameda County, California.

It has been adopted as a part of the approved Union Sanitary District "Standard Specifications" for Sewer Construction.

The present boundaries of Union Sanitary District include all areas annexed to Union Sanitary District in the sphere of influence areas of the cities of Fremont, Newark and Union City.

SECTION 16 - REQUIREMENTS FOR ISSUANCE OF SEWER CONSTRUCTION PERMITS

16.01 PROPERTY TO BE SERVED BY USD

All property to be served must be within the District boundaries.

16.02 INSURANCE REQUIREMENTS

All main sewer and building sewer work in the District shall be performed by Contractors with current Worker's Compensation and Public Liability insurance coverages. The amount of coverage for the Public Liability insurance shall be as set forth in District Ordinance No. 34 or subsequent amendments thereto. The Public Liability policy of insurance shall include, as additional insureds, the Union Sanitary District and each of its officers, employees, and agents.

16.03 LICENSE REQUIREMENTS

All main sewer and building sewer work in the District shall be performed by Contractors licensed by the State of California to perform such work except as noted in 16.04 B below. The Contractor will be required to sign necessary District forms prior to being issued a sewer construction permit.

16.04 BOND/DEPOSIT REQUIREMENTS

A. MAIN SEWER WORK

For construction, repairing or altering a "Main Sewer", a Surety Bond in a sum equal to 100% of the estimated cost of the work, guaranteeing the faithful performance of the work in accordance with the ordinances and rules and regulations of the District, including making good any defects through faulty, improper or inferior workmanship or materials arising or discovered within one (1) year after the completion of said work and acceptance thereof by the District. However, if the City or municipality within which such work is to be performed requires the filing of a Faithful Performance Bond guaranteeing making good defects through faulty, improper or inferior workmanship or materials arising or discovered within one (1) year after completion and acceptance of said work, no such bond will be required to be filed with the District.

B. BUILDING SEWER WORK BY CONTRACTOR OR OWNER

An individual or a contractor may apply for a permit for the installation or repair of a portion of a building sewer which is on private property by posting a cash deposit with the District, in accordance with the provisions of District Ordinance No. 34 or subsequent amendments thereto. The cash deposit will be refunded within 60 days of approval of work by the District.

16.05 FEES AND CHARGES

All fees and charges levied by the District are payable before issuance of a sewer construction permit unless otherwise noted herein. Except for any special fees or charges, all types are noted below:

A. ANNEXATION FEE

Process Application Fees and Annexation Fees are payable by all Developers or Property Owners for land not within the District boundaries per current District Ordinance No. 20 and 25 series.

The Process Application Fee and the First Installment of the Annexation Fee is due and payable upon request for annexation. The request must be signed by the Owner of the property and be accompanied by a copy of the Title Report and a location drawing of the property to be annexed.

The applicant is required to provide, at his/her expense, all necessary maps and descriptions required for approval by the Local Agency Formation Commission along with digital copies of all maps and descriptions in accordance with Section 16.14, Minimum Requirements for Digital Submittal. These documents are submitted to the District for transmittal to Alameda County for review and ultimately to the Commission for their review and approval.

A building sewer construction permit may not be issued, or construction work may not be accepted, until the property is annexed to the District. The annexation process may take up to 6 months or longer.

B. DOCUMENT REVIEW FEE

Per current District Ordinance No. 34 Series, document review fees are payable for the review of documents such as an easement or an encroachment permit.

C. STUDY FEE

Per current District Ordinance No. 34 Series, study fees are payable for the costs of a study of the effects of the proposed development.

D. PLAN REVIEW FEE

Per current District Ordinance No. 34 Series, plan review fees are payable by all Developers for the review of plans. District construction unit prices are used in the computation.

E. INSPECTION FEE

Per current District Ordinance No. 34 Series, inspection fees are payable by all Developers and/or permit holders for inspection services. District construction unit prices are used in the computation.

F. CAPACITY CHARGES

Per current District Ordinance No. 35 Series, capacity charges are payable by all Developers and/or Owners

G. FRONTAGE FEE

Per current District Ordinance No. 30 Series, frontage fees are payable by all Developers proposing to connect directly to District financed main sewers.

H. MATERIALS AND SERVICE FEE

Per current District Ordinance No. 34 Series, materials and service fees are payable to the District for materials furnished by the District and work done by District Forces in accordance with the construction requirements as shown on approved Plans and in the Standard Specifications. (See Section 17.02 herein).

I. REIMBURSEMENT FEE

Per current District Ordinance No. 9 Series, reimbursement fees are payable by Developers connecting to the frontage of main sewers installed by others, or tributary to the area, which are subject to reimbursement. Conditions and requirements of specific Reimbursement Agreements may apply.

J. WASTEWATER DISCHARGE PERMIT FEE

Per current District wastewater Discharge Ordinance, these fees are payable by users who are required to obtain a Wastewater Discharge Permit for discharge on non-domestic type wastes.

K. FAILURE-TO-OBTAIN-A-PERMIT FEE

Per current District Ordinance No. 34 Series, these fees are payable by the person(s) or Contractor(s) performing sewer work without a valid USD permit.

16.06 PERMIT HOLDER DEPOSIT

A cash deposit will be required from the person(s) or Contractor(s) performing sewer work for possible damage to District and private facilities and additional expense for correcting poor or improper workmanship and materials. Within 60 days after final approval of the sewer, per Section 19 herein, this deposit will be refunded.

16.07 DEVELOPER DEPOSIT

A cash deposit per "Cleanout To Grade" or "Control Manhole" may be required from the Developer prior to issuance of a sewer construction permit. District construction unit prices are used for determination of deposit. Within 60 days after final approval of the sewer, per Section 19 herein, this deposit will be refunded.

16.08 SUBMISSION OF DATA FOR MAIN SEWERS

A. PRELIMINARY PLANS

Three (3) sets of Preliminary Improvement Plans, Development Plans and Maps (tract map, parcel map, etc.), prepared by a Registered Civil Engineer in the State of California, must be submitted to the District. Standard size sheet of 22" x 34", 24" x 36", or 30" x 42" with a scale of 1"=40' or 1"=50' and profile to 1"=4' or 1"=2' must be used unless otherwise authorized by the Engineer. These will be reviewed by the Engineer and one (1) corrected copy returned to the applicant.

A digital copy of all preliminary plans shall be submitted in one (1) drawing file in accordance with Section 16.14, Minimum Requirements for Digital Submittal.

B. FINAL PLANS

After corrections are made, the original drawing can be signed by the Engineer. After all approving Agencies have signed the Plans, one (1) Plan of the Development drawn to a scale of 1"=100 and two (2) sets of Final Improvement Plans, Development Plans, Final Maps and Certificate Sheet suitable for microfilming must be furnished to the District. Unless otherwise authorized by the Engineer, these signed plans must be submitted to the District prior to issuance of a main sewer construction permit.

A digital copy of all final plans shall be submitted in one (1) drawing file in accordance with Section 16.14, Minimum Requirements for Digital Submittal.

C. ESTIMATE OF THE QUANTITY OF MATERIAL

One (1) copy of the final estimate of the quantities of the materials for the sanitary sewer system.

D. EASEMENT REQUIREMENTS

A main sewer authorized by the Engineer to be constructed on private property will require that a Sanitary Sewer Easement be granted to the District. It must be prepared by the Grantor on Standard District Forms properly signed and notarized. A location drawing and Title Report must be submitted with the document. A digital copy of the location drawing shall be submitted in accordance with Section 16.14, Minimum Requirements for Digital Submittal. After approval by the District, it shall be recorded by the Design Engineer with the Alameda County Recorder. Once it is recorded, a copy of the recorded document will be furnished to the District. This must be accomplished prior to acceptance by the District of the sewer that lies within the easement.

A separate document will not be required for a Sanitary Sewer Easement granted to the District by means of recorded maps. The easement, however, must be properly shown on a recorded final map and certificate sheet and a copy (both hard copy and digital copy) of each furnished to the District.

Public Utility Easements (P.U.E.) may be used for main sewers only when so authorized by the Engineer. If dedicated by a separate document, a copy (both hard copy and digital copy) with recording data must be furnished to the District.

E. QUITCLAIM REQUIREMENTS

When a Sanitary Sewer Easement is to be quitclaimed, a Quitclaim Deed shall be prepared and submitted to the District. After the document is reviewed and accepted by the District, it will be returned for recording by the Alameda County Recorder. Once it is recorded, a copy of the recorded document will be furnished to the District.

F. FIELD CHANGES

Two (2) sets of Plans and one (1) digital copy in accordance with Section 16.14, Minimum Requirements for Digital Submittal showing field changes proposed must be submitted to the Engineer for approval prior to the work being started.

16.09 SUBMISSION OF DATA FOR BUILDING SEWERS

Submittal requirements for District Plan Check for Building Sewers prior to approval of plans are shown in (A), (B), (C) and (D) below and in Section 16.14 – Minimum Requirements for Digital Submittal. (Does not apply to single family residences unless required by the Engineer).

After plan check is completed by the District, one (1) set of the checked submittals will be returned to the applicant for resubmittal of the required number of revised sets and digital files.

Plan submittals must have information listed below shown on original reproducible tracings to scale with prints submitted there from. Plan must be drawn to adequate scale, with north arrow, on a large enough sheet (11" x 17" min., 30" x 42" max.) and be suitable for microfilming. The minimum scale will be 1"=50' unless otherwise authorized by the Engineer. Digital files shall be in one (1) drawing file and shall be submitted in accordance with Section 16.14 – Minimum Requirements for Digital Submittal.

Name, address, telephone number and title of company or person preparing the plan must be clearly shown on the submitted plans.

Any office or field change from final approved construction plans must be re-approved by the District and may require resubmittal of revised plans and digital CADD files.

A. SITE PLANS

Three (3) copies of Site Plan plus one (1) copy of the digital CADD file. The Site Plan must show (unless otherwise permitted by the Engineer):

1. Public street and property dimensions.
2. All existing and proposed buildings, labeled with general usage and plotted accurately on site.
3. Areas to be paved and those left unpaved clearly marked.
4. Ground floor and pad elevations of all buildings.
5. Finish ground elevations at key points and curb elevations of public street.
6. Existing ground elevations where cover over proposed sewer is to be less than two (2) feet at time of construction.
7. Existing USD manhole number and rim elevation of nearest existing public sanitary sewer manhole in the street drawn to scale or with its distance shown to the site's nearest downstream property corner and the new sewer connection.
8. Existing and proposed utilities plotted correctly and labeled.
9. The proposed sanitary sewer must be shown with size, material, minimum slope, invert elevation to nearest 0.1 foot at connection to building plumbing (building drain).
10. Show invert elevations at all grade breaks.

11. Show invert elevation of all storm sewers at sanitary sewer crossings.
12. Structures proposed such as cleanouts, manholes (with rim and invert elevations), grease clarifiers, etc., labeled and shown on the plan.
13. Plumbing fixture unit count shown for each building.

B. FLOOR PLANS

Two (2) copies of Floor Plan. (Commercial and Industrial Only).
Floor Plan must show area layout and proposed usage of various areas of building.

C. PLUMBING AND / OR MECHANICAL PLANS

Two (2) copies of Plumbing and/or Mechanical Plan. (Commercial and Industrial Only).
Plumbing and/or Mechanical Plan must show interior plumbing (building drain) and the fixtures to be served, all properly labeled as to function.

D. CUT SHEETS

Receipt by District of three (3) sets of cut sheets on Standard District Forms prepared by a Registered Civil Engineer or Land Surveyor. Cut Sheets are required per Section 18.02 herein or when so stated by District on approved plans.

16.10 WASTE DISCHARGE REPORT/PERMIT

One (1) copy of either a Waste Discharge Report or Permit Form as required by the District Pretreatment Ordinance and Technically Based Local Limits - Ordinance No. 36 Series (Commercial and Industrial Only). After review of these submittals, it may be necessary for the owner or his/her representatives to meet with the Engineer prior to approval of plans.

16.11 EASEMENT REQUIREMENTS

When a private easement (across adjoining property) is required for installation of a building sewer, a copy of the recorded document must be submitted to the District prior to issuance of a sewer construction permit.

16.12 CITY BUILDING PERMIT

Prior to issuance of the sewer connection permit, it shall be necessary for the applicant to provide evidence of the necessary Building Permits from the appropriate jurisdiction.

16.13 ENCROACHMENT PERMIT

Whenever it will be necessary for workers, material, equipment or excavated trench material to be on real property not included in any deed, grant, easement or the like, an encroachment permit, license or other permission in writing must be submitted to the District prior to issuance of a sewer construction permit.

16.14 MINIMUM REQUIREMENTS FOR DIGITAL SUBMITTAL

Digital files submitted shall be based on accurate coordinate geometry calculations and registered to the California State Plane Coordinate System (Zone 3) in units of feet for horizontal control, NAD83, and NAVD29 in units of feet for vertical control or other ties as authorized by USD. The digital file submitted shall be in dwg or dxf format and shall be in one (1) drawing file containing all layers, illustrating all improvements within the project area, including all existing and proposed offsite improvements, tract boundaries, street centerlines, outfall sewers, etc. Descriptive information (i.e. text) may be included in the same layer and the feature, or added as a separate layer. Submitted digital files shall be in accordance with the Guidelines for Digital Submittal, or as otherwise approved by USD.

All maps and associated plans, except those for private sewers or laterals, shall be submitted in digital format. Digital submittals shall be submitted with each plan check submittal and shall conform to the following:

A. FILE FORMAT

1. AutoCAD (DWG) or
2. Digital exchange Format (DXF)

B. MEDIA

1. Compact Disk (CD) or
2. FTP site

C. MISCELLANEOUS

1. Each submittal shall be labeled with the project name and/or map number (tract, parcel map, etc.), project number, company name, address and contact phone number.
2. All drawing files shall have a North orientation of vertical (i.e. toward the top of the page).
3. All externally referenced files used shall be "bound" into the drawing file and submitted as one file. Submittal shall not contain externally referenced drawings.
4. Compressed files are acceptable only when using the Winzip utility or if the appropriate software to uncompress the data is provided by the person or firm submitting the file.

D. LAYERING

1. Layers shall contain, but not be limited to, the layers in the table named AutoCAD Layering Conventions. This table is for reference only and is not to be considered as a complete list of available layer names.
2. Layer colors, line types and line weights shall be left to the discretion of the engineer.

**AutoCAD Layering Conventions
For Submission of Developer Projects**

Layer Group	Layer Name	Layer Type	Description
Misc	BORDER		Contains features such as north arrow, vicinity map, location map, title of plans, signature blocks, standard title block, scale bar, legend, page borders, etc.
Misc	DETAILS		Standard construction details of jurisdictional agencies.
Misc	TXT	Text	Layer containing general and construction notes, sheet index, special condition notes, bench mark description, etc.
Civil	BLDG	Polygon	Building foot prints
Civil	BLDG -SETBAK	Line	Building setback line
Civil	BM or BMK	Point	Benchmark
Civil	BNDRY	Polygon	Closed polygon of Tract or Parcel Map boundary
Civil	CL	Line	Centerline - public streets
Civil	CLPVT	Line	Centerline - private streets
Civil	CONTOURS	Polyline	Finished contour lines (grading plans) with elevation attribute (Z value)
Civil	ELEV or EL	Point	Finished spot elevations (grading plans) with elevation attribute (Z value)
Civil	EP	Line	Edge of pavement (i.e. lip of gutter or edge of pavement in the case of no curb and gutter construction)
Civil	ESMT*	Line or Polygon	Easements not related to utilities, such as emergency vehicle access, pedestrian walkways, landscape maintenance, etc.
Civil	FOC	Line	Face of curb line
Civil	LOT	Text	Text indicating lot number
Civil	LP or LIP	Line	Lip of gutter
Civil	MON	Point	Survey monuments
Civil	MONL	Line	Monument line
Civil	PARCEL	Polygon	Closed polygons of each parcel or lot
Civil	ROW	Line	Public rights-of-way
Civil	ROWPVT	Line	Private rights-of-way

Layer Group	Layer Name	Layer Type	Description
Civil	SL	Point	Street light poles
Civil	SLCNDT	Line	Street lighting electrical conduit including pull boxes, service meters, etc.
Civil	STRIPE	Line	Street striping and pavement markings
Civil	STSIGN	Point	Street/traffic signs
Civil	SW	Line/Polygon	Sidewalks including handicapped ramps, driveways, back of walk and meandering walks
Civil	TOPO		All existing topological features (maybe submitted as a separate drawing file)
Civil	TS	Point	Traffic signal fixtures/poles
Civil	TSCNDT	Line	Traffic signal conduit including loop detectors, pull boxes, control cabinets etc.
Landscaping	LSIRR	Line	Public landscape irrigation (I.e. landscape maintenance districts) including service line from public main, water meters, valves, backflow and pressure regulating devices, control valves, etc.
Landscaping	LSTREES	Block insert	Street tree plantings that will be maintained by jurisdictional agency
Landscaping	LSPLANT	Block insert	Bushes, shrubs, groundcover and all other organic landscape material
Landscaping	LID	Polygon	Landscape Improvement Dist.
Landscaping	LLD	Polygon	Landscape/Lighting Dist.
Landscaping	LSMOW	Line or Polygon	Concrete mow strips
Misc	?TXT	Text	Layers containing text associated with various other layers where "?" denotes name of layer (e.g. sanitary sewer text would be named SSTEXT).
Misc	?TIC	Point	Tics at all beginning and ending curves for all utilities, easement boundaries, street centerlines (public and private), tract or parcel boundary, lot boundaries, etc. where "?" denotes name of feature or utility (e.g. CLTIC, SEE NOTE 1).
Sewer	SS	Line	Sanitary Sewer mains
Sewer	SSLAT	Line	Sanitary Sewer service laterals
Sewer	SSMH	Point	Sanitary Sewer manholes
Sewer	SSESMT	Polygon	Sanitary Sewer easements
Stormdrain	SDCI	Block insert	Storm drain curb inlets

Layer Group	Layer Name	Layer Type	Description
Stormdrain	SDESMT	Polygon	Storm drain easements
Stormdrain	SDDI	Block insert	Storm drain drainage inlet
Stormdrain	SDMH	Block insert	Storm drain manhole
Stormdrain	SD	Line	Storm drain
Stormdrain	SDVLT	Block insert	Storm drain vault
Stormdrain	SDFILT	Point	Storm drain filtering device
Stormdrain	SDMH	Point	Storm drain manholes and/or junction boxes
Utility	ELEC	Line	Electric utility line including power poles, underground conduit, pull boxes, vaults, manholes, ducts banks, etc.
Utility	ESMT?	Polygon	Easements where "?" denotes jurisdiction or purpose (PG&E, PUE, EVAE, etc.). Each utility shall have a separate layer (i.e. ESMTPG&E, ESMT PUE, etc.)
Utility	GAS	Line	Gas utility lines including service lines, valves, etc.
Utility	TELECOM	Line	All telecommunications utilities including (but not limited to) MCI, PacBell, Sprint, GTE, etc. showing location of underground lines, manholes, pull boxes, junction boxes, utility poles, duct banks, etc. Line type shall include name of utility.
Utility	CATV	Line	Television, cable TV showing location of underground lines, manholes, pull boxes, duct banks, utility poles, etc.
Utility	<i>UTILITY</i>	Line	Conduit layout of all utilities not specifically designated in this schema. Each utility may have a separate layer named for the utility and shall show all appurtenant facilities
Water	W	Line	Water mains
Water	WESMT	Polygon	Waterline easements
Water	WFH	Point	Fire Hydrants
Water	WFHV	Point	Fire Hydrant valves
Water	WSVC	Line	Water service lines
Water	WM	Point	Water meters
Water	WV	Point	Water valves

Note: The above layer naming conventions are meant only as a guide. It is not necessary to match exactly the naming conventions in this list. Layers that use numbers as names should be renamed using the above naming conventions or standard engineering practices .

SECTION 17 - MISCELLANEOUS MAIN SEWER AND BUILDING SEWER REQUIREMENTS

17.01 REPAIR OR RELOCATION OF EXISTING MAIN SEWER OR APPURTENANCES

Repairs or relocations of existing main sewers or appurtenances required by reason of damage, or conflict, will be performed by the District or by Contractors engaged by the District.

Before any such work is started by District Forces, a standard District "Work Order" must be signed by the party or his/her agent, responsible for payment, authorizing the work by District Forces and agreeing to pay charges incurred. Upon completion of work, the District will bill the party responsible for payment thereof.

In event any of the District's existing sewer mains, manholes or other appurtenances are damaged during construction or repair, and the District Engineer, in his/her sole discretion, determines that a threat to the District's system, the District may employ District Forces or other Contractors to take the necessary steps to repair such damage. In such event, the owner of the property involved, the General Contractor and the Sewer Contractor shall jointly and severally be liable for the District's necessary repair cost. The District may withhold acceptance of construction and reporting the same to the Governing Municipality until payment of the District's necessary repair costs or other financial arrangements to compensate the District are made. No "Work Order" must be signed in order for the owner or any of the owners, agents or contractors to be responsible for repair costs sustained by the District in such an emergency situation.

17.02 CONNECTION OR ADJUSTMENTS TO EXISTING MAIN SEWERS OR APPURTENANCES

Except for work on sewers not yet accepted by the District, all work on existing main sewers shall be done by District Forces, including:

- A. Splice into Main Sewer (See Section 22.08).
- B. Stub into Existing Public Manhole (See Section 21.19)
- C. Rechanneling Existing Public Manhole.
- D. Installation of Plywood Cover Over Existing Public Manhole Base Block.

The charge for said work by District Forces is based on the District's current rate schedule. A sewer "work Request Form" signed by the Contractor shall be submitted and the charges as estimated by the District paid prior to issuance of a sewer construction permit. Refunds or additional billing will be made after completion of the work and will be based upon actual costs incurred.

The exact time that the work is to be done by District Forces must be arranged by the Contractor with the District Office (an inspector or an inspection coordinator) at least 48 hours (2 business days) in advance preceding the work day. Messages or voicemails are not acceptable.

Work to be done by District Forces that, due to its' unusual character, is not listed on the rate schedule will be billed after the work is accomplished on the basis of actual costs. Before any such work is started by District Forces, a standard District "Work Order" must be signed by the party responsible for payment, authorizing the work by District Forces.

All work done by District Forces must be paid, or appropriate arrangements satisfactory to District made, prior to District accepting construction and reporting acceptance and approval to the Governing Municipality.

17.03 REPAIR, RELOCATION OF OR CONNECTION TO EXISTING BUILDING SEWERS

Except as noted below, all such work will be done by private Contractors. Minimum inspection fees must be paid and a sewer construction permit issued prior to start of work and all work must be done per District Specifications and subject to District inspection.

In the event damage necessitating repair or relocation of existing building sewers is caused by a public agency, utility company or their respective agents, the work will be done by District Forces.

In these cases before any such work is started by District Forces, a standard District "Work Order" must be signed by the party or his/her agent, responsible for payment, authorizing the work by District Forces and agreeing to pay charges incurred. Upon completion of the work, the District will bill the party responsible for payment thereof.

In event repair work is deemed necessary by the District, in its sole discretion, to alleviate a threat to the District's sewer system, and no "Work Order" is signed by the party or agent responsible for payment, or emergency repairs are undertaken by District, no approval and acceptance of construction will be issued by District until the reasonable cost of repairs are paid or arrangements appropriate to District are made for such reimbursement.

17.04 USE OF EXISTING BUILDING SEWERS

(See Section 11.05 of the Standard Specifications for requirements).

17.05 ABANDONMENTS

(See Section 11.10 of the Standard Specifications for requirements).

17.06 NUMBER OF BUILDING SEWERS REQUIRED

In accordance with current District Ordinance, the following excerpts are quoted:

"Every building in which plumbing fixtures are installed shall be separately and independently connected to a main sewer or septic tank."

"Where there is more than one building on a lot and where the lot cannot be subdivided under the provisions of any local regulations, a separate building sewer will not be required." For example "Service buildings, such as a garage, power house, or other like buildings where required as an adjunct to and to be used in connection with a residence, public buildings, or commercial plant, may be connected to the building sewer serving the main building."

SECTION 18 - REQUIREMENTS PRIOR TO START OF CONSTRUCTION

18.01 PERMIT

The Contractor must have in his/her possession a valid sewer construction permit issued by the District for all sewer construction. Note that no permit will be issued for connection to, or extension of, any sewer not accepted by the District. See current District Ordinance for inspection fee penalty for starting work without a valid sewer construction permit.

No sewer construction permit will be issued by District until the applicant has a valid building permit issued by the Governing Municipality, unless the applicant is a public agency immune from building permit requirements.

Construction permits will be valid only as long as the building permit issued by the Governing Municipality remains valid. Upon the expiration of the building permit issued for such construction, or issuance of a new parcel map or subdivision map, for the construction on same parcel, additional connection charges will be based on any increase subsequent to the initial charges. Capacity charges along with plan checking and other administrative charges, must be paid prior to issuance of a new sewer construction permit.

18.02 STAKING AND CUT SHEETS

(See Sections 21.07 and 22.06 herein for stake location requirements).

Before start of any sewer construction requiring staking, three (3) copies of cut sheets on the Standard District Form must be submitted to the District (Fax transmissions shall not be accepted). They will be checked within twenty-four (24) hours and one (1) approved copy will be furnished to the Contractor for use in construction. Stakes must not be marked with cuts prior to District approval of cut sheets.

A. DISTRICT PROJECTS

The District will provide all construction stakes and prepare all cut sheets necessary for District Projects.

B. MAIN SEWERS

A registered Civil Engineer or Land Surveyor engaged by the Developer will be responsible for setting stakes and preparing cut sheets.

C. BUILDING SEWERS

A Registered Civil Engineer or Land Surveyor engaged by the Developer will be responsible for setting stakes and preparing cut sheets for all "Townhouse" type projects and any other residential, commercial or industrial developments that in the opinion of the Engineer requires a good control of sewer grade and alignment due to flat slopes, other utilities, and/or circuitous routing.

When such staking and cut sheets are required it will be so indicated on the Plans by the Engineer, prior to approval of Plans. If in the opinion of the Engineer, construction requiring stakes have been set, a field check must be made by the Developer's Engineer to verify the accuracy of the stakes.

18.03 INSPECTION

A. DURING NORMAL DISTRICT WORKING HOURS

The District Inspector or an inspection coordinator must be notified 24 hours (one full business day) prior to the start of any sewer construction during normal District working hours and a request must be made for inspection. Messages or voicemails are not acceptable. This notification applies not only to starting new work, but also to restarting work which has been temporarily halted.

B. OUTSIDE OF NORMAL DISTRICT WORKING HOURS

The District Inspector or an inspection coordinator must be notified 48 hours (two business days) prior to the start of any sewer construction outside of normal District working hours and a request must be made for inspection. Messages or voicemails are not acceptable. All inspection performed during these hours shall be reimbursed to the District at the rates in effect at that time, and as part of the notification requires the signing of a "Work Request Form" prior to any inspection of work being performed. Payment of the inspection charges must be made upon receipt of the billing from the District. The current rate for this service can be determined by contacting the District Office. A minimum of four hours overtime will be charged for any inspections requested for weekends or District holidays. Overtime will be charged in one-hour increments for inspection requested in addition to the normal eight-hour working day.

SECTION 19 - APPROVAL AND ACCEPTANCE OF CONSTRUCTION

19.01 MAIN SEWERS

After all construction of the main sewer has been completed to the satisfaction of the Engineer, all fees and charges paid, all easements, annexations, and maps have been recorded and copies have been given to the District, and all other requirements have been met, the main sewer can be accepted as a public sewer by the District.

19.02 BUILDING SEWERS

After all construction of the building sewer has been completed to the satisfaction of the Engineer, all fees and charges paid, and all other requirements met, the building sewer can be approved by the District. This approval of construction will be indicated by the notification of the City in which the work occurred.

19.03 PAYMENT

In no event will a building or main sewer be approved and accepted, and so reported to the Governing Municipality, until all fees and charges are paid, including charges for work done by District Forces and repairs undertaken by District as provided in Sections 11 and 17 .

SECTION 20 - SPECIFICATIONS AND DETAILS

20.01 MATERIALS AND METHODS OF CONSTRUCTION

Materials and methods of construction will be as required in the Standard Specifications, and on District-Approved Plans.

20.02 CONSTRUCTION DETAILS

Construction Details will be required on Standard Details and on District-Approved Plans.

SECTION 21 - DESIGN AND POLICY STANDARDS FOR MAIN SEWERS

21.01 PIPE MATERIALS

Limited to Vitrified Clay Pipe (VCP), Acrylonitrile Butadiene Styrene Composite Pipe (ABS), Poly Vinyl Chloride Pipe (PVC, SDR 26 or less), High density Polyethylene pipe (HDPE, DR 21 or less) and Ductile Iron Pipe (DIP, Pressure Class 250 or greater with non-corrosive lining) all as listed in the Standard Specifications.

21.02 PIPE MATERIAL CHANGES

Size or pipe material changes are not allowed between any two manholes.

21.03 SIZE AND SLOPE

Minimum pipe size is eight (8) inches in diameter. The sewers should be designed as steep as possible with due consideration for service area and other controls. Unless otherwise permitted by the Engineer, the slopes shown in the following table will be minimum for sewer sizes shown:

Pipe Diameter	Minimum Slope (feet per foot)
8"	0.0034
10"	0.0026
12"	0.0020
15"	0.0015
18"	0.0012

(Larger sewer sizes shall have a minimum slope as specified by the Engineer).

Sewer design will be based on District Master Plans as to ultimate total volume of flow expected from the tributary area. Sewers are designed to flow full at peak flows. Peaking factors are based on location and expected future conditions. (Manning formula with $n = 0.013$ will be used for all pipe materials).

21.04 ALIGNMENT

Sewer shall be laid in a straight alignment except that horizontal curved sewers may be used when located within a defined street area and concentric with center of street unless otherwise approved. Minimum curve radius shall be in accordance with 7.01.F.

21.05 CROSS CONNECTION

Sewers will be required to be designed cross-connected except in dead end streets.

21.06 GRADE

Sewer shall be laid on a straight grade except that vertical curved sewers may be used only in specific instances when so authorized by the Engineer. Conditions to be met will be specified in each instance by the Engineer.

21.07 GRADE STAKES

Unless otherwise required by the Engineer, sewer construction stakes will be located at 50 feet maximum intervals except that on horizontal curves and on sewers with a slope flatter than 0.0034 feet per foot the maximum spacing will be 25 feet. The maximum spacing of construction stakes on vertical curves shall be 10 feet.

The stakes shall be offset from the center line of the sewer at a safe distance from the edge of the trench but in no case greater than 10 feet unless authorized by the Engineer. The stakes will be marked with off-set distance and station only.

21.08 DESIGN DEPTH

To avoid interference between building sewers and other utilities, the sanitary sewer main should be designed, when possible, at a minimum of 6.5 feet below finished grade.

21.09 MINIMUM PIPE COVER

Minimum permitted cover in inches over outside top of pipe bell to top of "backfill" or to existing ground at time of sewer installation, whichever is lower, is shown in the table on Standard Detail No. 18, titled: Sewer Pipe Installation.

Cover requirements for other pipe materials and sizes will be based on their strength characteristics as approved by the Engineer.

21.10 TRENCH INTERSECTIONS

Avoid non-perpendicular crossings/intersections between the sanitary sewer and other underground utilities.

21.11 HORIZONTAL UTILITY CLEARANCE

A minimum horizontal clearance of five (5) feet should be maintained between the sewer main and adjacent underground utility mains and concrete curbs. A minimum horizontal clearance of ten (10) feet should be maintained between the sewer main and parallel water mains, unless approved in advance by the Engineer.

21.12 CROSSING STORM DRAINS

A. VITRIFIED CLAY PIPE (VCP)

Whenever a VCP pipe main or building sewer crosses over a storm drain, regardless of the vertical clearance, or under a storm drain with less than six (6) inches vertical clearance, span the storm drain trench with single length of PVC Pressure Pipe (SDR 18), and extend a minimum distance on each side of the trench per Standard Details.

B. FLEXIBLE PIPE

Whenever a flexible pipe main or building sewer crosses over a storm drain, a single length of similar flexible pipe may span the storm drain trench. Pipe couplings are not allowed within the storm drain trench.

If the strength characteristics of the flexible pipe is exceeded, the span of the storm drain trench shall be made with a single length of PVC Pressure Pipe (SDR 18), and extend a minimum distance on each side of the trench per Standard Details. Conditions to be met will be specified in each instance by the Engineer.

21.13 CROSSING WATER MAINS

No main or building sewer shall be installed over a water main where the vertical clearance is less than twelve (12) inches. The water main shall be spanned with a single length of PVC Pressure Pipe (SDR 18) per Standard Details.

No main sewer shall be installed under a water main with less than twelve (12) inches of vertical clearance.

21.14 STRUCTURE LOCATIONS

Except as noted below, manholes are required at all angle points, changes in grade and permanent dead ends. Maximum structure spacing is 450 feet unless otherwise permitted by the Engineer. A Riser may be used in lieu of a manhole on dead end runs only in cul-de-sacs that are less than 200 feet in length.

21.15 MAIN LOCATIONS

To accommodate traffic control and access, mains should be located in the center of traffic lanes, when possible. For two-lane streets without medians, the mains should be located approximately 5 feet on either side of the street centerline.

21.16 IN AND OUT ELEVATIONS AT MANHOLES

The In-and-Out elevations of the incoming and outgoing sewers shall be shown on the plans, and unless authorized by the Engineer, the following shall apply:

A. SEWERS OF SAME DIAMETER

Where two or more main sewers of the same diameter intersect, the difference in invert elevations of the incoming and outgoing sewers shall be a minimum of 0.01 foot per 10 degree deflection between mains with a maximum of 0.10 foot for a deflection of 90 degrees. Main sewers through manhole with no deflection will be designed with no change in invert elevation.

B. SEWERS OF DIFFERENT DIAMETERS

Where two or more main sewers of different diameters intersect, the invert elevations of the incoming and outgoing sewers shall be so related that the inside tops (crown) of the sewers are at the same elevation.

21.17 MAXIMUM DEFLECTION AT MANHOLES

At manholes, the upstream deflection angle at the intersection of two main sewers must not be greater than 100 degrees.

21.18 BUILDING SEWER CONNECTION AT MANHOLES

Four (4) inch and six (6) inch Building Sewers will not normally be permitted to be connected into manholes except for dead end manholes. (See Section 22.08 herein).

21.19 MANHOLE RIM ELEVATION

Manhole rim elevation shall be shown on Plans to nearest 0.10 foot, unless otherwise indicated on the Plans, it shall be assumed to be flush with the adjacent ground surface. In areas where future streets will be constructed, rim elevation shall also be shown for future finished grade.

21.20 CONNECTION TO EXISTING MANHOLE

In existing manholes where no stub exists, District forces will provide a channel in the portion of the base block located inside the manhole two inches larger than the outside diameter of the proposed stub. It shall be the responsibility of the Contractor to perform all the necessary work on the exterior of the manhole in preparation for the installation of the new stub. The Contractor shall be responsible for the alignment and grade of the new stub. The Contractor shall make a water-tight seal of the new stub from the outside of the manhole. All work by the Contractor shall be performed in a manner that will maintain the integrity of the existing manhole. District forces will finish the inside channel at the developer's expense. The Contractor shall provide 24 hours notice to the District prior to the start of any work.

21.21 CONNECTIONS BETWEEN MAIN SEWERS

Connections of new main sewers into existing main sewers must be made by means of a new manhole installed by the Contractor with District Forces doing the channeling at Developers cost. (See Sections 17.02 and 22.08 herein for connection of building sewer into existing main sewer).

21.22 DROP MANHOLES

Normally, drop manholes are not permitted. Use of vertical curve is usually more desirable. Use of drop manholes will be at the discretion of the District Engineer.

21.23 BOLT-DOWN MANHOLES

Standard District bolt-down manhole frame and cover without vent holes shall be required when manhole is located on a lot where there will be a residence.

21.24 EASEMENT WIDTH REQUIREMENTS

Main sewers not located in public streets must be situated within Sanitary Sewer Easements or within Public Utility Easements. Unless otherwise required by the Engineer, 15 feet is the

minimum width when manholes lie within the easement and 10 feet is minimum otherwise.

21.25 EASEMENT PAVING REQUIREMENTS

All manhole structures appurtenant to sanitary main sewers must be accessible to District maintenance vehicles.

Where deemed necessary by the Engineer, this accessibility shall be achieved by means of an adequately surfaced roadway of a design approved by said Engineer.

21.26 EASEMENT ACCESS REQUIREMENTS

Access to and along the easement, including all manholes shall be feasible and safely achievable by District maintenance vehicles.

SECTION 22 - DESIGN AND POLICY STANDARDS FOR BUILDING SEWERS

22.01 SIZE AND SLOPE

Minimum size of building sewer shall be four (4) inches in diameter but in no case smaller than the building drain (building plumbing) stub diameter. Plumbing fixture unit values, as established by the latest edition of the Uniform Plumbing Code, shall be used in designing the building sewer.

The following Table shows (for four-inch and six-inch diameter sewers) the minimum slope in percent permissible for the maximum number of plumbing fixture units noted. Note that cut sheets will be required for 6 inch sewers with slope less than 1.0%.

(Please note however, that in areas where the mains are of adequate depth that 2% slope is the preferred minimum for 4-inch sewers and 1% slope is the preferred minimum for 6-inch sewers.)

Maximum Fixture Units	4-inch Diameter Building Sewer	6-inch Diameter Building Sewer
200	1.0%	0.5%
600	N.A.	0.5%
700	N.A.	0.6%
800	N.A.	0.7%
900	N.A.	0.8%
1000	N.A.	0.9%
1200	N.A.	1.0%

When over 1200 fixture units are to be accommodated, 8 inch or larger diameter building sewer may be used, in accordance with main sewer design criteria. (See Section 21 herein).

22.02 PIPE MATERIALS

All materials authorized for use in the Standard Specifications may be used for domestic waste. Specific District approval of pipe material will be required for a sewer that will convey industrial waste. When building sewers are located under porches, steps, breezeways, roofed patios, carports, covered walks, covered driveways and similar structures they shall be constructed of Cast Iron, or P.V.C. (SDR 18).

22.03 ALIGNMENT

Sewer alignment shall be as straight as possible. When angle points are approved, only one 45 degree (maximum) change of direction (horizontal or vertical) is permissible without a cleanout. Any additional changes of direction (horizontal or vertical), thereafter, in excess of 22 ½ degrees shall be served by a cleanout or manhole. Ninety degree bends or tees are not permitted.

22.04 BUILDING PLUMBING (BUILDING DRAIN) LOCATION

The location should be arranged so that the point of connection with the building sewer is on that portion of the building facing the public sewer main.

22.05 GRADE

Unless otherwise authorized by the Engineer, the sewer shall be laid on a straight grade between the main sewer and the property line and between the property line and the building drain (building plumbing). Changes in grade shall be served by a cleanout or manhole.

22.06 GRADE STAKES

When cut sheets are required, sewer construction stakes shall be located at angle points, grade breaks, cleanouts, wyes, structures and at a 50 foot maximum spacing. An additional stake will also be required at property line and at connection point with building plumbing (building drain).

The stakes shall be offset from the center line of the sewer at a safe distance from the edge of the trench but in no case greater than 10 feet unless authorized by the Engineer. The stakes will be marked with off-set and station only.

When the sewer is to be constructed to property line only, the Engineer may require a stake to be set at the point prior to construction.

22.07 CURB MARKING

At the time the curb stakes are set (prior to construction of curb and gutter) an additional stake must be set by the Developer's Engineer on the curb stake line opposite the point at which the building sewer crosses the property line. This will insure that the "S" can be stamped in the fresh concrete in the proper location as required under Section 11.06 of the Standard Specifications.

22.08 CONNECTION TO EXISTING MAIN SEWER

Unless otherwise permitted or required by the Engineer, the connection of a four (4) inch diameter building sewer into an existing eight (8) inch or larger diameter main sewer, or the connection of a six (6) inch diameter building sewer into an existing 10 inch or larger diameter main sewer will be made by installation of a wye spliced into the existing main sewer or a stub installed by means of a tap made by "Tap Tite" or approved equal. The connection of the building sewer to the main sewer shall be airtight and at the option of the Engineer may require air testing.

The connection of a four (4) inch diameter building sewer into an existing six (6) inch sewer main, or the connection of a six (6) inch diameter building sewer into an existing eight (8) inch main sewer will be made by installation of a wye spliced into the existing main sewer.

Contractor will not be permitted to splice wye on existing USD main sewers (see Section 17.02 herein).

Connection of building sewers to sewer lines larger than 15 inches in diameter will only be permitted when so approved by the Engineer.

22.09 ELEVATION AT CONNECTION TO MAIN SEWER

When sufficient grade is available, design sewer elevations at connection to main sewer on the basis that the invert elevation of the building sewer is equal to the inside top elevation of the

main sewer.

22.10 CONNECTION TO EXISTING BUILDING SEWER

The connection may be made by means of a private manhole, wye spliced into existing building sewer or stub installed by means of a tap made by "Tap Tite" or approved equal, all as shown on Standard Details and on District Approved Plans.

Actual connection of a new building sewer to an existing building sewer will not be permitted until the new sewer has been satisfactorily tested. If authorized by the Engineer, a test wye may be used with a plug in lieu of leaving a temporary gap in the sewer.

22.11 CONNECTION TO BUILDING DRAIN (PLUMBING KICK-OUT)

After a permit authorizing said construction has been issued, building sewers may be constructed up to a point 5 feet from the building wall. Actual connection of the building sewer to the building drain (building plumbing) will not be permitted however, until the main sewer or building sewer to which it connects has been accepted by the District and the subject building sewer has been satisfactorily tested in accordance with Standard Specifications Section 12.

Actual connection must be done by a sewer contractor with a valid sewer construction permit issued by the District. Work must be done in the presence of and to the satisfaction of the Engineer.

22.12 CLEARANCES

(a) Unless otherwise permitted by the Engineer, when a building sewer crosses another utility, a vertical clearance of at least six (6) inches shall be maintained.

(b) Unless otherwise permitted in the Uniform Plumbing Code, building sewers and other utilities shall be kept sufficiently separated and shall be laid in separate trenches.

22.13 PARALLEL TO FOOTING

Any sewer deeper than the footing of any building or structure and paralleling the same must be designed to be of sufficient distance from the footing so that no part of the trench will fall within a 45 degree line drawn downward from the bottom of the footing (see Standard Details).

22.14 CROSSING STORM DRAINS

A. VITRIFIED CLAY PIPE (VCP)

Whenever a VCP pipe building sewer crosses over a storm drain, regardless of the vertical clearance, or under a storm drain with less than six (6) inches vertical clearance, span the storm drain trench with a single length of PVC Pressure Pipe (SDR 18), and extend a minimum distance on each side of the trench per Standard Details.

B. FLEXIBLE PIPE

Whenever a flexible pipe building sewer crosses over a storm drain, a single length of similar flexible pipe may span the storm drain trench. Pipe couplings are not allowed within

the storm drain trench.

If the strength characteristics of the flexible pipe are exceeded, the span of the storm drain trench shall be made with a single length of PVC Pressure Pipe (SDR 18), and extend a minimum distance on each side of the trench per Standard Details. Conditions to be met will be specified in each instance by the Engineer.

22.15 CROSSING WATER MAINS

No building sewer shall be installed over a water main where the vertical clearance is less than twelve (12) inches. Where the vertical clearance over a water main is more than twelve (12) inches span the water main with one length of PVC Pressure Pipe (SDR 18) per Standard Details.

22.16 MINIMUM PIPE COVER

Minimum permitted cover in inches over outside top of pipe bell to top of "Backfill" or to existing ground at time of sewer installation, whichever is lower, is shown in the table on Standard Detail Sheet titled: Sewer Pipe Installation.

Cover requirements for other pipe materials and sizes will be based on their strength characteristics as approved by the Engineer.

22.17 TRENCH INTERSECTIONS

Avoid non-perpendicular crossings/intersections between the sanitary sewer and other underground utilities.

22.18 HORIZONTAL UTILITY CLEARANCE

A minimum horizontal clearance of five (5) feet should be maintained between the building sewer and adjacent underground utility lines and concrete curbs. A minimum horizontal clearance of ten (10) feet should be maintained between the building sewer and parallel water mains or services.

22.19 STRUCTURE TYPE AND LOCATION

A. PRIVATE MANHOLE

Private manholes must be constructed on building sewers eight (8) inches in diameter and larger with maximum spacing of 450 feet, at changes in horizontal or vertical direction, and at other locations required by the Engineer. They may be used on smaller building sewers in lieu of cleanouts.

A "control manhole" is required on the building sewer serving each user in an industrial building, if so required by the Engineer in accordance with District Ordinances.

B. CLEANOUT TO GRADE "C.O.T.G."

A cleanout shall be constructed on four (4) inch and six (6) inch sewer at intervals not to exceed 100 feet as well as at locations indicated in Section 22.03 herein. See Section "C"

below for requirements at connection to building plumbing. Also see "A" above for use of manholes in lieu of cleanout to grade. No cleanout is required on runs less than 10 feet in length (See Section 7.05 in Standard Specifications).

C. TWO-WAY CLEANOUT TO GRADE

Two-way cleanouts shall be constructed on all four (4) inch sewers at the connection of the building sewer with the plumbing drain. This cleanout shall be located no further than 30 inches from the building wall and protected with an approved box. (See Section 7.06 in Standard Specifications).

D. TEST WYE

A test wye shall be constructed at locations shown on Plans or as required by the Engineer to facilitate testing of the building sewers. (See Section 7.07 in Standard Specifications).

E. ANY OTHER STRUCTURES

Other structures required will be located as shown on approved Plans and be constructed in accordance with District requirements.

22.20 OVERFLOW DEVICES

Overflow protection devices shall be installed on building sewers when specifically required by the Engineer. The particular device to be used and its installation must be approved by the Engineer. This device will be required on all residential and commercial buildings where the floor elevation is six (6) inches or less above the closest upstream manhole rim elevation.

22.21 NUMBER OF BUILDING SEWERS REQUIRED


See Section 17.06.

22.22 PRIVATE PUMPING STATIONS

Private pumping stations should be avoided if possible. Private pumping stations must be approved by the Engineer. The pumping stations should be designed and stamped by a California registered civil engineer. Submittals including design calculations, flows, pump information, etc. shall be made to the Engineer. Minimum requirements for private pumping stations are shown in the Standard Details.


SECTION 23 – STANDARD DETAILS

TITLE	SHEET NO.
Standard Manhole	1
Trunk Manhole	2
Standard Drop Manhole	3
Special Manhole Base for Dead End Manholes in Cul-de-sacs	4
Private Control Manhole Types “A” & “B”	5
Private Control Manhole Type “C”	6
Manhole Frame and Cover	7
Bolt-down Manhole Frame and Cover	8
Private Manhole Frame and Cover	9
Private Control Manhole Frame and Cover	10
36” Diameter Manhole Frame and Cover	11
Riser	12
Riser Frame and Cover for 6”, 8” & 10” Diameter Pipe	13
Building Sewer Details	14
Building Sewer Cleanout to Grade	15
VCP Sanitary Sewer/Storm Drain Crossing	16
Sanitary Sewer/Water Main Crossing	17
Sewer Pipe Installation (Cover, slope, special bedding and encasement requirements)	18
Three Compartment Sand and Grease Interceptor	19
Two Compartment Sump	20
Private Pumping Station Plan and Elevation Section	21
Private Pumping Station Connection to Main and Notes	22
Mobile Holding Tank Disposal Facility	23
Repair Coupling for VCP 15” Diameter and Larger	24
Overflow Device	25
Standard Pipe Casing	26

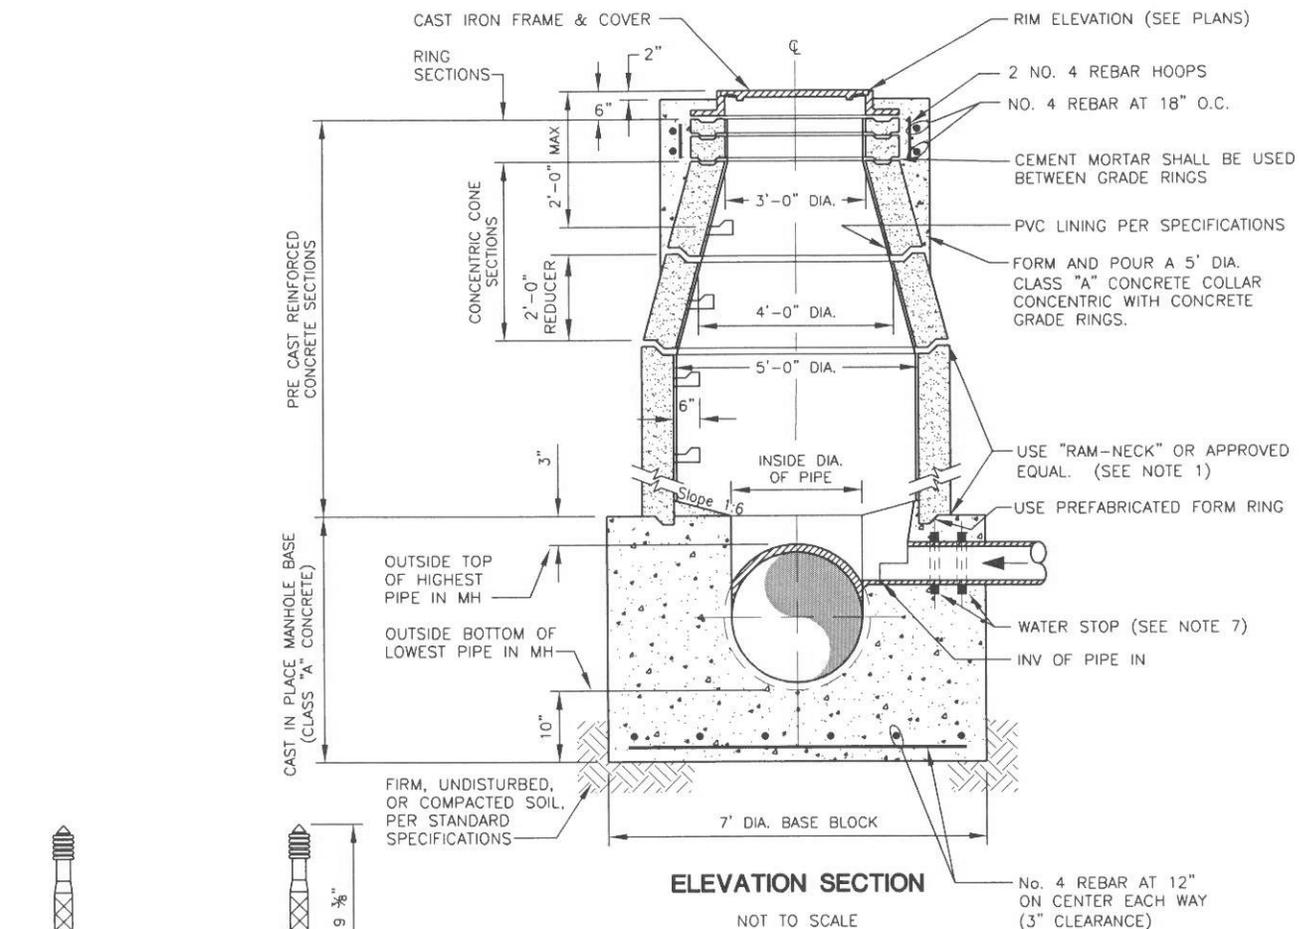


MANHOLE STEPS


- NOTES:
1. INSTALL "RAM-NECK" OR APPROVED EQUAL BETWEEN EACH JOINT OF THE CONE AND BARREL SECTIONS TO MAKE A FLEXIBLE WATER-TIGHT JOINT. AFTER JOINT IS MADE, TRIM JOINT SMOOTH ON THE INSIDE OF MANHOLE.
 2. ALL STEPS SHALL BE INSTALLED IN PRECAST SECTIONS BY MANUFACTURER AND SPACED 10"-15" APART.
 3. PRECAST SECTIONS SHALL BE INSTALLED SO THAT STEPS ARE ALIGNED VERTICALLY AND AS SHOWN IN THE PLAN SECTION.
 4. IF DISTANCE FROM MANHOLE RIM TO TOP OF BASE BLOCK IS LESS THAN 4'-0", ORDER PRE-CAST SECTIONS WITHOUT STEPS.
 5. TRUNK MANHOLES ARE REQUIRED WHEN THE SEWER LINE IS 24" OR LARGER IN DIAMETER.
 6. FLEXIBLE COUPLING NOT REQUIRED FOR FLEXIBLE PIPE OR IF MANHOLE IS INSTALLED OVER EXISTING SANITARY SEWER.
 7. FLEXIBLE PIPE ONLY - AN APPROVED WATER STOP, SUCH AS TWO O-RINGS OR A BANDED RUBBER COUPLING, SHALL BE INSTALLED ON ALL FLEXIBLE PIPE ENTERING OR LEAVING A MANHOLE AND CENTERED UNDER THE MANHOLE WALL AS SHOWN.
 8. CEMENT MORTAR SHALL BE USED BETWEEN ALL GRADE RINGS.
 9. ALL CONCRETE GRADE RINGS, CONES AND BARREL SECTIONS SHOWN ABOVE ARE PRECAST AS MANUFACTURED BY CENTRAL PRECAST CONCRETE INC., ONE HANSON CT., MILPITAS, CA. OR AN APPROVED EQUAL.

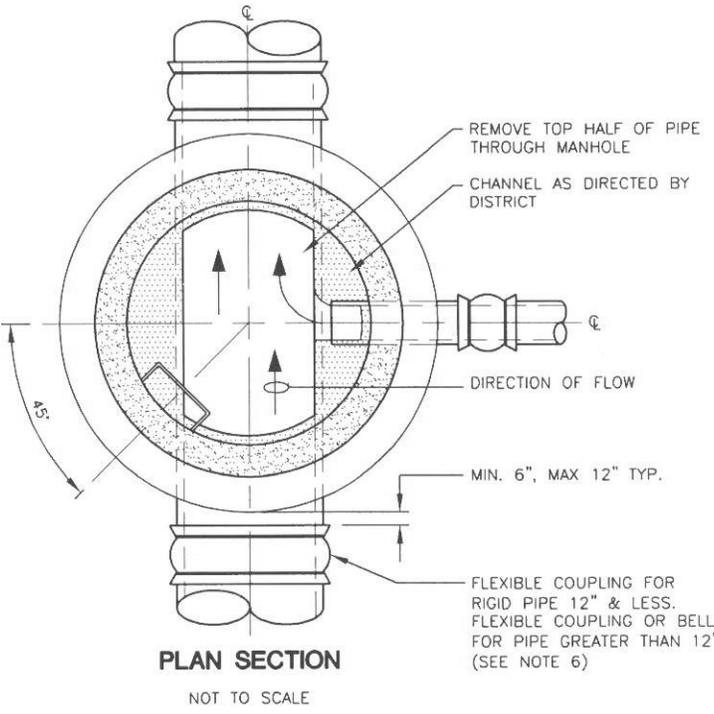


Date 5-12-06 Detail No. 2
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587

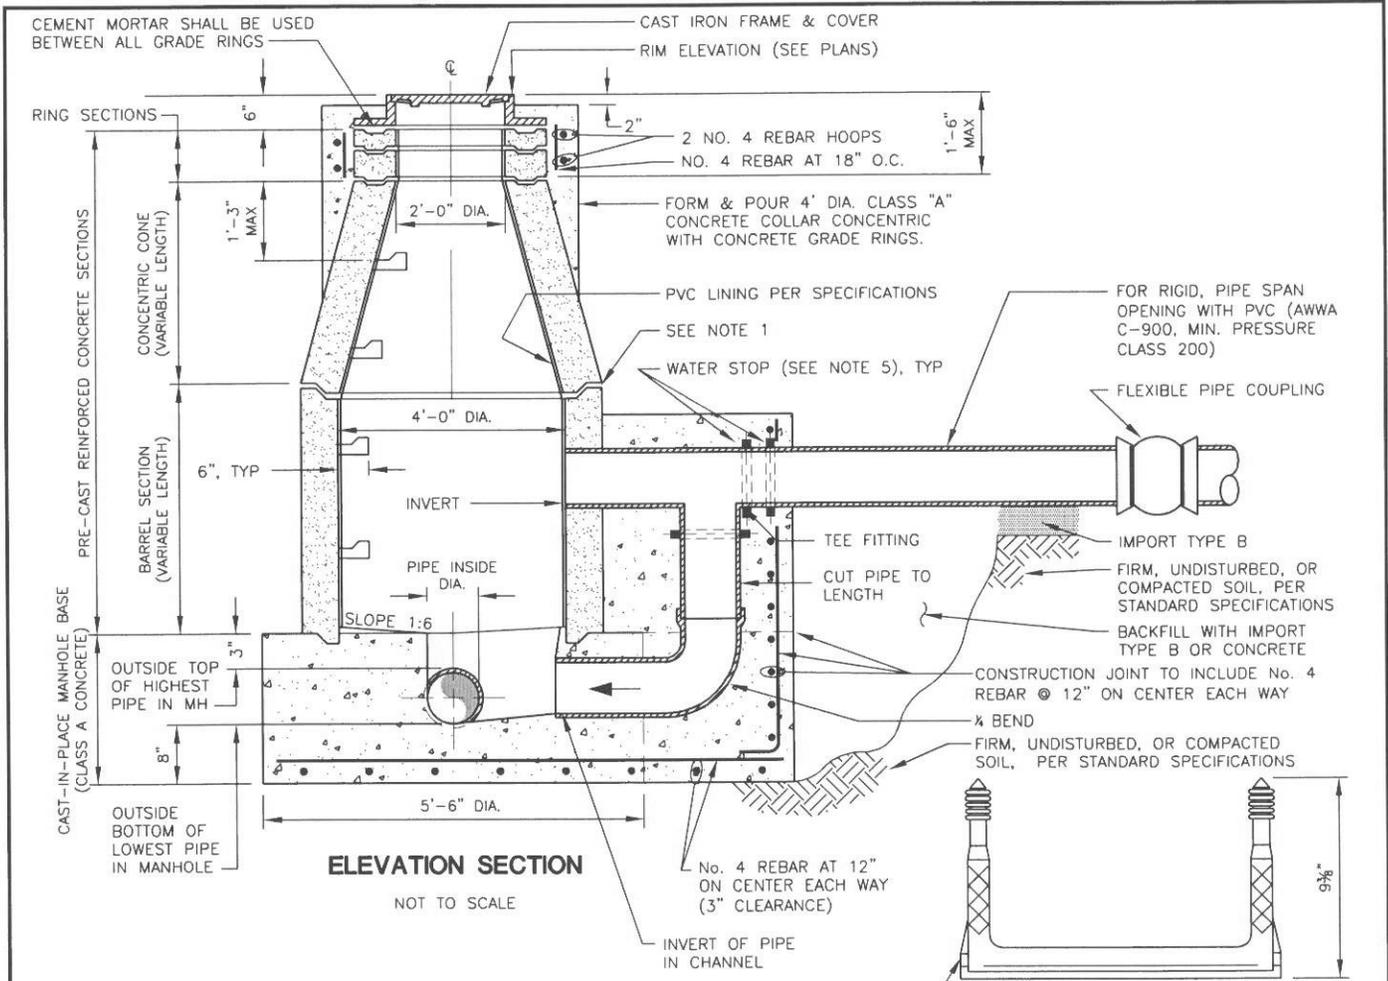

ELEVATION SECTION
NOT TO SCALE

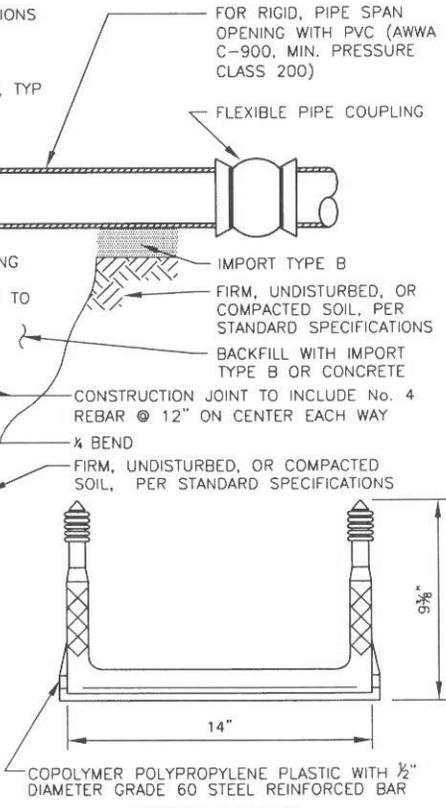

MANHOLE STEPS

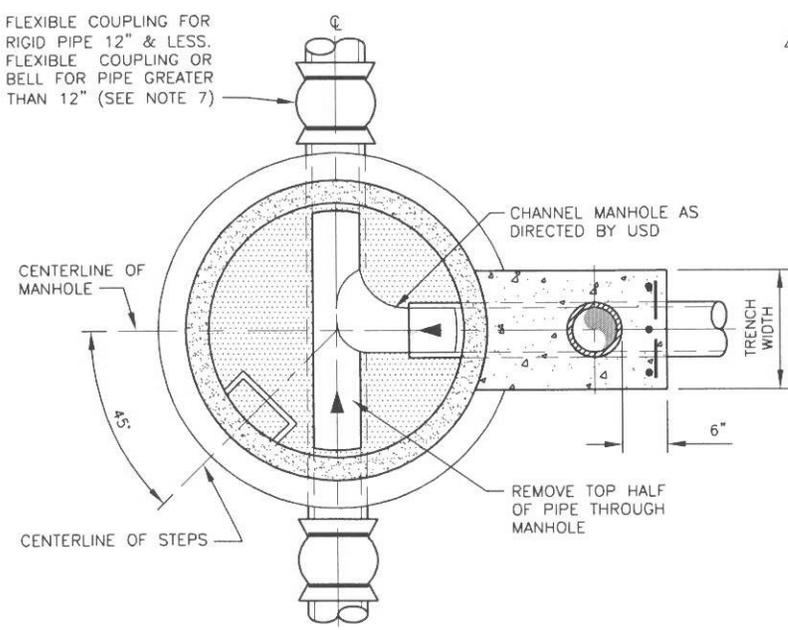


PLAN SECTION
NOT TO SCALE

- NOTES:
1. INSTALL "RAM-NECK" OR APPROVED EQUAL BETWEEN EACH JOINT OF THE CONE AND BARREL SECTIONS. AFTER JOINT IS MADE, TRIM JOINT SMOOTH ON THE INSIDE OF MANHOLE.
 2. ALL STEPS SHALL BE INSTALLED IN PRE-CAST SECTIONS BY MANUFACTURER AND SPACED APART BY 10"-15".
 3. PRE-CAST SECTIONS SHALL BE INSTALLED SO THAT STEPS ARE ALIGNED VERTICALLY AND AS SHOWN IN THE PLAN SECTION.
 4. IF DISTANCE FROM MANHOLE RIM TO TOP OF BASE BLOCK IS LESS THAN 4'-0", ORDER PRE-CAST SECTION WITHOUT STEPS.
 5. FLEXIBLE PIPE ONLY - AN APPROVED WATER STOP, SUCH AS TWO O-RINGS OR A BANDED RUBBER COUPLING, SHALL BE INSTALLED ON ALL FLEXIBLE PIPE ENTERING OR LEAVING A MANHOLE, AND CENTERED UNDER THE MANHOLE WALL AS SHOWN.
 6. CEMENT MORTAR SHALL BE USED BETWEEN ALL GRADE RINGS.
 7. FLEXIBLE COUPLING NOT REQUIRED FOR FLEXIBLE PIPE OR IF MANHOLE IS INSTALLED OVER EXISTING SANITARY SEWER.
 8. ALL CONCRETE GRADE RINGS, CONES AND BARREL SECTIONS SHOWN ABOVE ARE PRECAST AS MANUFACTURED BY CENTRAL PRECAST CONCRETE INC., ONE HANSON CT., MILPITAS, CA. OR AN APPROVED EQUAL.

Date 5-12-06 Detail No. 3
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587


USD UNION SANITARY DISTRICT

STANDARD DROP MANHOLE **3**

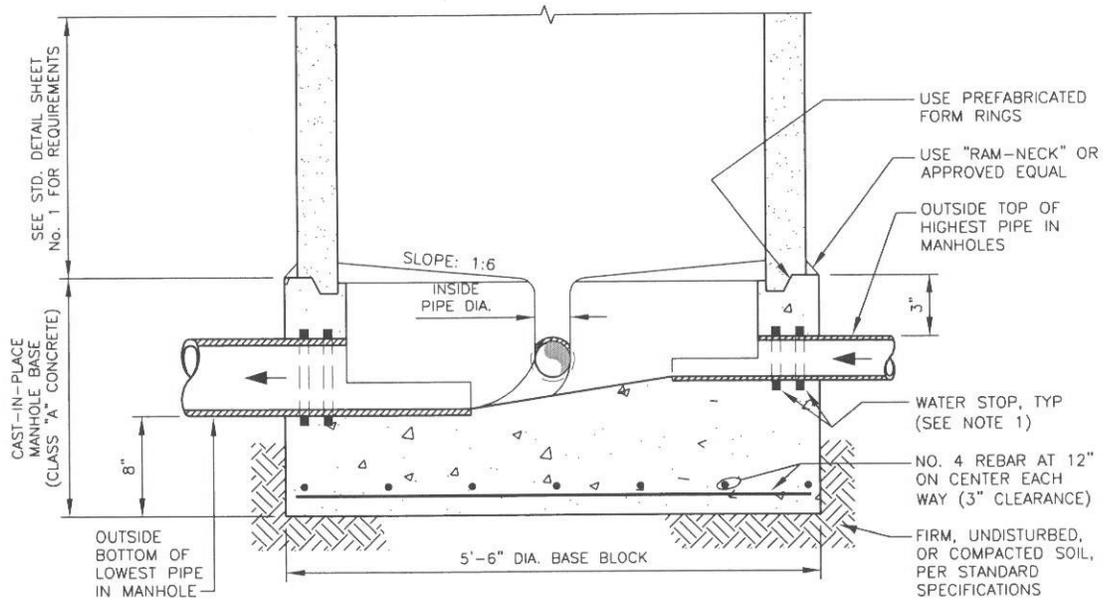

ELEVATION SECTION

NOT TO SCALE

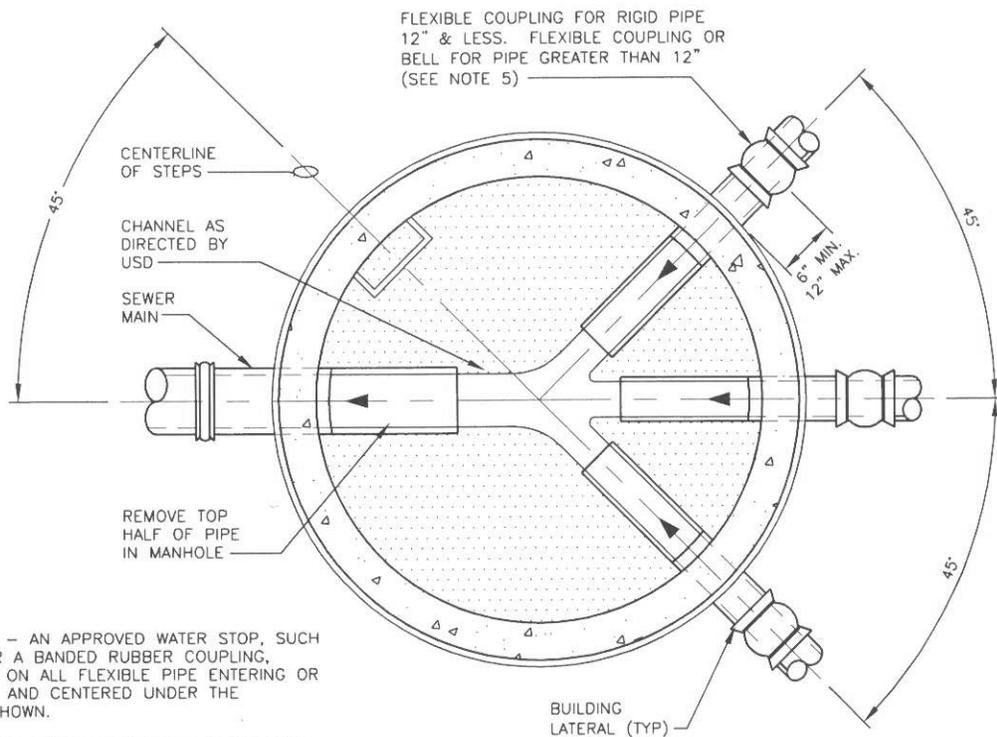

PLAN SECTION

NOT TO SCALE

NOTES:

1. FLEXIBLE PIPE ONLY - AN APPROVED WATER STOP, SUCH AS TWO O-RINGS OR A BANDED RUBBER COUPLING, SHALL BE INSTALLED ON ALL FLEXIBLE PIPE ENTERING OR LEAVING A MANHOLE, AND CENTERED UNDER THE MANHOLE WALL AS SHOWN.
2. ALL PIPES IN MANHOLE BASE BLOCK SHALL MATCH TOPS.
3. MAXIMUM NUMBER OF LATERALS TO BE CONNECTED TO A DEAD END MANHOLE IN A CUL-DE-SAC IS THREE (3).
4. INSTALL "RAM-NECK" OR APPROVED EQUAL BETWEEN EACH JOINT OF THE CONE AND BARREL SECTIONS TO MAKE A FLEXIBLE WATER-TIGHT JOINT. AFTER JOINT IS MADE, TRIM JOINT SMOOTH ON THE INSIDE OF MANHOLE.
5. FLEXIBLE COUPLING NOT REQUIRED FOR FLEXIBLE PIPE OR IF MANHOLE IS INSTALLED OVER EXISTING SANITARY SEWER.

Date 10-25-05 Detail No. 4
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT


SPECIAL MANHOLE BASE FOR DEAD END MANHOLES IN CUL-DE-SACS

SEE STANDARD DETAIL SHT 10 FOR FRAME & COVER DETAIL

SEE STANDARD DETAIL SHT 6 FOR CONCRETE COLLAR DETAIL


CEMENT MORTAR SHALL BE USED BETWEEN GRADE RINGS, TYP.

FIRM, UNDISTURBED, OR COMPACTED SOIL, PER STANDARD SPECIFICATIONS

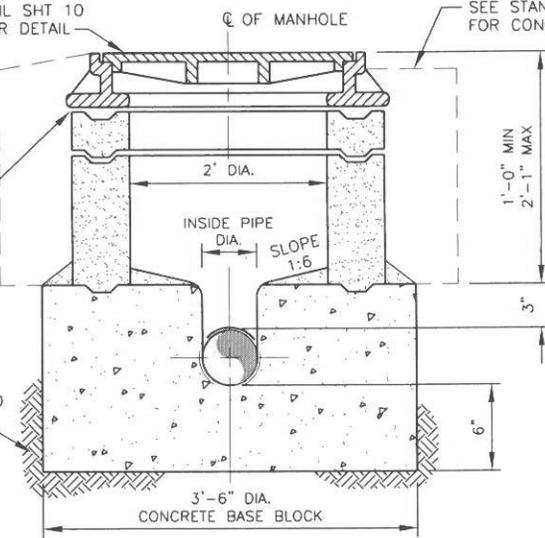

TYPE "A" MANHOLE

NOT TO SCALE

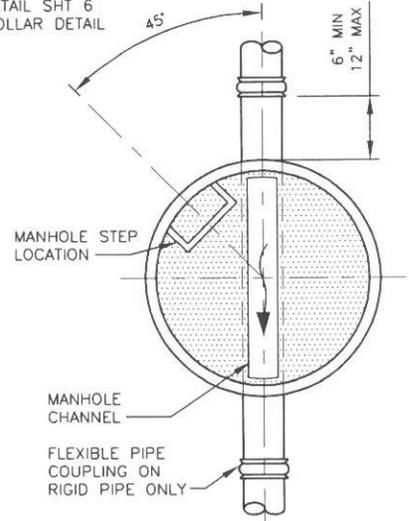


TYPICAL PLAN SECTION

NOT TO SCALE

SEE STANDARD DETAIL NO. 10 FOR FRAME & COVER DETAIL


SEE STANDARD DETAIL SHT 6 FOR CONCRETE COLLAR DETAIL

USE "RAM-NECK" OR APPROVED EQUAL
FIRM, UNDISTURBED, OR COMPACTED SOIL, PER STANDARD SPECIFICATIONS

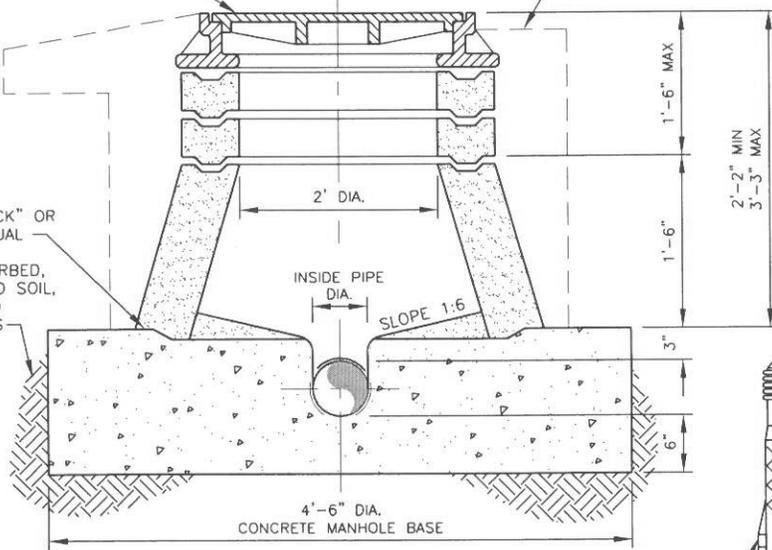

TYPE "B" MANHOLE

NOT TO SCALE

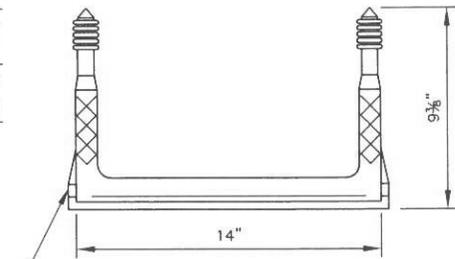

COPOLYMER POLYPROPYLENE PLASTIC WITH 1/2" DIAMETER GRADE 60 STEEL REINFORCED BAR

MANHOLE STEPS

NOTES:


1. TYPE "C" PRIVATE CONTROL MANHOLE (DETAIL NO. 6) SHALL BE USED IN MOST CIRCUMSTANCES. TYPE "A" & "B" SHALL BE USED ONLY WITH SPECIAL PERMISSION BY THE ENGINEER.
2. INSTALL "RAM-NECK" OR APPROVED EQUAL BETWEEN EACH JOINT OF THE CONE AND BARREL SECTIONS TO MAKE A FLEXIBLE, WATER-TIGHT JOINT. AFTER JOINT IS MADE, TRIM JOINT SMOOTH ON THE INSIDE OF MANHOLE.
3. DO NOT INSTALL STEPS IN MANHOLE NECKS OR IN A MANHOLE THAT IS LESS THAN 4 (FOUR) FEET DEEP. IF MANHOLE IS GREATER THAN 4 (FOUR) FEET DEEP, STEPS SHALL BE INSTALLED AND EQUALLY SPACED AT INTERVALS FROM 10"-16" APART AND ALIGNED VERTICALLY.
4. COLLAR AND MANHOLE BASE SHALL BE CLASS "A" CONCRETE POURED IN PLACE.
5. INSTALL PRIVATE CONTROL MANHOLE FRAME AND COVER AS SHOWN ON DETAIL NO. 10 OF USD STANDARD SPECIFICATIONS.
6. ALL CONCRETE GRADE RINGS, CONES AND BARREL SECTIONS SHOWN ABOVE ARE PRECAST AS MANUFACTURED BY CENTRAL PRECAST CONCRETE, INC., ONE HANSON CT., MILPITAS, CA, OR AN APPROVED EQUAL.
7. FOR FLEXIBLE PIPE ONLY - AN APPROVED WATER STOP, SUCH AS BANDED RUBBER COUPLING, SHALL BE INSTALLED ON ALL FLEXIBLE PIPE ENTERING OR LEAVING A MANHOLE AND CENTERED UNDER THE MANHOLE WALL.

Date 5-12-06 Detail No. 5
Approved By Richard B. Currie
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

PRIVATE CONTROL MANHOLE
TYPES "A" & "B"

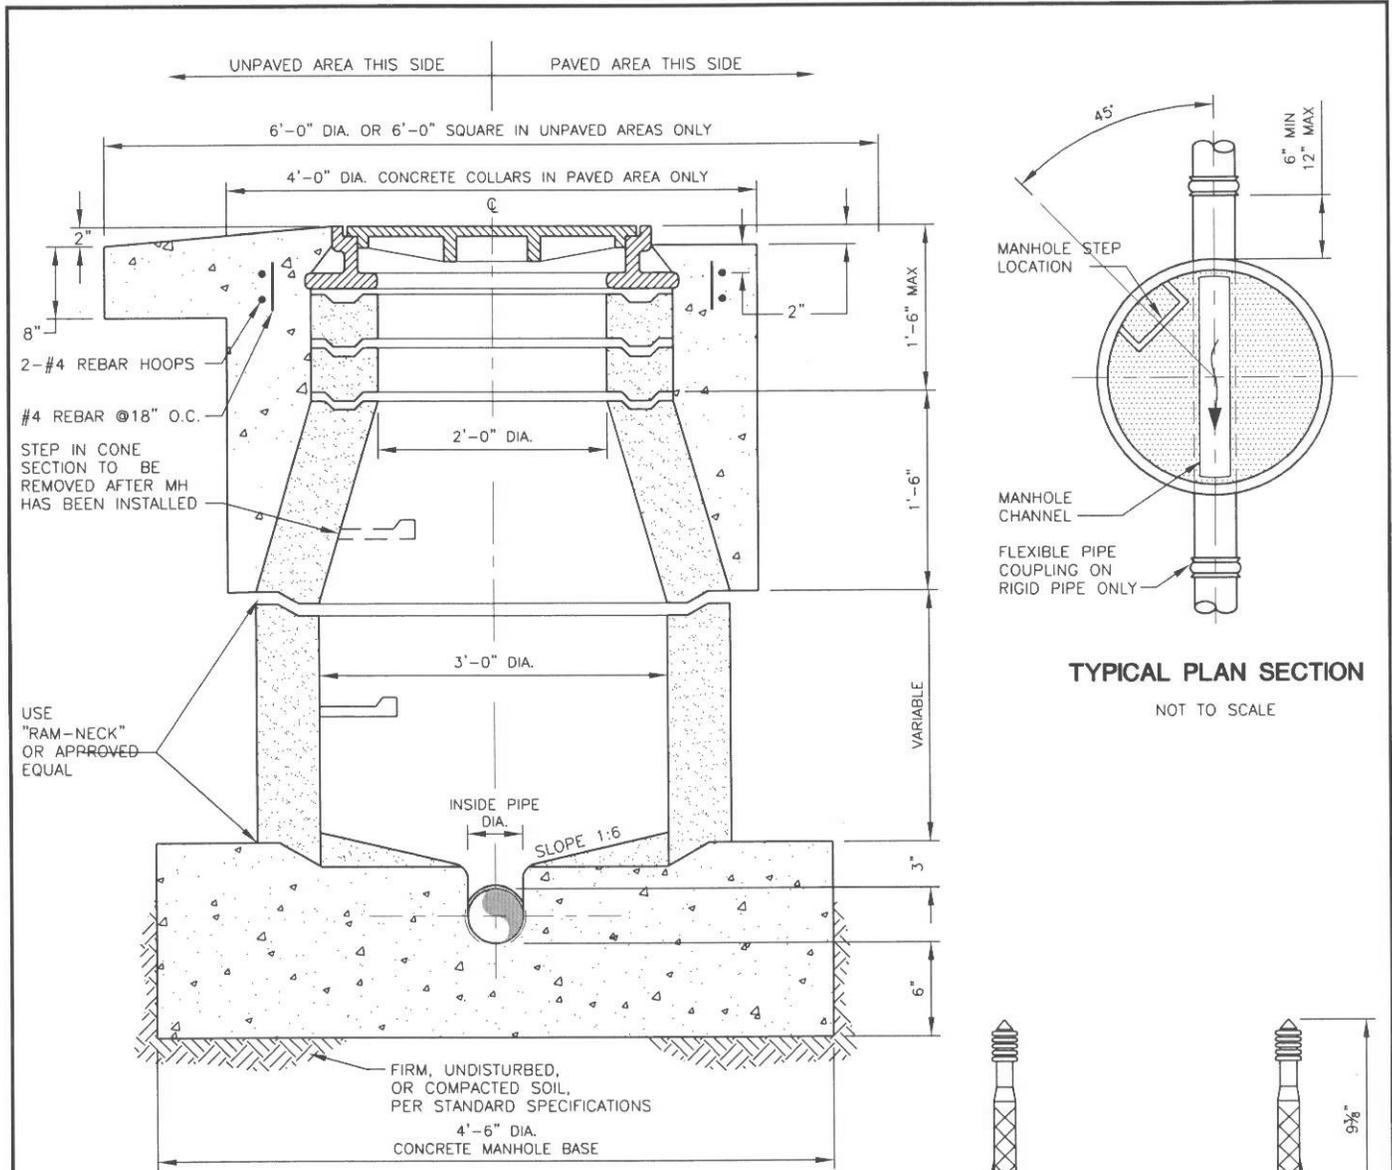

TYPE "C" MANHOLE
NOT TO SCALE


TYPICAL PLAN SECTION
NOT TO SCALE

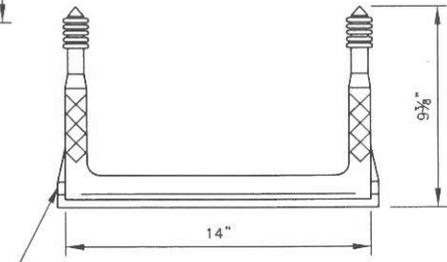

MANHOLE STEPS
COPOLYMER POLYPROPYLENE PLASTIC WITH 1/2" DIAMETER GRADE 60 STEEL REINFORCED BAR



NOTES:

1. INSTALL "RAM-NECK" OR APPROVED EQUAL BETWEEN EACH JOINT OF THE CONE AND BARREL SECTIONS TO MAKE A FLEXIBLE, WATER-TIGHT JOINT. AFTER JOINT IS MADE, TRIM JOINT SMOOTH ON THE INSIDE OF MANHOLE.
2. DO NOT INSTALL STEPS IN MANHOLE NECKS OR IN A MANHOLE THAT IS LESS THAN 4 (FOUR) FEET DEEP. IF MANHOLE IS GREATER THAN 4' DEEP, STEPS SHALL BE INSTALLED AND EQUALLY SPACED AT INTERVALS FROM 10"-16" APART AND ALIGNED VERTICALLY.
3. COLLAR AND MANHOLE BASE SHALL BE CLASS "A" CONCRETE POURED IN PLACE.
4. INSTALL PRIVATE CONTROL MANHOLE FRAME AND COVER AS SHOWN ON STANDARD DETAIL NO. 10.
5. ALL CONCRETE GRADE RINGS, CONES AND BARREL SECTIONS SHOWN ABOVE ARE PRE CAST AS MANUFACTURED BY CENTRAL PRECAST CONCRETE, INC., ONE HANSON CT., MILPITAS, CA, OR AN APPROVED EQUAL.
6. FLEXIBLE PIPE ONLY - AN APPROVED WATER STOP, SUCH AS BANDED RUBBER COUPLING, SHALL BE INSTALLED ON ALL FLEXIBLE PIPE ENTERING OR LEAVING A MANHOLE, AND CENTERED UNDER THE MANHOLE WALL.

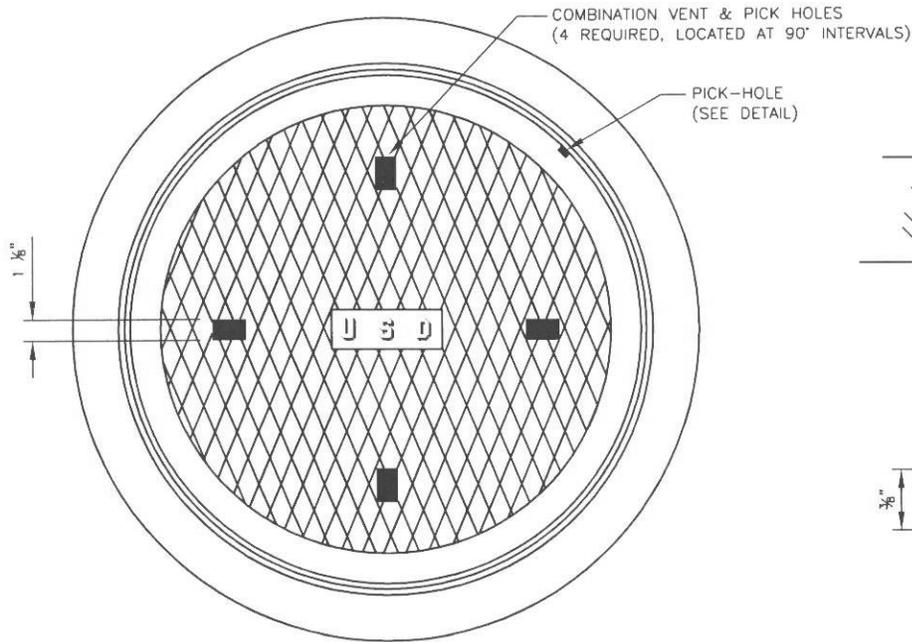


PLAN SECTION

NOT TO SCALE

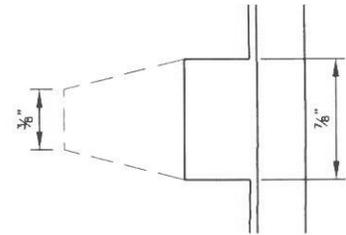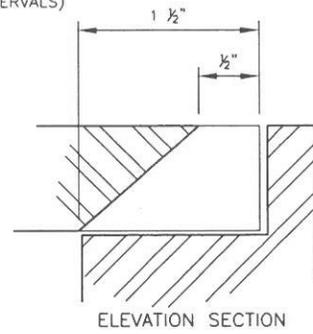


PICK HOLE DETAIL

NOT TO SCALE

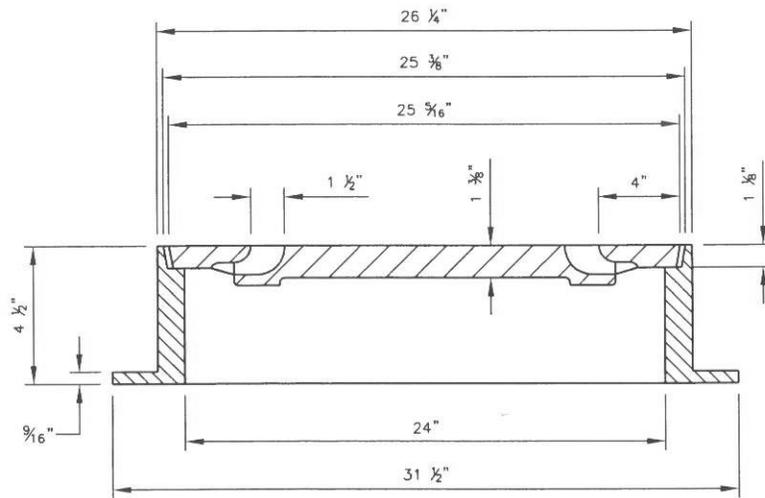

ELEVATION SECTION

NOT TO SCALE

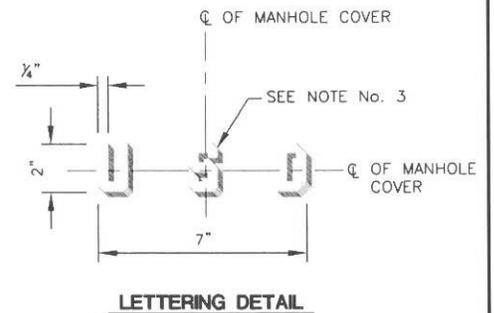

NOTES:






1. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
2. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
3. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVER SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
5. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95420, OR APPROVED EQUAL.
6. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.

Date 5-12-06 Detail No. 7
 Approved By Richard B. Currie
 RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT

MANHOLE FRAME AND COVER

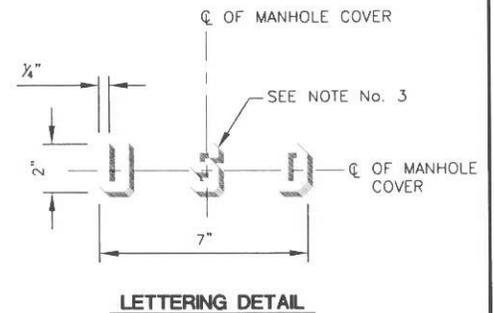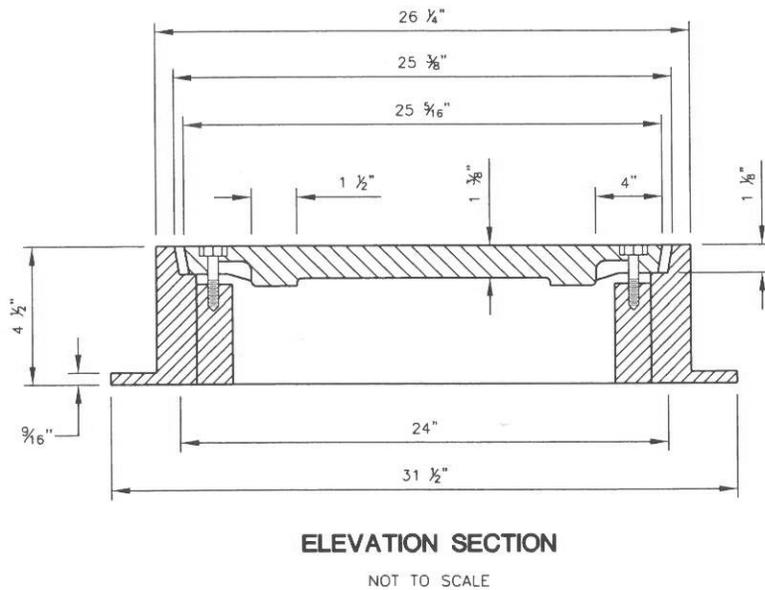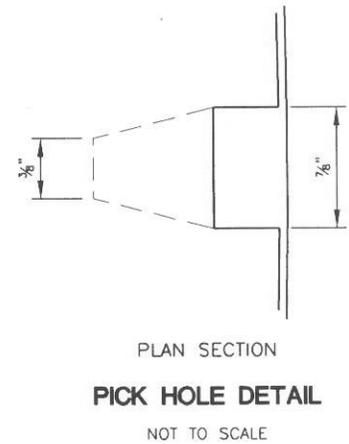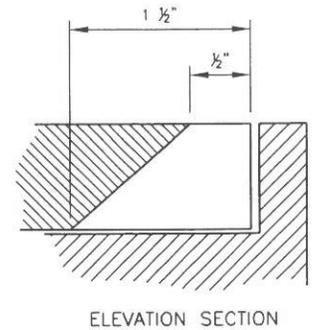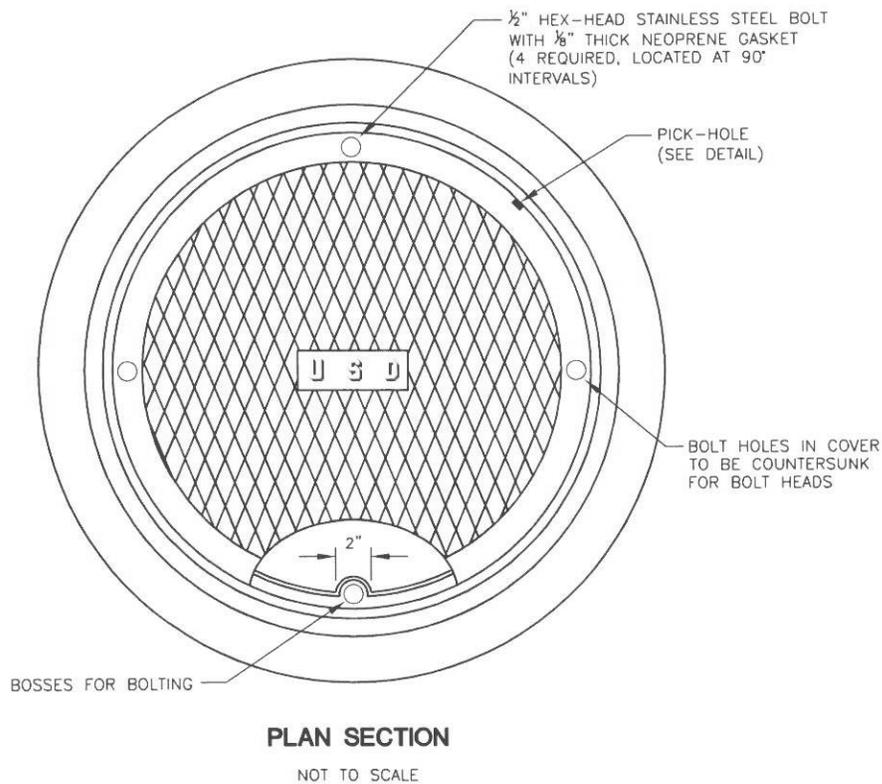


NOTES:

1. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
2. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
3. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVER SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
5. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95420, OR APPROVED EQUAL.
6. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.


Date 5-12-06 Detail No. 8
 Approved By Richard B. Currie
 RICHARD B. CURRIE, RCE 31587

 **UNION SANITARY DISTRICT**


**BOLT-DOWN MANHOLE
FRAME AND COVER**

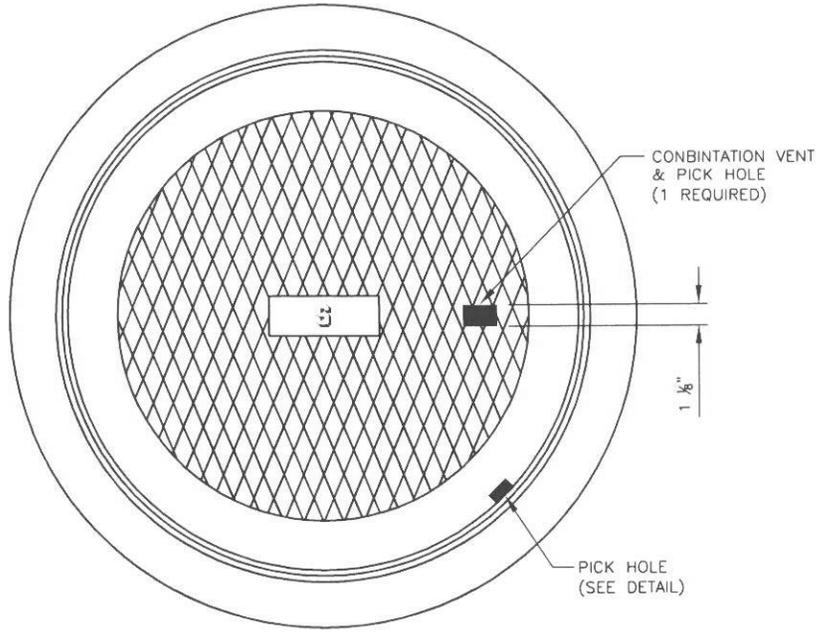

PLAN SECTION
NOT TO SCALE

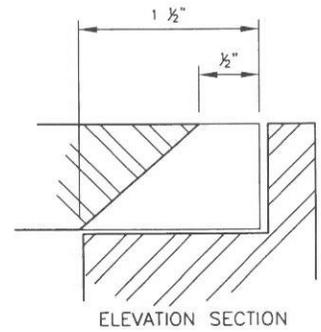


ELEVATION SECTION

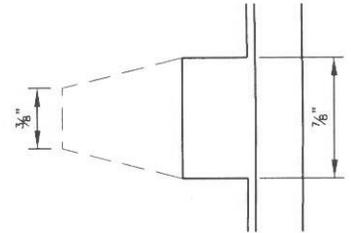


PLAN SECTION

PICK HOLE DETAIL
NOT TO SCALE

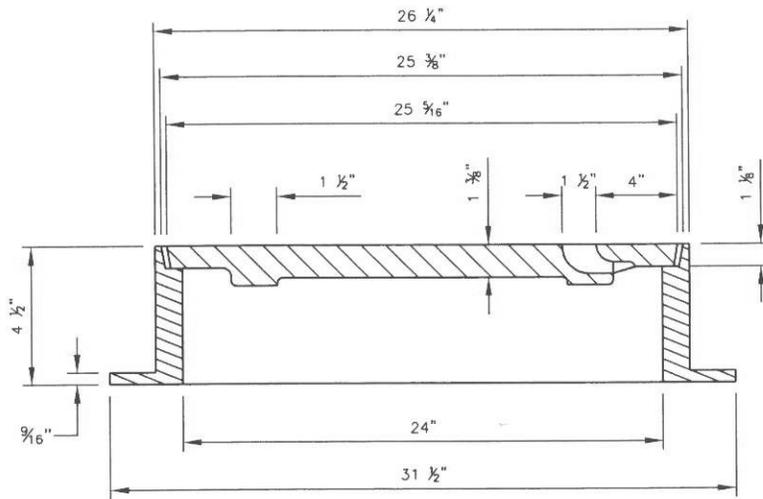

ELEVATION SECTION
NOT TO SCALE

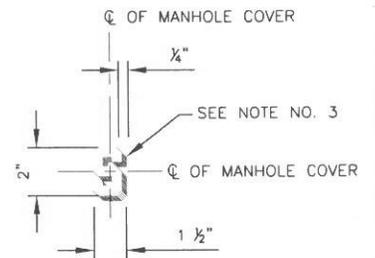

LETTERING DETAIL

NOTES:


1. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
2. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
3. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVER SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
5. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95420, OR APPROVED EQUAL.
6. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.

Date 5-12-06 Detail No. 9
Approved By Richard B. Currie
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

**PRIVATE MANHOLE
FRAME AND COVER**

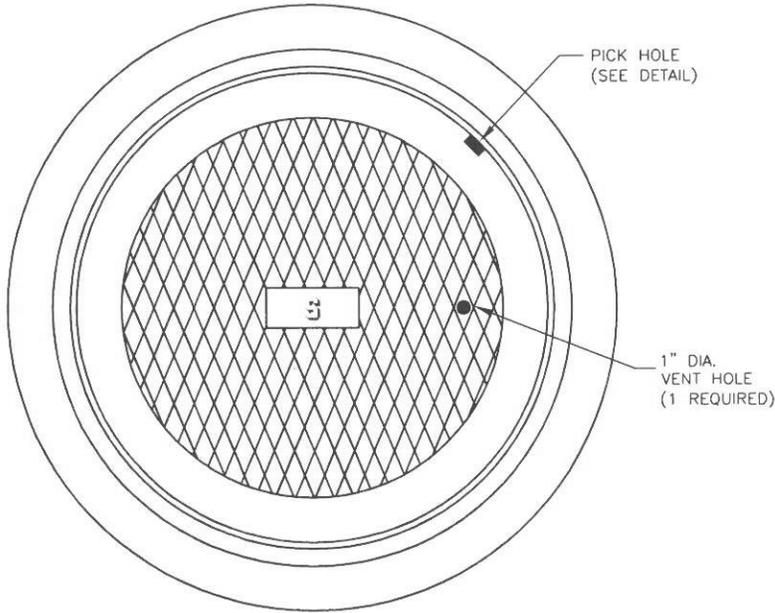


PLAN SECTION

NOT TO SCALE

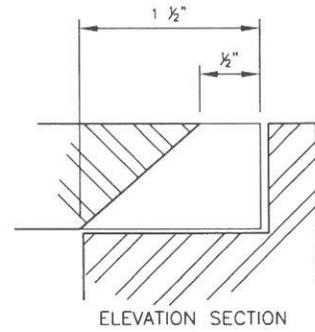


ELEVATION SECTION

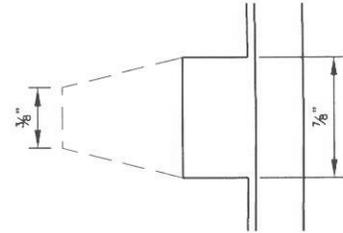

PLAN SECTION


PICK HOLE DETAIL

NOT TO SCALE

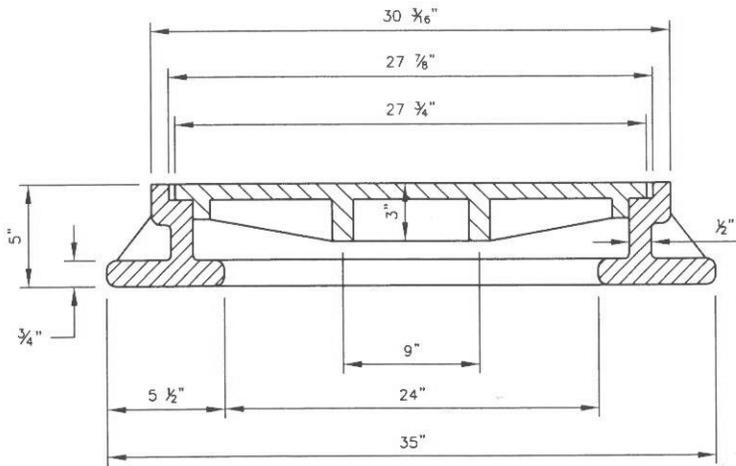

ELEVATION SECTION

NOT TO SCALE

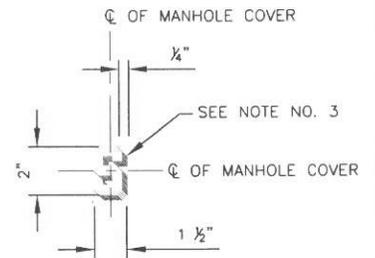

LETTERING DETAIL

NOTES:


1. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
2. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
3. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVER SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
5. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95420, OR APPROVED EQUAL.
6. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.

Date 5-12-06 Detail No. 10
 Approved By Richard B. Currie
 RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT


**PRIVATE CONTROL MANHOLE
 FRAME AND COVER**

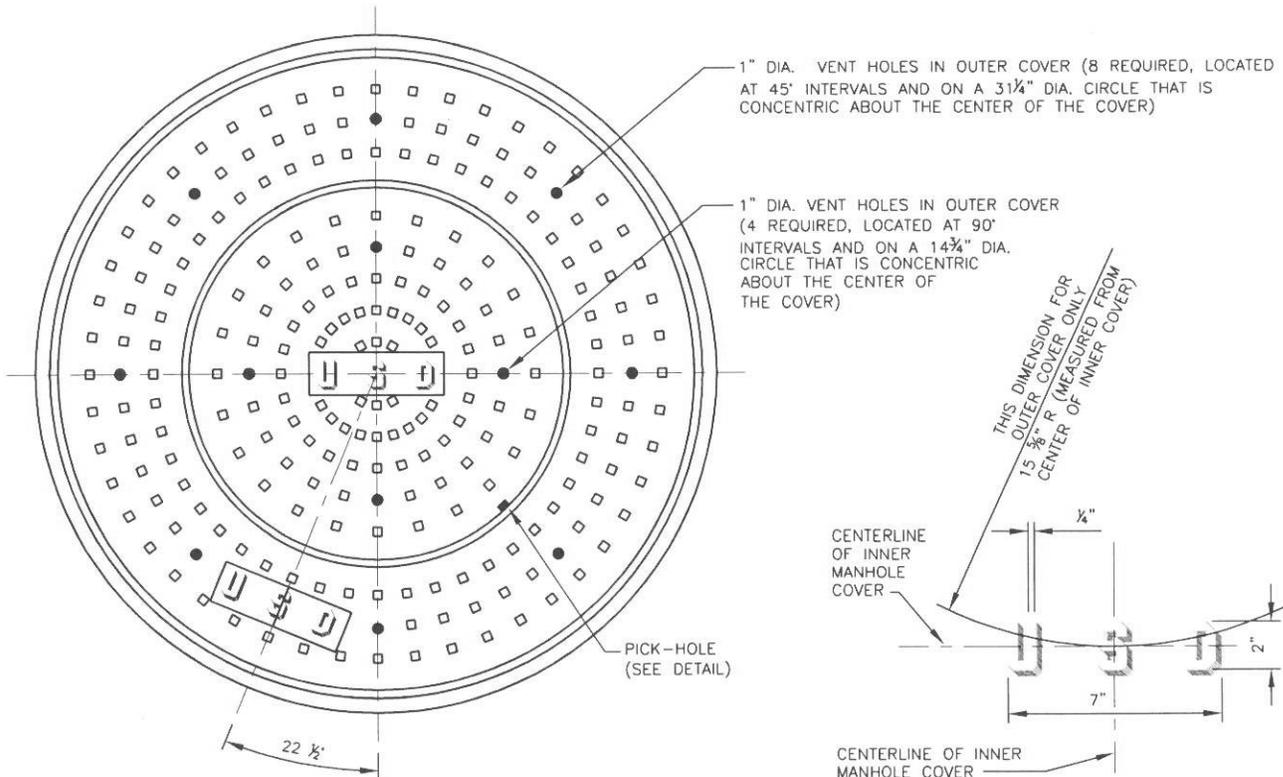



PLAN SECTION
NOT TO SCALE

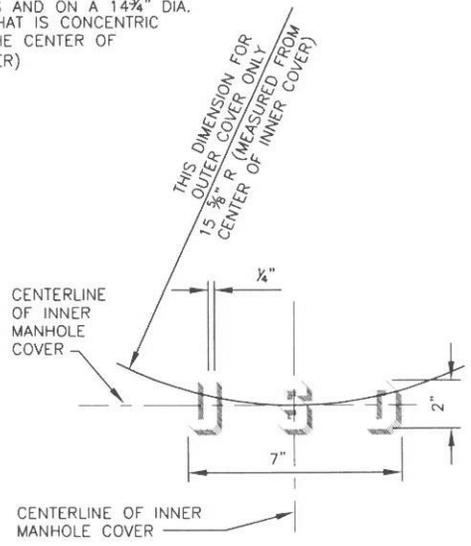

LETTERING DETAIL

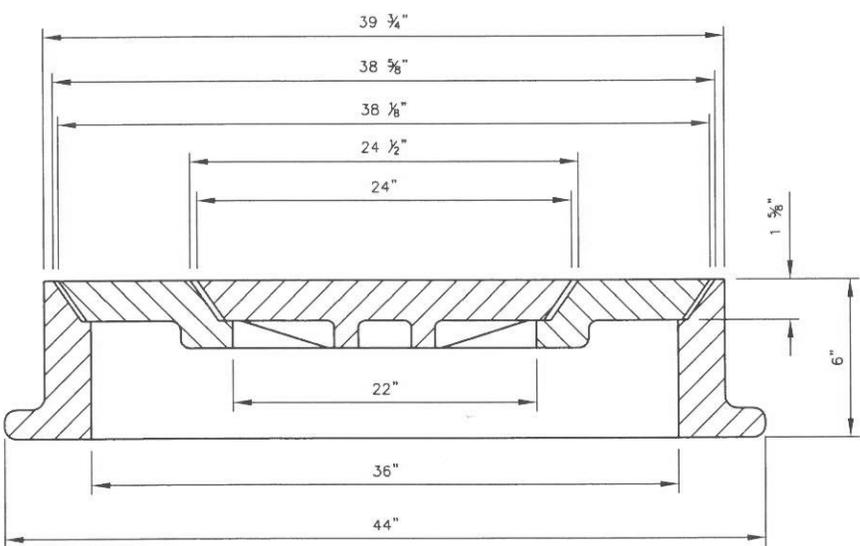

ELEVATION SECTION
NOT TO SCALE

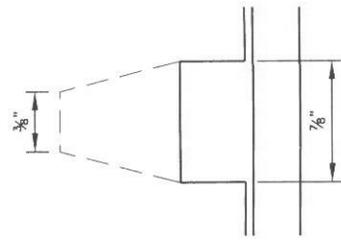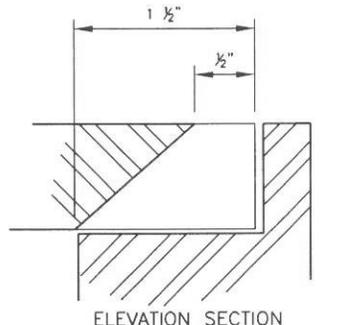


PICK HOLE DETAIL
NOT TO SCALE

- NOTES:
1. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
 2. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
 3. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
 4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVERS SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
 5. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95420, OR APPROVED EQUAL.
 6. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.

Date 5-12-06 Detail No. 11
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587


 **UNION SANITARY DISTRICT**

**36" DIAMETER MANHOLE
 FRAME AND COVER**

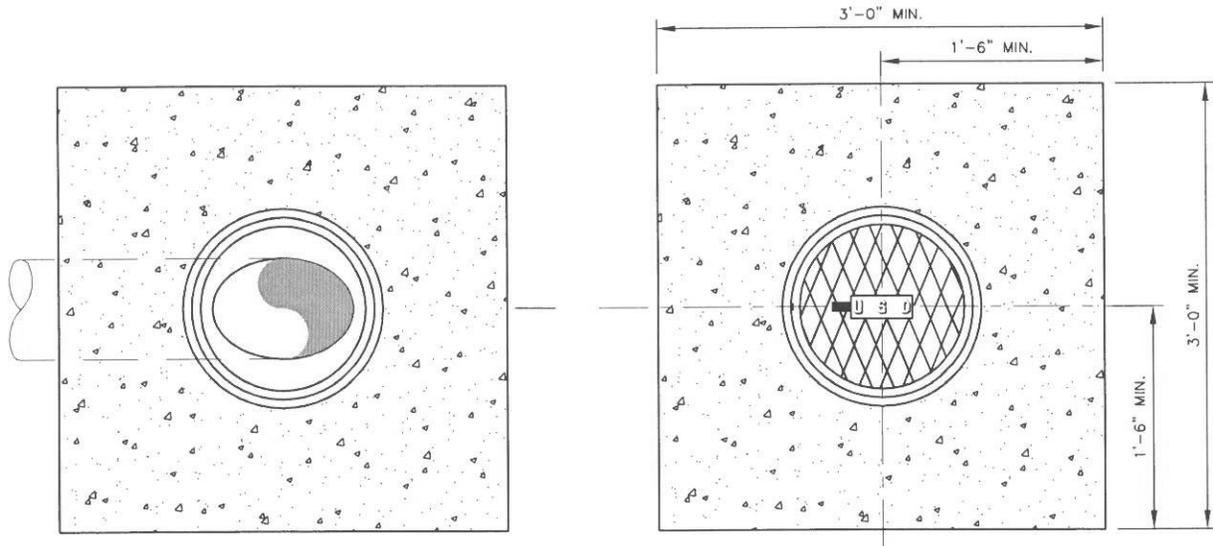


PLAN SECTION WITHOUT LID
NOT TO SCALE

PLAN SECTION
NOT TO SCALE

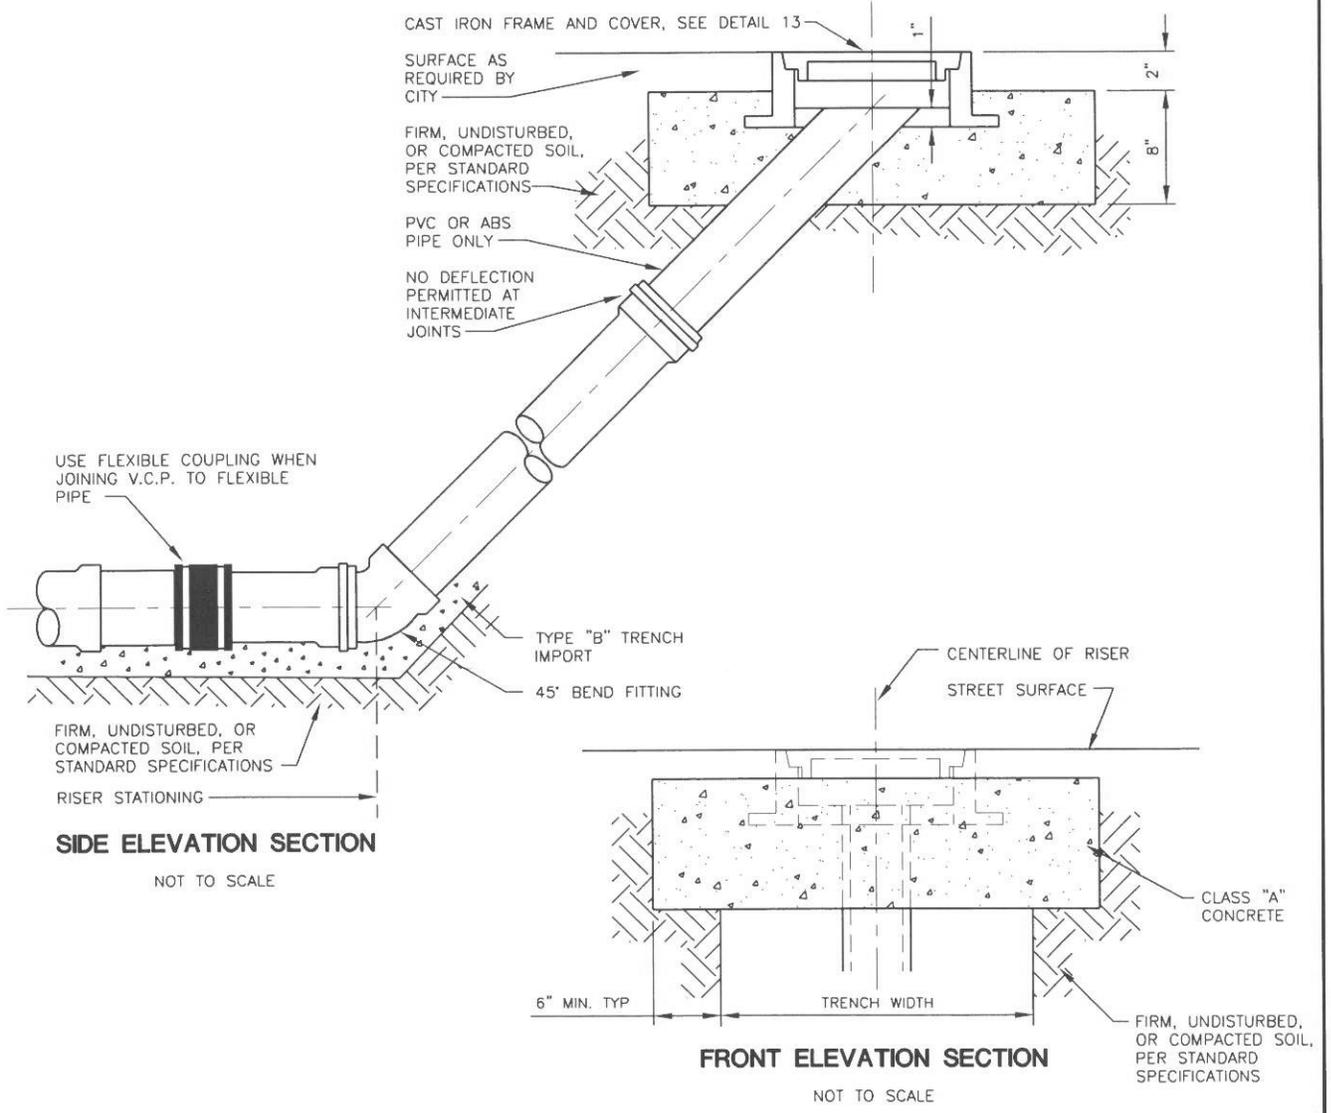


SIDE ELEVATION SECTION
NOT TO SCALE


FRONT ELEVATION SECTION
NOT TO SCALE

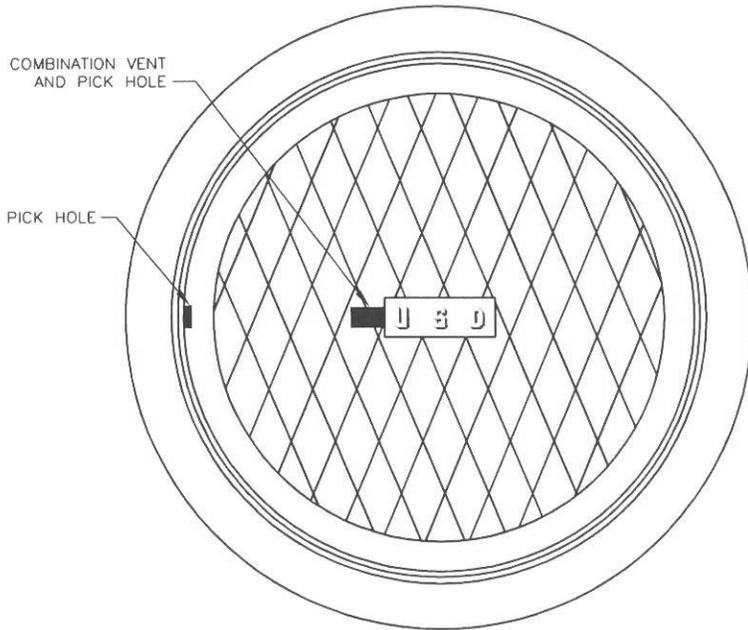


PLAN SECTION
NOT TO SCALE

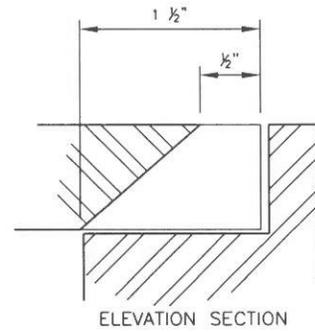


ELEVATION SECTION

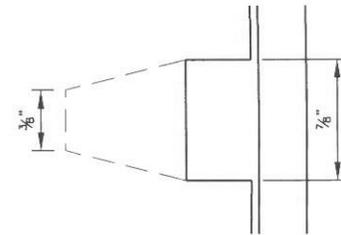

PICK HOLE DETAIL
NOT TO SCALE

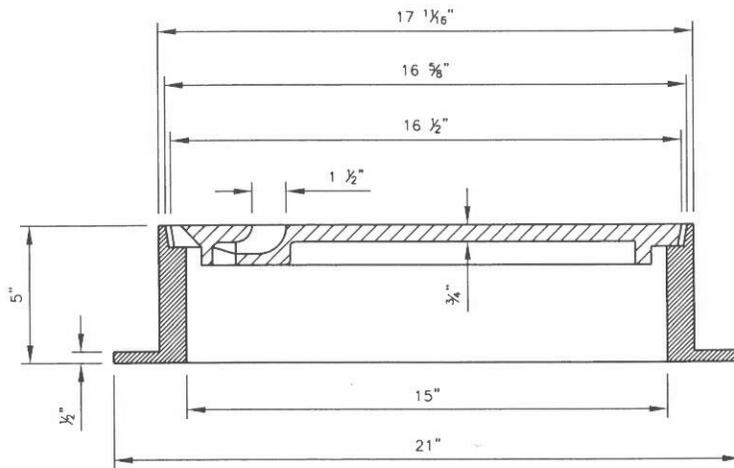

ELEVATION SECTION
NOT TO SCALE

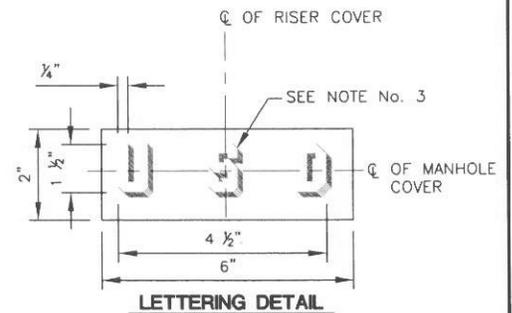

LETTERING DETAIL

NOTES:

1. MINOR MODIFICATIONS IN ABOVE DIMENSIONS AND MANUFACTURING CONFIGURATIONS ARE PERMISSIBLE SUBJECT TO DISTRICT APPROVAL.
2. CAST IRON FOR FRAME AND COVER SHALL BE CLASS 30 MINIMUM AS PER ASTM A-48.
3. RAISED LETTERS 1/4" HIGH TO BE CAST IN CENTER OF MANHOLE COVER.
4. BEFORE LEAVING THE FOUNDRY, THE FRAME AND COVER SHALL BE PAINTED OR DIPPED IN ASPHALT PAINT.
5. SEE UNION SANITARY DISTRICT STANDARD DETAIL NO. 12 FOR INSTALLATION REQUIREMENTS.
6. MANHOLE FRAME AND COVER SHALL BE AS MANUFACTURED BY SOUTH BAY FOUNDRY, 42 N. CLUFF AVE., LODI, CA 95240, OR APPROVED EQUAL.
7. FRAME AND COVER BEARING SURFACES SHALL BE MACHINED TO ASSURE CLOSE, QUIET FIT.

Date 10-25-05 Detail No. 13
Approved By Richard B. Currie
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

**RISER FRAME & COVER FOR
6", 8" & 10" DIAMETER PIPE**


NOTES:

- DO NOT INSTALL A STANDARD CLEANOUT IF THE LENGTH BETWEEN THE STANDARD CLEANOUT AND THE TWO-WAY CLEANOUT IS 20' OR LESS.
- THE SEWER SHALL BE LAID ON A STRAIGHT GRADE BETWEEN THE MAIN SEWER AND THE PROPERTY LINE AND BETWEEN THE PROPERTY LINE AND BUILDING PLUMBING.

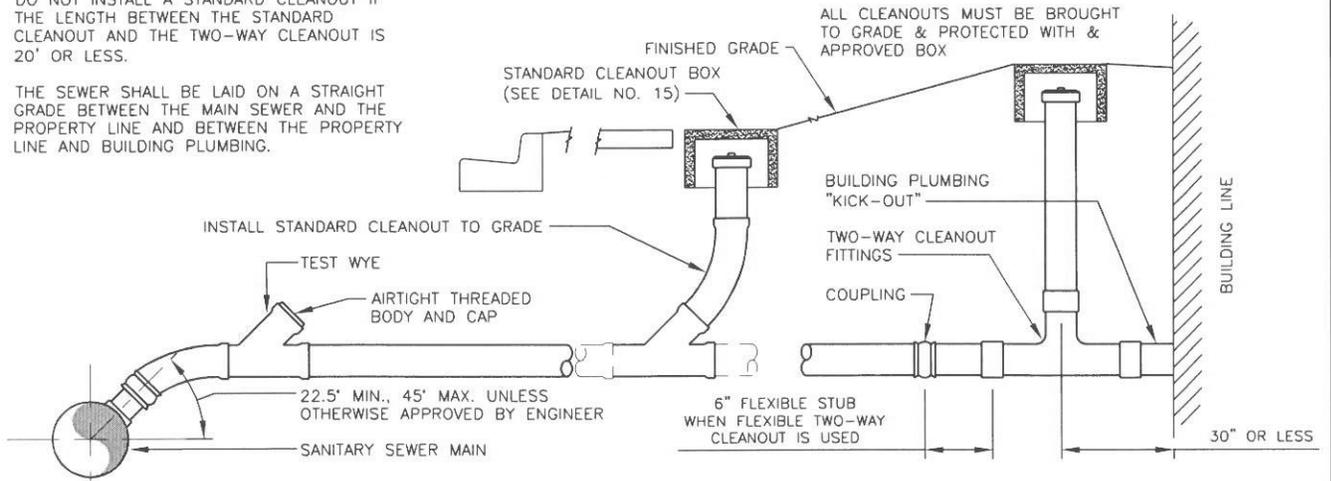


TYPICAL CONNECTION OF BUILDING SEWER TO EXISTING MAIN SEWER

NOT TO SCALE

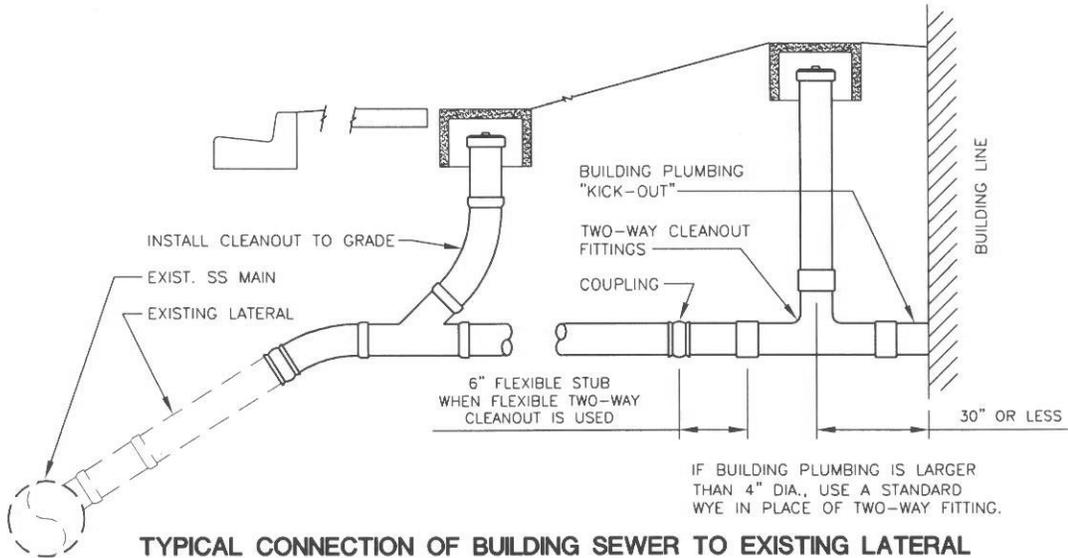


TYPICAL CONNECTION OF BUILDING SEWER TO EXISTING LATERAL

NOT TO SCALE

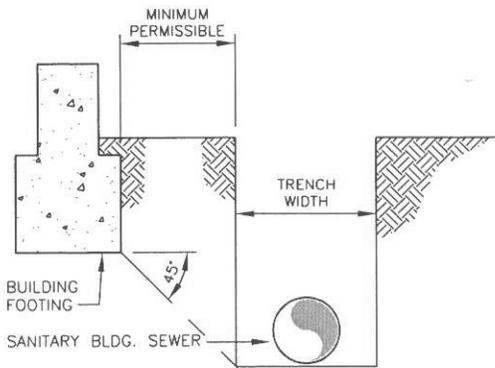


DETAIL - BUILDING SEWER ADJACENT TO BUILDING FOOTING

NOT TO SCALE

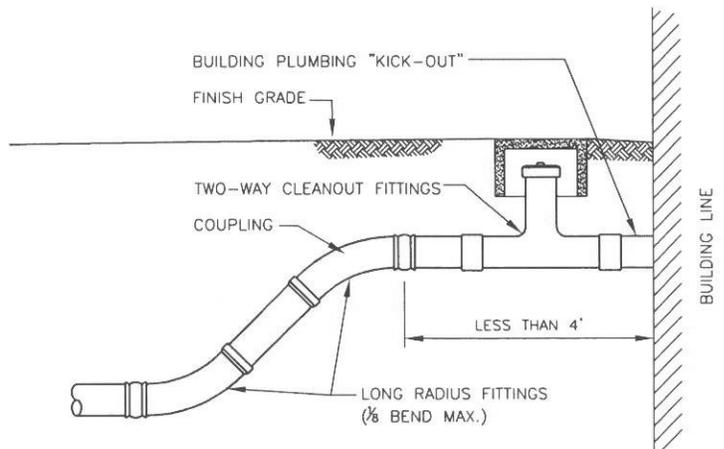


TYPICAL CONNECTION TO BUILDING SEWER FOR SHALLOW BUILDING PLUMBING "KICK-OUT"

NOT TO SCALE

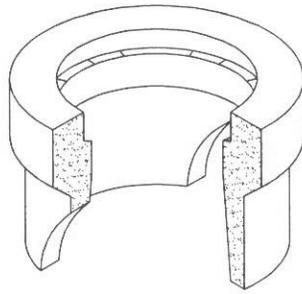


CIRCULAR CONCRETE BOX

NOT TO SCALE

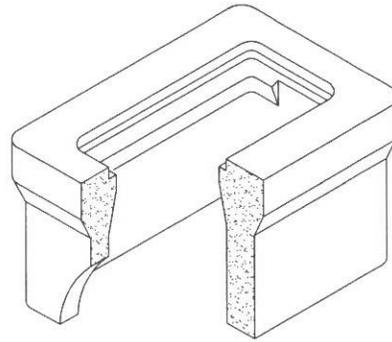

RECTANGULAR CONCRETE BOX

NOT TO SCALE

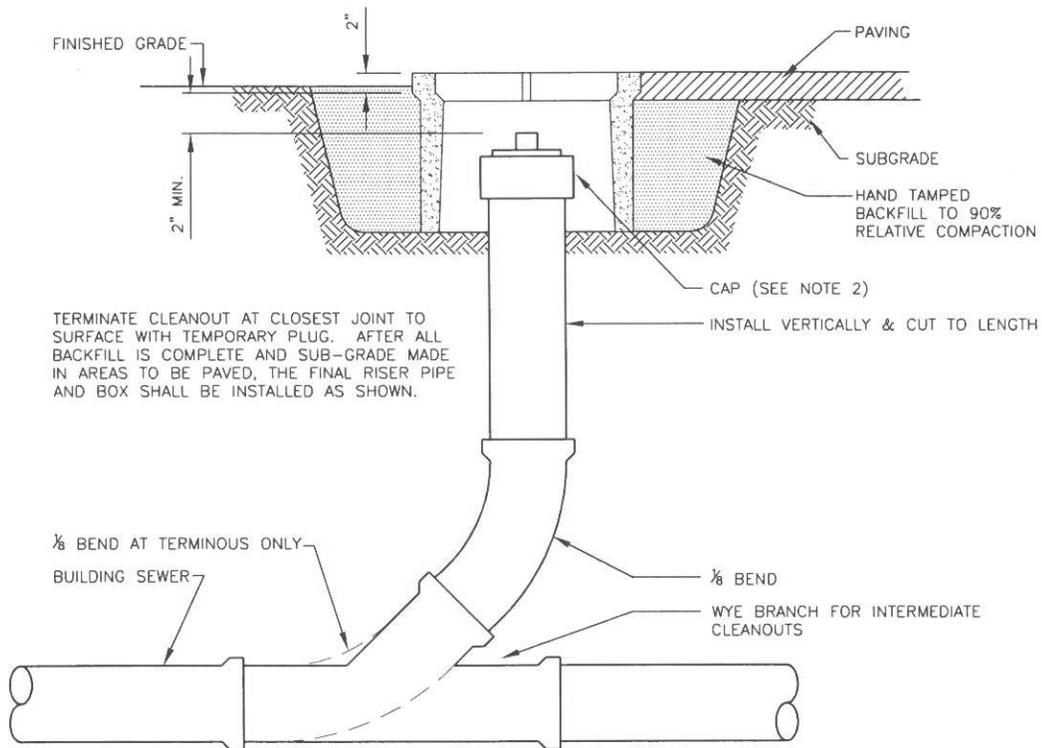

ELEVATION

NOT TO SCALE

NOTES:


1. RECTANGULAR OR CIRCULAR BOXES ARE PERMITTED.
2. CLEANOUT CAPS SHALL CONSIST OF AN AIRTIGHT THREADED BODY AND CAP.
3. CIRCULAR BOXES INSTALLED IN SIDEWALK AREAS SHALL HAVE A SOLID COVER WITHOUT HOLES.
4. APPROVED RECTANGULAR BOXES ARE:
 - a) CHRISTY CONCRETE PRODUCTS: B3 BOX WITH A B3D CONCRETE LID OR A B3C METAL LID OR
 - b) BROOKS PRODUCTS, INC.: No. 3 METER BOX WITH A No. 3 HEAVY DUTY CONCRETE LID OR A No. 3 CAST IRON TRAFFIC LID. OR AN APPROVED EQUAL.
5. CONCRETE LIDS ARE ACCEPTABLE FOR USE IN NON-VEHICULAR TRAFFIC AREAS, WHILE METAL LIDS MUST BE USED ELSEWHERE. BOLT-DOWN LIDS MAY BE REQUIRED IN CONCRETE WALKWAYS OR DRIVEWAYS.
6. ALL CLEANOUT BOX LIDS SHALL BE MARKED WITH A LETTER "S" OR THE WORD "SEWER".
7. CLEANOUT PIPE SHALL BE THE SAME DIAMETER AS BUILDING SEWER DIAMETER.

Date 5-12-06 Detail No. 15
 Approved By Richard B. Currie
 RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

**BUILDING SEWER
 CLEANOUT TO GRADE**

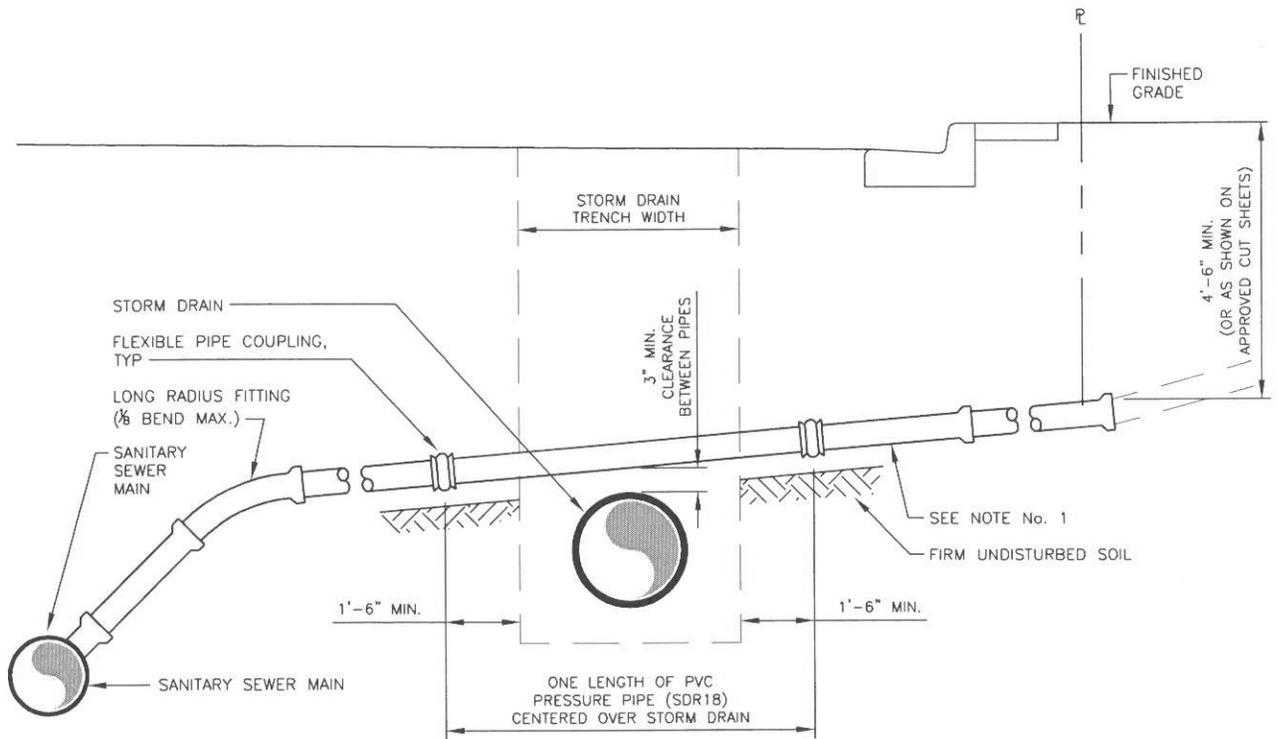

TYPICAL CROSSING OVER STORM DRAIN

NOT TO SCALE

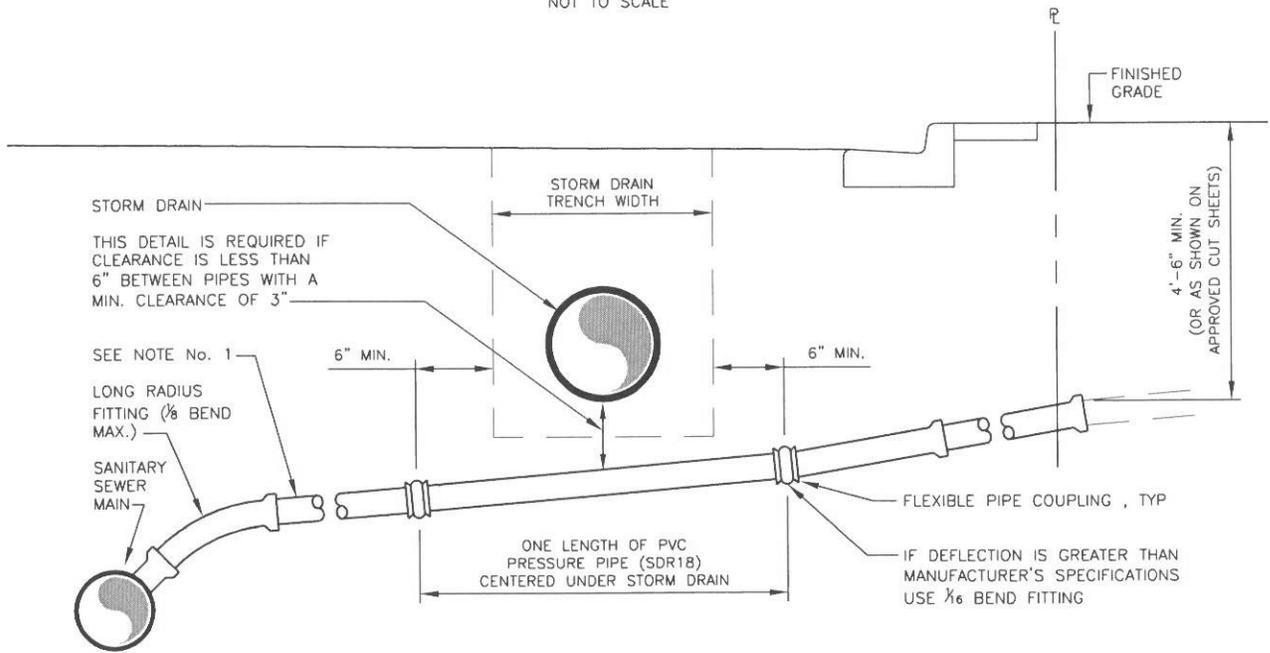

TYPICAL CROSSING UNDER STORM DRAIN

NOT TO SCALE

NOTES:


1. THE ABOVE DETAILS ARE TYPICAL FOR MAIN AND BUILDING SEWER WHEN VCP PIPE MATERIAL IS USED.
2. THIS TYPE OF CROSSING MAY BE REQUIRED BY UNION SANITARY DISTRICT WHEN CROSSING CERTAIN OTHER UTILITIES.
3. THE BOTTOM DETAIL IS TYPICAL FOR MAIN AND BUILDING SEWER WHEN PVC PIPE IS USED UNDER STORM SEWER PIPE 48 INCHES IN DIAMETER OR LARGER.

Date 10-25-05 Detail No. 16
 Approved By Richard B. Currie
 RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT


**VCP SANITARY SEWER/STORM
 DRAIN CROSSING**

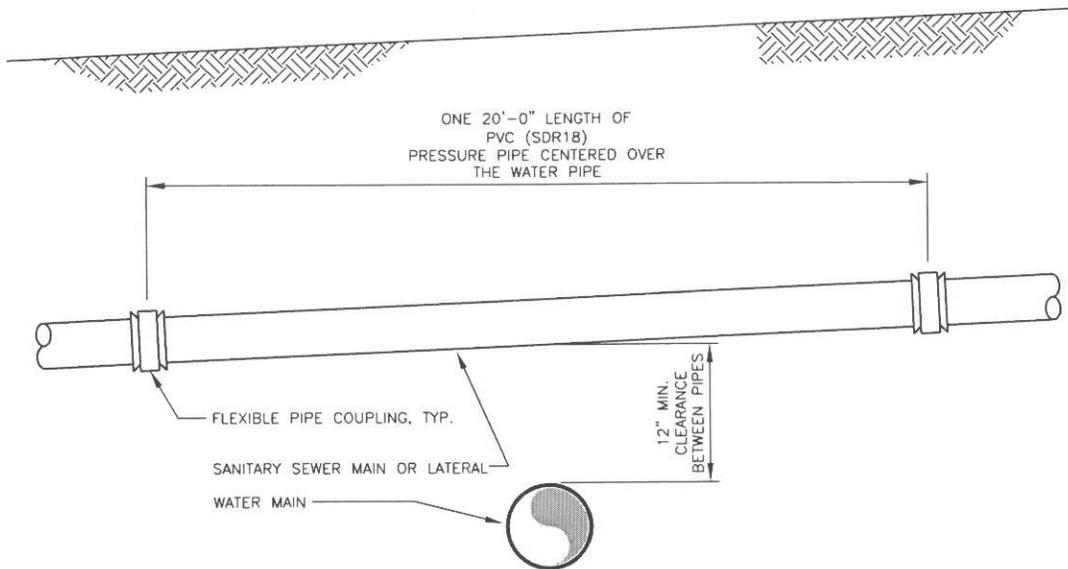

TYPICAL CROSSING OVER WATER MAIN

NOT TO SCALE

NOTE: REQUIRED WHENEVER A SANITARY SEWER MAIN OR LATERAL CROSSES OVER A WATER MAIN

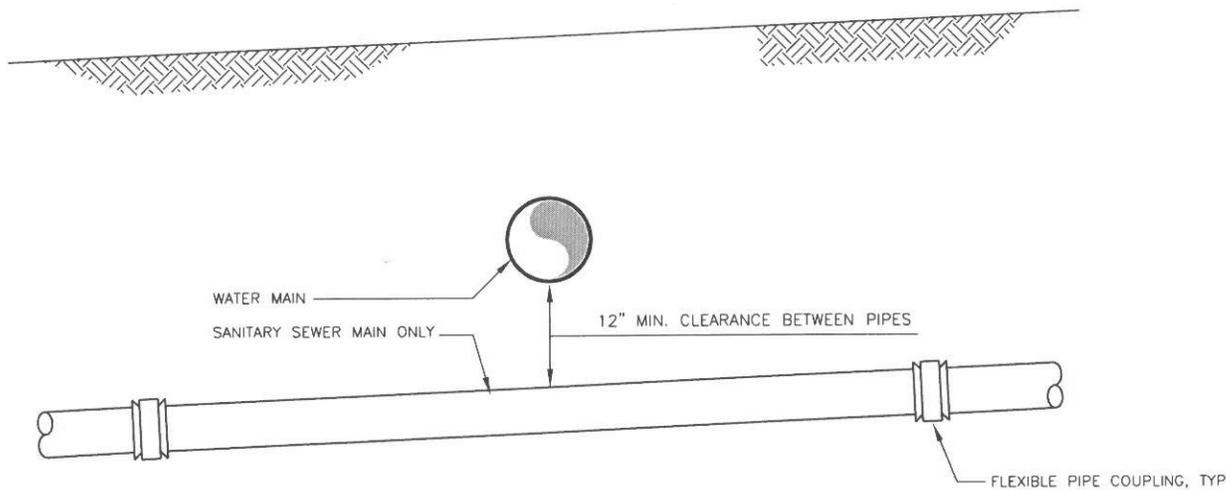

TYPICAL CROSSING UNDER WATER MAIN

NOT TO SCALE

Date 10-25-05 Detail No. 17

Approved By *Richard B. Currie*
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT



SANITARY SEWER/WATER
MAIN CROSSING

PIPE COVER LIMITATION TABLE			
PIPE SPECIFICATION - SEE SEC. 5		COVER IN FEET MIN - MAX**	
MATERIAL	TYPE AND MINIMUM CLASS	DETAIL A	DETAIL B
BUILDING SEWERS FROM PROPERTY LINE TO BUILDING IN UNPAVED PRIVATE PROPERTY			
4"-6" VCP		-	2.0 - 30
4"-6" ABS	SOLID WALL	-	2.0 - 30
4"-6" CIP	SOIL PIPE	-	1.0 - 30
4"-6" CIP	DUCTILE (CLASS 50 & 51)	-	0.5 - 30
4"-6" PVC	SOLID WALL (CLASS SDR 18)	-	1.0 - 30
4"-6" PVC	SOLID WALL (CLASS SDR 26)	-	2.0 - 30
BUILDING SEWERS IN PUBLIC UTILITY & U.S.D. EASEMENTS, PUBLIC RIGHTS OF WAY & PAVED PRIVATE PROPERTY			
4"-6" VCP		3.0 - 19	-
4"-6" DIP	DUCTILE (Class 50 & 51)	0.5 - 30	-
4"-6" ABS	SOLID WALL	3.0 - 30	-
4"-6" PVC	SOLID WALL (Class SDR 26)	3.0 - 30	-
MAIN SEWERS IN PUBLIC UTILITY & U.S.D. EASEMENTS, PUBLIC RIGHTS OF WAY & PAVED PRIVATE PROPERTY			
8"-Larger VCP		3.0 - 14	-
8"-Larger DIP	DUCTILE (Class 50 & 51)	0.5 - 30	-
8"-Larger PVC	SOLID WALL (Class SDR 26)	3.0 - 30	-

**WHEN MAXIMUM COVER IS EXCEEDED, APPROVAL BY U.S.D. OF SPECIAL BEDDING REQUIREMENTS IS NECESSARY.

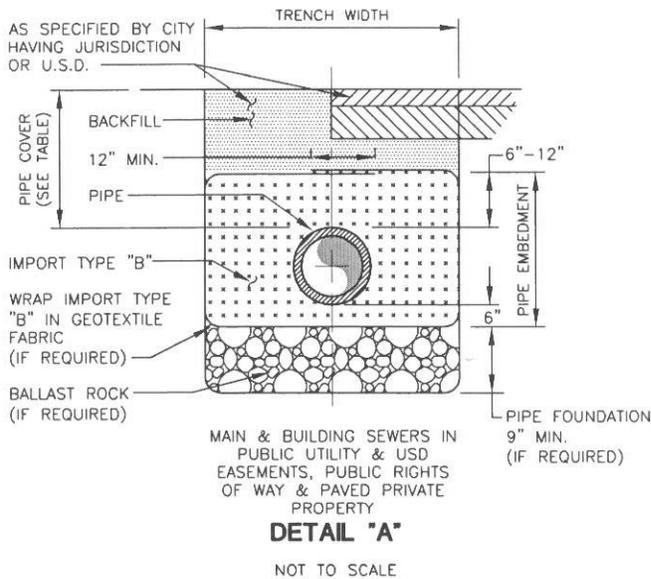

MINIMUM SIZE AND SLOPE LIMITATION TABLE			
SPECIFICATION - SEE SEC. 21 & 22			
PIPE DIAMETER	MINIMUM SLOPE (FT. PER FT.)	COMMENTS	MAXIMUM FIXTURE UNITS
BUILDING SEWER FROM SEWER MAIN TO BUILDING			
4"	0.020	IF MAIN IS NOT OF ADEQUATE DEPTH 0.01 FT/FT IS MINIMUM.	200
6"	0.005		600
6"	0.006		700
6"	0.007		800
6"	0.008		900
6"	0.009		1000
6"	0.010		1200
MAIN SEWERS			
8"	0.0034		---
10"	0.0026		---
12"	0.0020		---
15"	0.0015		---
18"	0.0012		---

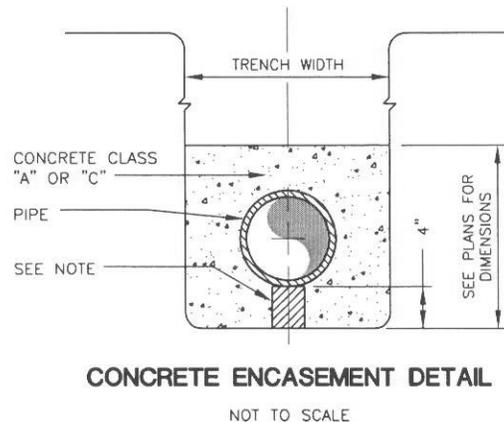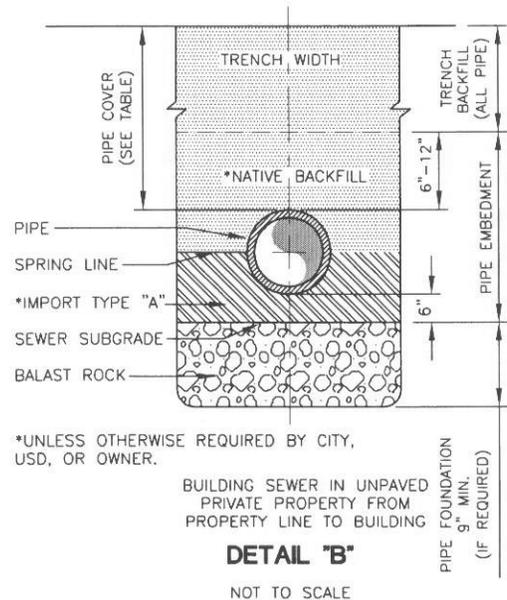

NOTE:
CONCRETE BLOCK OR BRICK ON FIRM UNDISTURBED GROUND
BEFORE CONCRETE ENCASEMENT IS Poured.

Date 10-25-05 Detail No. 18
Approved By *Richard B. Currie*
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

SEWER PIPE INSTALLATION (COVER,
SLOPE, SPECIAL BEDDING AND
ENCASEMENT REQUIREMENTS)

18


NOTE TO ENGINEER OR ARCHITECT

PROVIDE 4" ELEVATION DROP BETWEEN INLET AND OUTLET PIPES THROUGH BOX. SHOW PIPE INVERT ELEVATIONS AT INLET AND OUTLET PLAN.

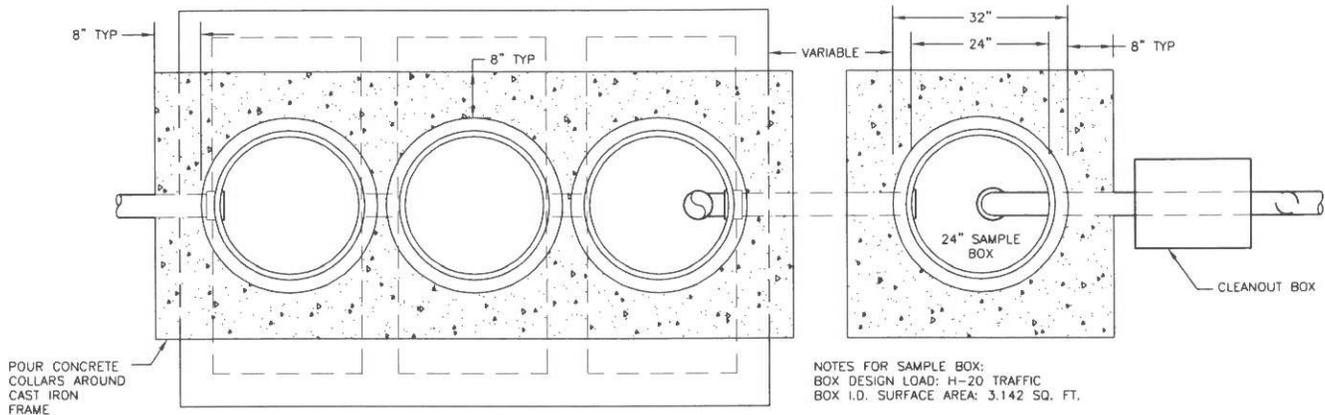

PLAN VIEW

NOT TO SCALE

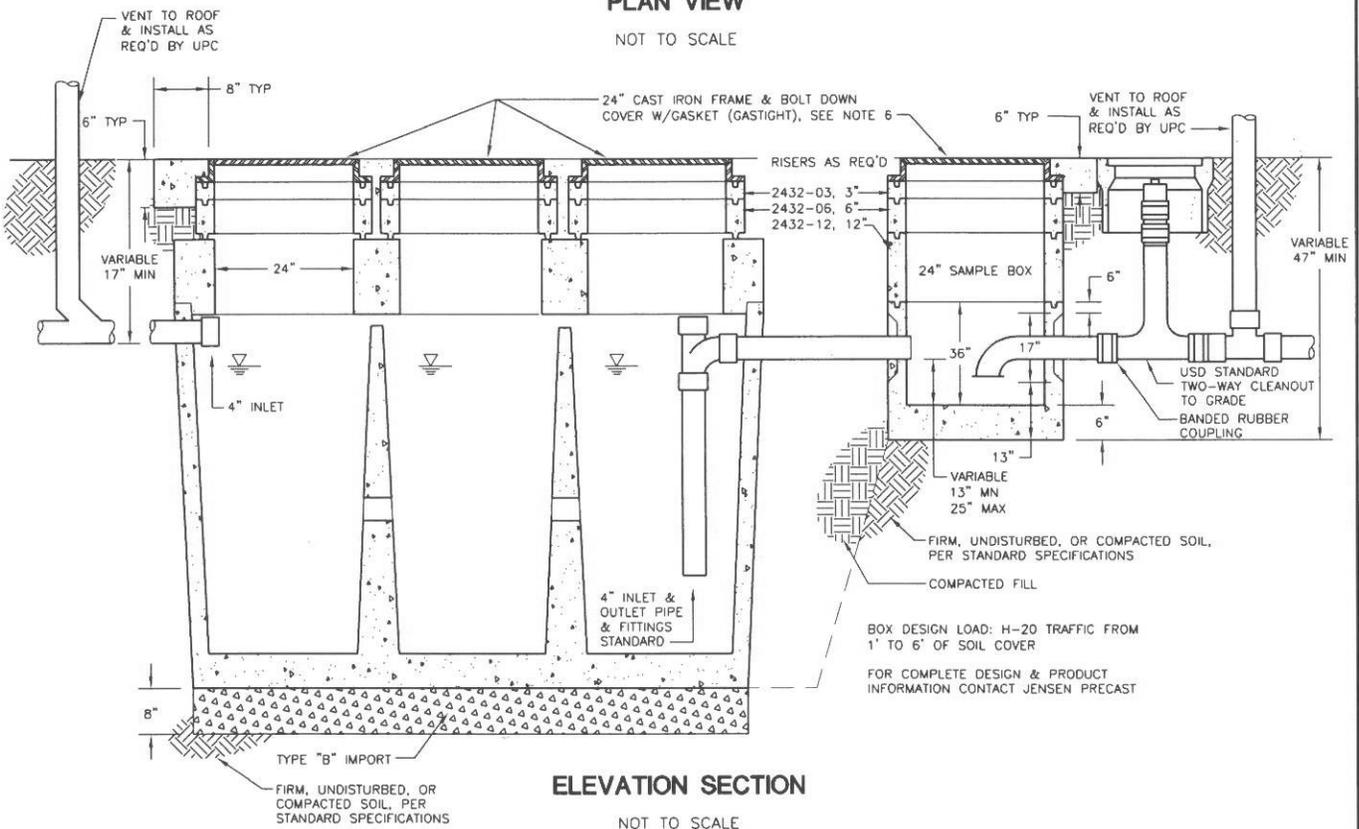

ELEVATION SECTION

NOT TO SCALE



NOTES:

1. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.
2. CIRCULAR LIDS SHALL BE SOUTH BAY FOUNDRY 1900-BD OR APPROVED EQUAL, WITH RAISED "S" OR "SANITARY SEWER".
3. TANK TO BE PLACED ON TYPE "B" IMPORT.
4. HEIGHT OF TANK ABOVE FITTINGS IS VARIABLE, 6 OR 12 INCH SECTIONS MAY BE ADDED TO REACH THE REQUIRED FINISHED GRADE. MORTAR AND BAND BOTH SIDES IN FIELD.
5. ALL CONCRETE JOINTS SHALL BE CLEANED, WETTED AND MORTARED PRIOR TO SETTING NEXT SECTION. THE JOINTS SHALL BE PACKED, TROWELED AND BANDED SMOOTH ON BOTH SIDES OF THE BOX.
6. BOLT EACH OF THE THREE (3) COMPARTMENT COVERS DOWN TO FRAME WITH NOT LESS THAN TWO (2) 7/16" HEX HEAD STEEL BOLTS.
7. UNLESS OTHERWISE APPROVED BY THE CITY OF JURISDICTION, A VENT WILL BE REQUIRED ON THE INLET SIDE OF THE INTERCEPTOR WHEN ITS DISTANCE FROM THE VENT SYSTEM WITHIN THE BUILDING IS GREATER THAN 10 FEET. VENT PIPES ON THE INLET SIDE AND THE OUTLET SIDE MAY BE INSTALLED SEPARATELY OR COMBINED IN CONFORMANCE WITH THE UNIFORM PLUMBING CODE.
8. STRUCTURE SHALL BE MANUFACTURED BY JENSEN PRECAST OR APPROVED EQUAL.
9. PLUMBING THROUGH THE INTERCEPTOR SHALL MATCH LATERAL SIZE.
10. SEE JENSEN PRECAST, OR APPROVED EQUAL, FOR DIMENSIONS OR EQUIVALENT TANK WITH PRIOR APPROVAL OF THE ENGINEER. MAXIMUM TANK SIZE SHALL BE 3,000 GALLONS. MULTIPLE TANKS SHALL BE USED FOR INTERCEPTORS REQUIRING MORE THAN 3,000 GALLON VOLUME.

Date 10-25-05 Detail No. 19
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587

US UNION SANITARY DISTRICT

THREE COMPARTMENT SAND & GREASE INTERCEPTOR 19

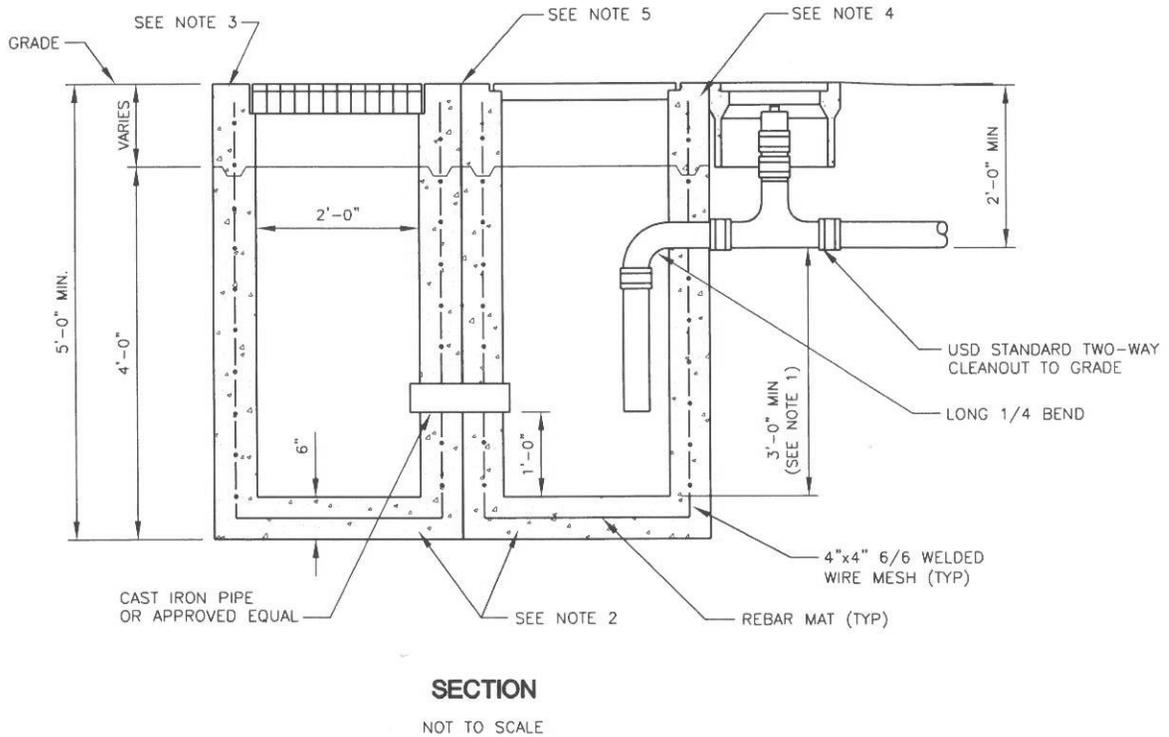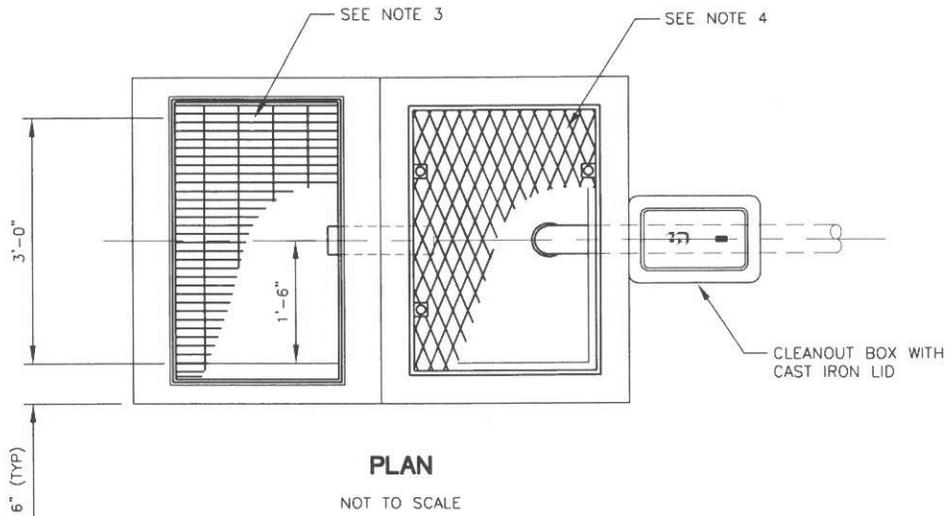

NOTES:

1. DIMENSION AS SHOWN UNLESS OTHERWISE SPECIFIED BY USD.
2. TWO (2) U32 CATCH BASIN BOXES AS MANUFACTURED BY CHRISTY CONCRETE PRODUCTS, INC., 44100 CHRISTY STREET, FREMONT, CA 94538 OR AN APPROVED EQUAL.
3. ONE (1) U32 CATCH BASIN GRADE RING WITH A FRAME NO. U32 CAST IN PLACE WITH A WELDED STEEL GALVANIZED GRATE NO. U32 HT (HIGH TRAFFIC) AS MANUFACTURED OR SUPPLIED BY THE COMPANY IN NOTE NO. 2 OR AN APPROVED EQUAL.
4. ONE (1) U32 CATCH BASIN GRADE RING WITH A VAULT FRAME CAST IN PLACE AND A GALVANIZED STEEL VAULT COVER NO. T32-51JH (H-20, GALV.) BOTH WITH BOLT DOWN PROVISIONS AS MANUFACTURED OR SUPPLIED BY THE COMPANY IN NOTE NO. 2 OR AN APPROVED EQUAL.
5. EPOXY BOTH BOXES TOGETHER IN THE FIELD WITH A TWO-COMPONENT, 100% SOLIDS EPOXY RESIN.
6. PLUMBING THROUGH SUMP SHALL MATCH LATERAL SIZE.


Date 10-25-05 Detail No. 20
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

TWO COMPARTMENT SUMP

20

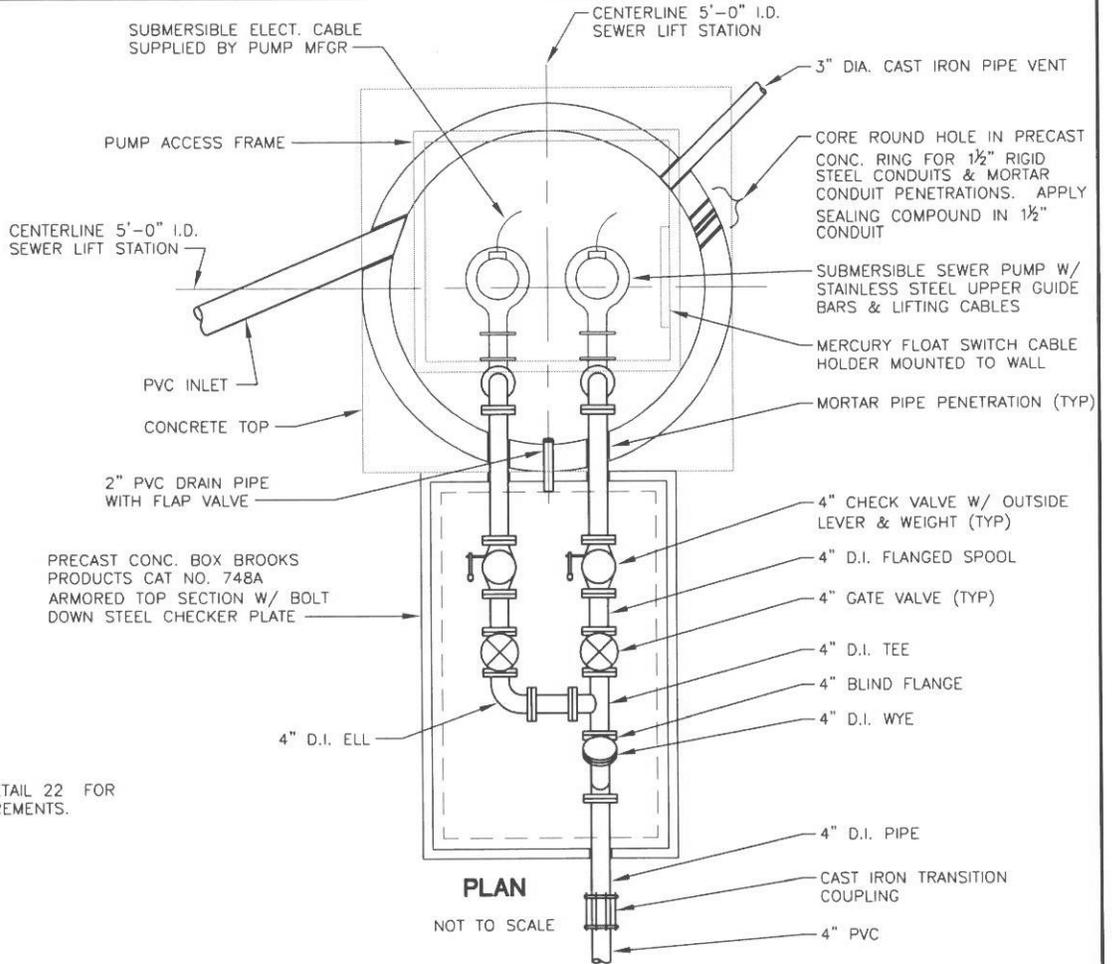

NOTE: SEE NOTES ON DETAIL 22 FOR ADDITIONAL REQUIREMENTS.

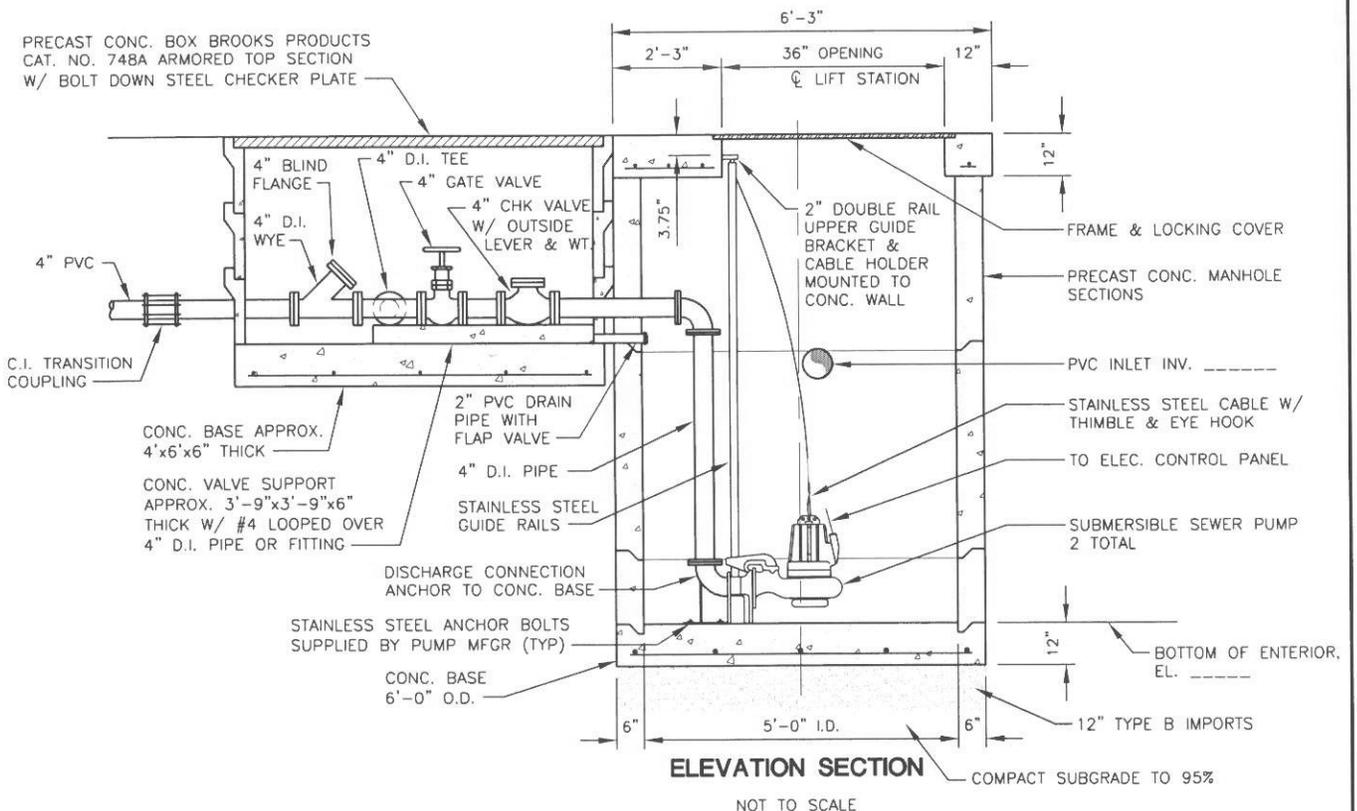


Date 5-12-06 Detail No. 21
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT

PRIVATE PUMPING STATION
 PLAN AND ELEVATION SECTION

21

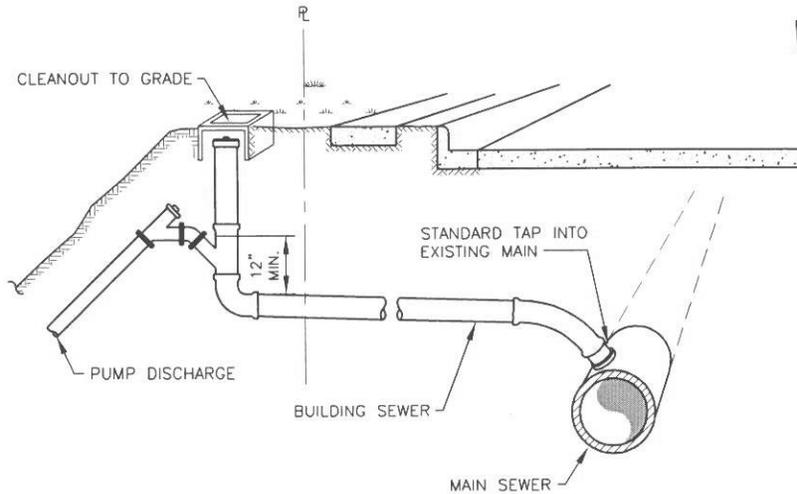

ELEVATION SECTION

NOT TO SCALE

NOTES:

1. THE MINIMUM REQUIREMENTS FOR A PRIVATE PUMPING SYSTEM CONNECTING TO THE DISTRICT'S SYSTEM ARE SPECIFIED IN THE FOLLOWING PARAGRAPHS.
2. THE DISTRICT ACCEPTS NO RESPONSIBILITY FOR THE DESIGN, OPERATION OR MAINTENANCE OF SUCH PRIVATELY-OWNED AND OPERATED SYSTEMS.
3. ALL EQUIPMENT AND ACCESSORIES SHALL BE STANDARD MANUFACTURED ITEMS AND THOSE COMING IN DIRECT CONTACT WITH SEWAGE SHALL BE SPECIFICALLY MANUFACTURED FOR SEWAGE USE.
4. WHEN INSTALLED OUTSIDE OF A BUILDING, THE MOTOR, CONTROLS AND VALVES SHALL BE READILY ACCESSIBLE FOR MAINTENANCE YET PROTECTED AND SHELTERED BY A WEATHER-PROOF, WELL VENTILATED ENCLOSURE SECURED AGAINST TAMPERING.

PUMPS:

THE PUMPS SHALL BE A CENTRIFUGAL, SUBMERSIBLE, NON-CLOG TYPE. THE IMPELLER SHALL BE CAPABLE OF PASSING A TWO (2) INCH SPHERE. THE MINIMUM PUMP DISCHARGE SHALL BE THREE (3) INCHES IN DIAMETER. THE PUMP CAPACITY AGAINST THE REQUIRED HEAD SHALL BE APPROVED BY THE DISTRICT.

SUBMERSIBLE PUMPS MUST BE U.L. RATED AS EXPLOSION PROOF. PUMP REQUIREMENTS INSOFAR AS SOLIDS HANDLING CAPACITY AND PUMP RATE AND HEAD, MUST CONFORM TO BASIC STANDARDS REQUIRED FOR STANDARD WET PIT INSTALLATIONS.

PUBLIC USAGE INSTALLATIONS (AS DEFINED IN THE UNIFORM PLUMBING CODE) WILL REQUIRE DUAL PUMPS MEETING ABOVE DESIGN STANDARDS AND ARRANGED TO FUNCTION INDEPENDENTLY IN CASE OF OVERLOAD OR MECHANICAL FAILURE.

PUMP SUMP:

THE PUMP SUMP TANK SHALL BE SIXTY (60) INCHES IN DIAMETER AND THE DEPTH SHALL BE AS REQUIRED TO EXTEND SIX (6) INCHES ABOVE GROUND AND THREE (3) FEET BELOW THE INLET PIPE (UNLESS OTHERWISE APPROVED BY THE DISTRICT). THE PUMP SUMP SHALL BE REINFORCED CONCRETE.

ELECTRIC POWER SERVICE:

THE POWER REQUIREMENTS SHALL BE AS RECOMMENDED BY THE PACIFIC GAS AND ELECTRIC COMPANY. THE NAME PLATE HORSEPOWER SHALL BE GREATER THAN THE BRAKE HORSEPOWER NECESSARY TO OPERATE THE PUMP AT THE TOTAL REQUIRED HEAD AND SHALL NOT OVERLOAD IF OPERATING HEAD SHOULD DROP 30%.

ELECTRICAL WORK AND CONTROL:

ALL ELECTRICAL WORK AND CONTROLS SHALL CONFORM TO THE REQUIREMENTS OF THE CITY HAVING JURISDICTION. THE ELECTRICAL CONTROLS SHALL PROVIDE ADEQUATE PROTECTION FOR THE MOTOR AND EQUIPMENT.

FLOAT SWITCH ASSEMBLY:

THE LEVEL CONTROL SWITCH SHALL HAVE GAS TIGHT MOUNTINGS WITH A NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION ONE (1) SWITCH ENCLOSURE.

VENT FOR PUMP SUMP:

WHERE SYSTEM IS LOCATED WITHIN THE DWELLING, A VENT SHALL BE PROVIDED AS REQUIRED BY LOCAL CODES. WHERE SYSTEM IS LOCATED OUTSIDE THE DWELLING, A THREE (3) INCH OR LARGER VENT SHALL BE EXTENDED TO A POINT TEN (10) FEET ABOVE THE PUMP SUMP COVER AND HAVE A RETURN BEND AT TOP.

DISCHARGE LINE:

THE PRESSURE PORTION OF THE DISCHARGE LINE, INCLUDING THE CHECK VALVE, GATE VALVE AND FLEXIBLE COUPLINGS SHALL BE EQUAL IN SIZE TO THE PUMP DISCHARGE. THE PIPE SHALL BE DUCTILE IRON OR APPROVED EQUAL SUITABLE FOR DESIGN PRESSURES. THE CHECK VALVE SHALL BE A STOCKHAM G-927 OR APPROVED EQUAL. THE GATE VALVE SHALL BE A STOCKHAM G-608 OR APPROVED EQUAL. THE FLEXIBLE COUPLING SHALL BE A STYLE 38 DRESSER COUPLING OR APPROVED EQUAL.

THE GRAVITY PORTION OF THE DISCHARGE LINE SHALL BE FOUR (4) INCH MINIMUM DIAMETER PIPE AND SHALL MEET THE DISTRICT REQUIREMENTS FOR BUILDING SEWERS.

SUBMITTAL REQUIRED FOR DISTRICT APPROVAL:

THE OWNER OR CONTRACTOR SHALL SUBMIT TO THE DISTRICT FOR APPROVAL A COMPLETE DESIGN SUBMITTAL, INCLUDING HYDRAULIC CALCULATIONS, LIST OF EQUIPMENT AND ACCESSORIES TO BE INSTALLED AND PUMP CURVES PRIOR TO DISTRICT ISSUANCE OF A BUILDING SEWER PERMIT. SUBMITTAL SHALL BE STAMPED BY A LICENSED CIVIL OR MECHANICAL ENGINEER.

Date 10-25-05 Detail No. 22




Approved By *Richard B. Currie*
RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT

PRIVATE PUMPING STATION
CONNECTION TO MAIN AND NOTES

22

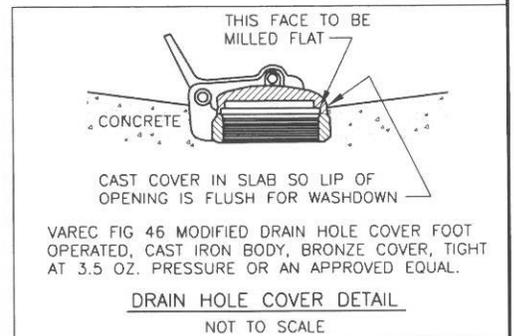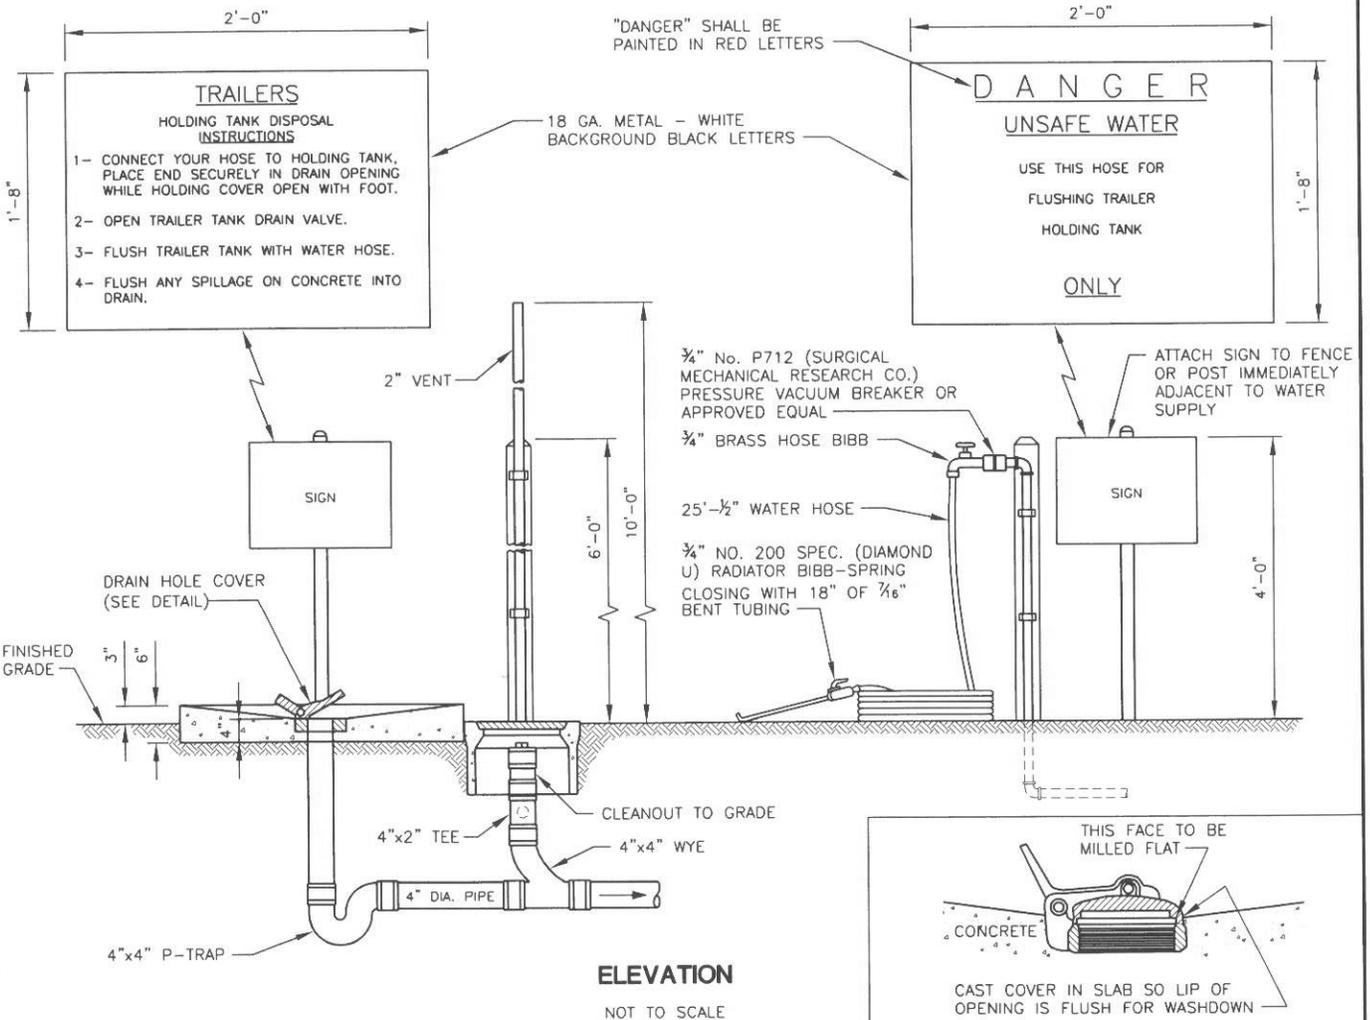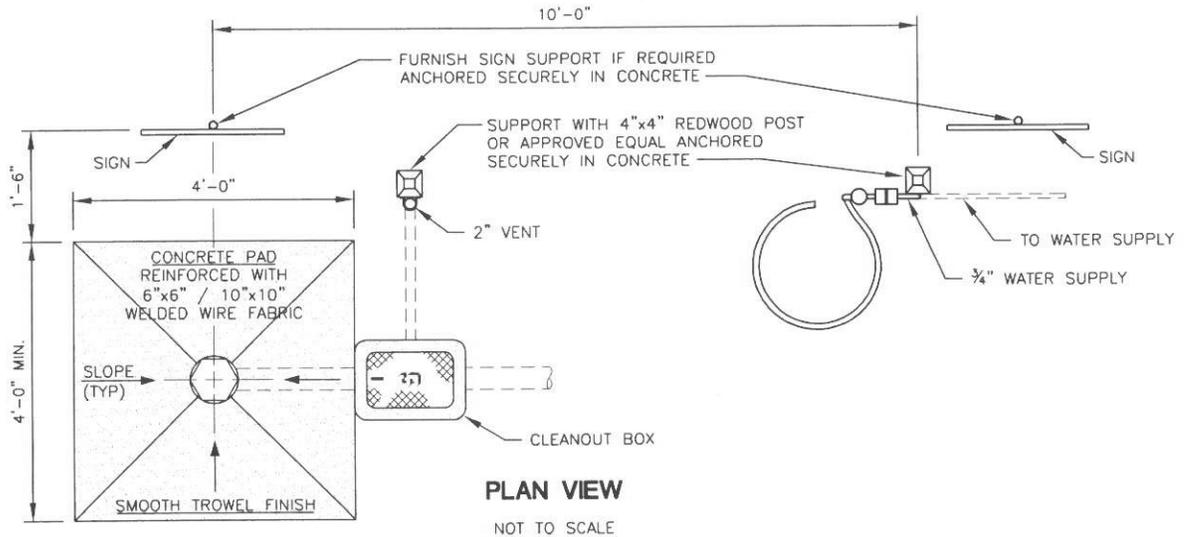

Date 10-25-05 Detail No. 23

Approved By *Richard B. Currie*
RICHARD B. CURRIE, RCE 31587




UNION SANITARY DISTRICT

MOBILE HOME HOLDING
TANK DISPOSAL FACILITY

23


CLASS "A" CONCRETE FORMED & POURED IN PLACE (IF REQUIRED BY ENGINEER)

STAINLESS STEEL BANDING MATERIAL (4 REQUIRED)

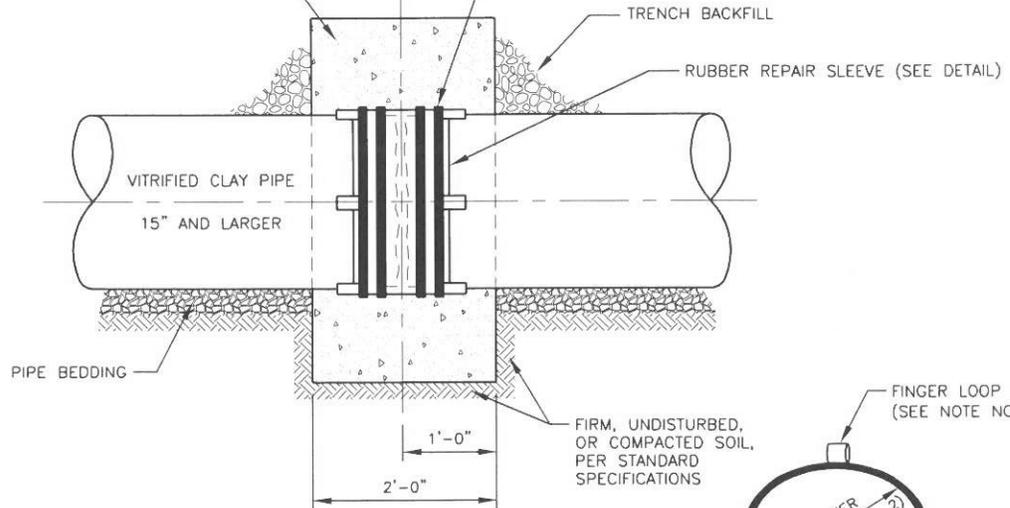

PLAN

NOT TO SCALE

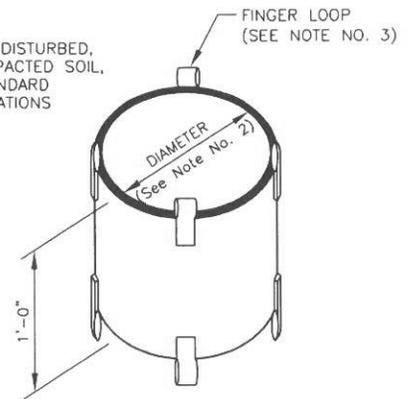


RUBBER REPAIR SLEEVE

DETAIL

NOT TO SCALE

NOTES:

1. REPAIR SLEEVE SHALL BE MADE OF RUBBER REINFORCED WITH ONE OR TWO PLYS OF TIRE CORD AS MANUFACTURED BY VANDELANS & SONS, P.O. BOX 758, 1320 SOUTH SACRAMENTO STREET, LODI, CA. 95241, OR APPROVED EQUAL.
2. THE INSIDE DIAMETER OF THE RUBBER REPAIR SLEEVE SHALL BE $\frac{1}{8}$ " LARGER THAN THE OUTSIDE DIAMETER OF THE VITRIFIED CLAY PIPE.
3. FINGER LOOPS SHALL BE $1\frac{1}{2}$ " WIDE RUBBER REINFORCED WITH ONE PLY OF TIRE CORD AND THE FINGER LOOPS SHALL BE VULCANIZED TO THE RUBBER REPAIR SLEEVE. (4 REQUIRED EACH END AND EQUALLY SPACED AROUND THE CIRCUMFERENCE OF THE REPAIR SLEEVE).

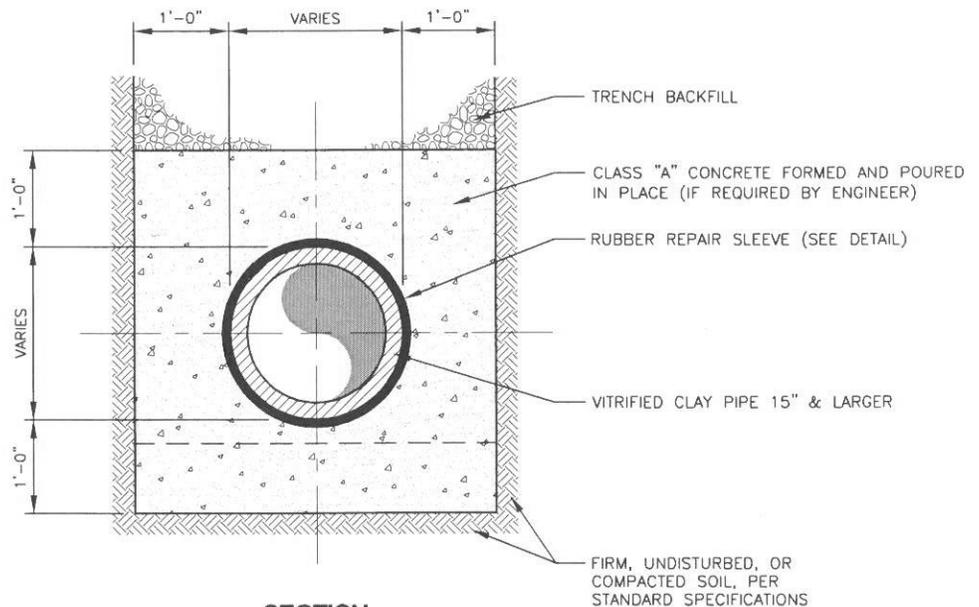

SECTION

NOT TO SCALE


Date 10-25-05 Detail No. 24

Approved By *Richard B. Currie*
RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT

REPAIR COUPLING FOR VCP
15" DIAMETER AND LARGER

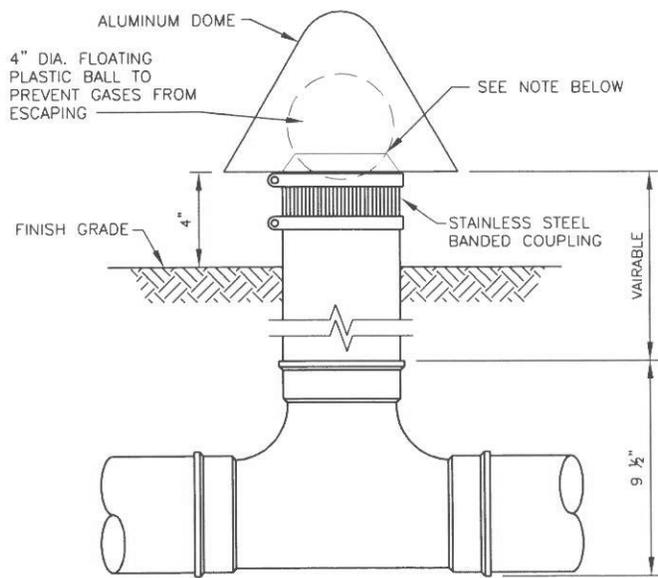


NOTE:
INSTALL THE DEVICE SUCH THAT THE BALL SEAT IS LOWER THAN THE ELEVATION OF THE LOWEST PLUMBING FIXTURE ATTACHED TO THE BUILDING DRAINS.

BACKWATER OVERFLOW DEVICE AND TWO-WAY CLEANOUT



PLAN
NOT TO SCALE


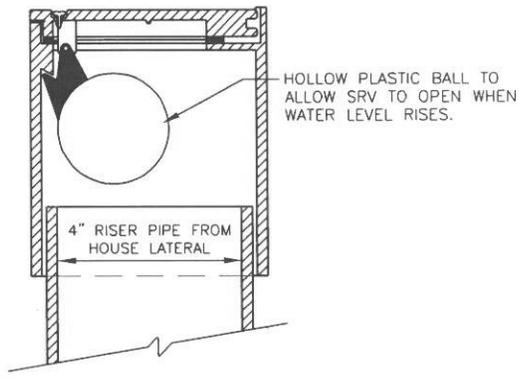


SECTION A-A
NOT TO SCALE

NOTE:
INSTALL THE SEWER RELIEF VALVE IN A LEVEL POSITION ABOVE A STANDARD TWO-WAY CLEANOUT SUCH THAT THE TOP OF THE RELIEF VALVE COVER IS LOWER THAN THE ELEVATION OF THE LOWEST PLUMBING FIXTURE ATTACHED TO THE BUILDING DRAINS.


SEWER RELIEF VALVE

- NOTES:
1. WHEN AN OVERFLOW DEVICE IS REQUIRED AT THE PROPERTY LINE OR DRIVEWAY, THE SEWER RELIEF VALVE SHALL BE INSTALLED IN A CONCRETE BOX.
 2. APPROVED CONCRETE BOXES ARE:
 - a) CHRISTY CONCRETE PRODUCTS: V9 RECTANGULAR DRAIN BOX WITH V9-71C GRATE LID
 - b) CHRISTY CONCRETE PRODUCTS: V1 CIRCULAR DRAIN BOX WITH A V1-71C GRATE LID

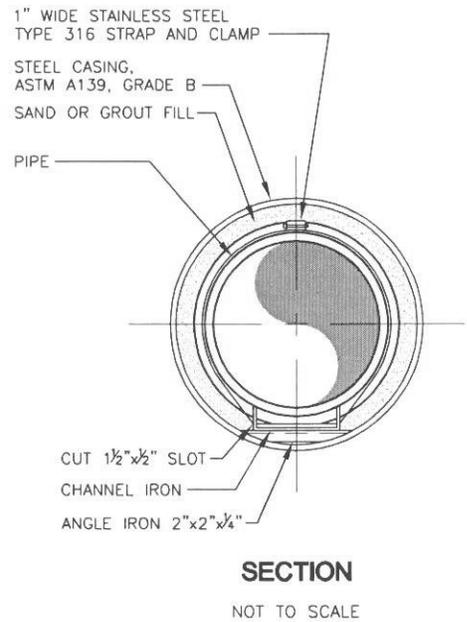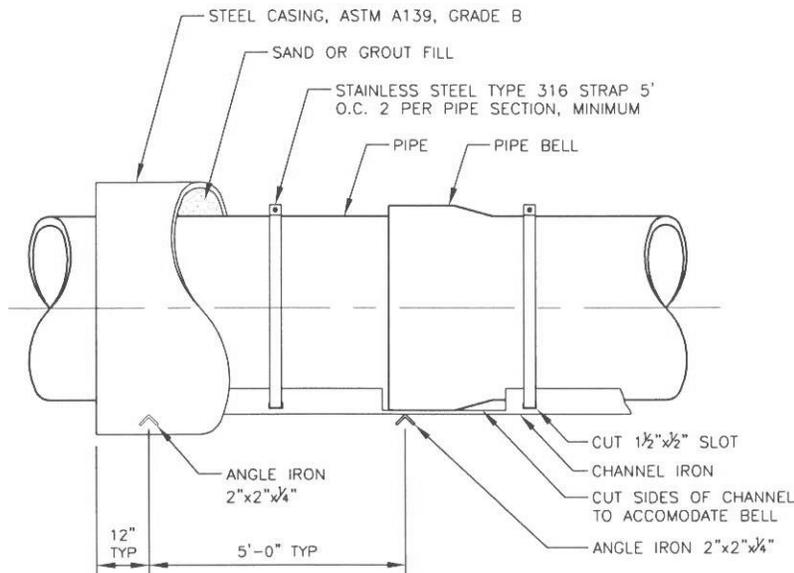

TYPICAL CASING PIPE DETAIL

NOT TO SCALE

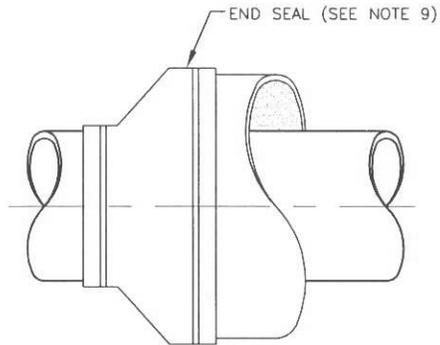

END SEAL

NOT TO SCALE

NOTES:

1. CASING SHALL BE STEEL, ASTM A139, GRADE B, MINIMUM ½" NOMINAL THICKNESS. CASING INSIDE DIAMETER SHALL BE 30" OR 12" LARGER THAN OUTSIDE DIAMETER OF CARRIER PIPE BELL, WHICHEVER IS GREATER.
2. EACH CASING JOINT SHALL BE WELDED ALL AROUND.
3. CASING SHALL BE INSTALLED BY JACKING AND BORING.
4. ANNULAR SPACE BETWEEN INSIDE OF CASING AND OUTSIDE OF CARRIER PIPE SHALL BE COMPLETELY FILLED WITH CLEAN DRY SAND OR GROUT PER SPECS. PROVIDE 1" MINIMUM CLEARANCE BETWEEN CASING AND CARRIER PIPE.
5. CARRIER PIPE AND CHANNEL WILL BE SUPPORTED BY ANGLE IRON WELDED TO THE INNER WALL OF CASING. CARRIER PIPE SHALL BE LAID SUCH THAT AN EVEN GRADE IS PROVIDED.
6. CHANNEL SECTIONS SHALL BE WELDED TO FORM CONTINUOUS CHANNEL. MAX ALLOWABLE UNSUPPORTED LENGTH OF CHANNEL IN CASING IS 5'-0". CHANNEL SHALL BE WELDED TO ANGLE IRON AT ENDS OF CASING ONLY.
7. CHANNEL SIDES SHALL BE CUT TO PROVIDE MIN. ⅛" CLEARANCE BETWEEN CHANNEL AND BELL END OF PIPE. PIPE SHALL NOT BE SUPPORTED BY BELL END OF PIPE.
8. PROVIDE ANGLE IRON MAX. 1'-0" FROM ENDS OF CASING.
9. END SEAL SHALL BE ⅛" THICK NEOPRENE RUBBER WITH TYPE 316 STAINLESS STEEL STRAPS.

Date 5-12-06 Detail No. 26
 Approved By *Richard B. Currie*
 RICHARD B. CURRIE, RCE 31587



UNION SANITARY DISTRICT

STANDARD PIPE CASING

26

INDEX

----- **A** -----

Abandonments 11.10
 Building Sewer 11.10(b)
 Main Sewer 11.10(a)
 Manhole 11.10(c)
 Septic Tank 11.10(d)

Abbreviations 2.02
 Pipe Types 2.03

Acceptance
 of construction 19
 of building sewer 19.02
 of main sewers 19.01

Access
 to fire hydrants, water gates, meters
 And private driveways 8.02(h)
 to job site 11.01(c)

Adjustments
 to existing main sewers or appurtenances 11.09, 17.02

Air Testing
 Building sewers 12.02
 Main sewers 12.01

Alignment
 Allowable deviation 7.01(b)
 Of building sewers 22.03
 Of main sewers 21.04

Alterations
 Engineer's right 11.02

Approval, of construction
 Building sewers 19.02
 Main sewers 19.01

----- **B** -----

Backwater Devices
 Building sewers 22.20

Blasting 8.02(f)

Bore
 For building sewer pipe 7.09

Bracing	
For trenches	8.02(e)
Building sewer	
Abandonment of,	11.10(a)
Alignment of,	22.03
Approval and acceptance of,	19.02
Cleanout to grade.....	7.05, 22.19(b)(c)
Clearance between utilities	22.12
Connection to existing building sewer.....	22.10
Connection to building drain (kick out)	22.11
Connection to existing main sewer	22.08
Crossing utilities	22.14
Curb marking.....	11.06, 22.07
Easement requirements	16.11
Grade	22.05
Grade stakes.....	22.06
Location parallel to building footing.....	22.13
Minimum pipe cover	22.16
Number required	17.06
Plans	16.09
Pipe materials	22.02
Private manhole	22.19(a)
Repair of,	11.08(c), 17.03
Relocation of,	17.03
Structure type.....	22.19
Test wye.....	7.07, 22.19(d)
Testing of,	12.02
Two way cleanout to grade	7.06, 22.19(c)
Use of existing,.....	11.05

----- C -----

Casing	
Sewer through,.....	7.08
Cleaning	
Discharge of cleaning water.....	14.02
Sewer pipe	14.01
Cleanup	
Site	15.01
Cleanout	
To grade.....	22.19(b)
Two way to grade.....	22.19(c)
Clearance	
Crossing other utilities (private sewer)	22.12
Horizontal between other utilities (main sewer)	21.11
Horizontal between other utilities (private sewer)	22.18

Commencement	
New sewer pipe line	7.01(h)
Compaction	
Trench	9.05(c)
Connection	
To building drain (plumbing kick-out)	22.11
To existing building sewer	17.03, 22.10
To existing main sewer or appurtenances	17.02, 21.18, 22.08
Construction Permit Requirements	
Annexation policy	16.01, 16.05(a)
Bond	16.04
Developer deposit	16.07
Contractor's license	16.03
Fees and charges	16.05
Plans for main sewers	16.08
Plans for building sewers	16.09
Couplings	
Pipe	5.03
Cover	
Minimum pipe	21.09
Cross-connection	
Main sewers	21.05
Curb Marking	22.07
Cut sheets	18.02
----- D -----	
Damage to District Facilities	
Repair costs	17.03
Defective	
Work or materials	11.03
Definitions and Terms	2.01
Deflectometer	
Test	12.01(e)
Design Depth	
Main sewers	21.08
Details	
Construction (required)	20.02

Dewatering	
Sewer subgrade	8.02(g)

----- E -----

Easement Requirements	
Building sewers	16.11
Main sewers	16.08(d)
Paving requirements	21.25
Width requirements	21.24

Embedment	
Requirement for,	5.05
Specifications for,	9.04

Existing sewer	
Verification of location and elevation.....	7.01(g)

Excavation	
Definition	8.01

----- F -----

Fees	
Payment before approval	16.05

----- G -----

Grade	
Allowable deviation of,	7.01(b)
Building sewers	22.05
Main sewers	21.06

Grade Stakes	
Building sewers	22.06
Main sewers	21.07

Grade Line	
Laser	7.01(c)
String line	7.01(d)

Grout	6.02
-------------	------

Guarantee of Work.....	3.02
------------------------	------

----- I -----

Import Material	
Type "A"	9.04(a)(1)
Type "B"	9.04(a)(2)

Inspection	
Access to work site	11.01(c)

Conformance to specifications	11.01(a)
Notification of construction work	18.03
Television	13

----- J -----

Joint Deflection	
Limitation	7.01(f)

----- L -----

Lasers	7.01(c),7.01(d)
--------------	-----------------

----- M -----

Mandrel	
Test	12.01(e)

Manhole	
Abandonment	11.10(c)
Base block, poured concrete	7.03(a)
Base block, precast concrete	7.03(b)
Bolt-down cover	21.23
Castings	7.03(d)
Collar	7.03(f)
Connection of building sewer	21.18
Connection of sewer stubs	21.20
Deflection, maximum of sewer pipes	21.17
Drop	7.03(c), 21.22
Elevations of sewer pipes	21.16
Locations of,	21.15
Marking	11.07
Rim elevation	21.19
Private	22.19(a)
Protection	11.04
Sewer pipes through	7.01(i)
Shaft, precast concrete	7.03(b)
Steps	7.03(e)

Mortar	6.02
--------------	------

Materials of Construction	
Concrete	6.01
Cleanout to Grade	7.05
Embedment	9.04
Existing building sewers	11.05
Manhole	7.03
Mortar	6.02
Pipe	5.02, 21.01, 22.02
Riser	7.04
Rock ballast	9.02
Steel casing	7.08

----- P -----

Paving Replacement
Definition 10.01
Easements 10.02, 10.03
Private property..... 10.03
Public rights-of-way..... 10.02
Utility easements..... 10.02

Permits
City building..... 16.12
Sewer construction..... 18.01
Waste discharge report..... 16.05(j)

Pipe
Acrylonitrile-butadiene-styrene (ABS) 5.02(b)(1)
Cast iron (CIP) 5.02(a)(3)
Ductile iron (DIP)..... 5.02(a)(2)
Embedment..... 9.04
Field cutting..... 7.01(m)
Flexible..... 5.02(b)
Foundation
 Rock ballast..... 9.02
Ground to be filled for cover..... 7.01(k)
Handling of..... 7.01(l)
Material (building sewer) 22.02
Material (main sewer)..... 21.01
Material change (main sewer)..... 21.02
Minimum cover (building sewer) 22.16
Minimum cover (main sewer) 21.09
Poly vinyl chloride (PVC)..... 5.02(b)(2)
Splice 7.02
Vitrified Clay (VCP) 5.02(a)(1)

Plans
Building sewer..... 16.09
Main sewer..... 16.08

Plugs
Sewer pipe 7.01(e)

Preparation
Site 4.01

----- Q -----

Quitclaim
Requirements..... 16.08(e)

----- R -----

Relocation
Existing building sewer..... 11.08(c), 17.03

Existing main sewer	11.08(b), 17.01
New building sewer	11.08(a)
Other agency facilities.....	11.08(d)
Restoration	
Site	15.01
Riser	
Casting.....	7.04(b)
Shaft.....	7.04(a)
Rock Ballast	
Pipe foundation	9.02
----- S -----	
Saddle	
Pipe	5.04
Septic Tanks	
Abandonment.....	11.10(d)
Sewer Line	
Commencement of new	7.01(h)
Shoring.....	8.02(e)
Size and Slope (pipe)	
Building sewer.....	22.01
Main sewer.....	21.03
Specifications and Details.....	20
Splice	7.02
Staking	
Construction	7.01(a), 18.02
Storm Drain Crossings	
Building sewer.....	22.14
Main sewer.....	21.12
Structure	
Type and location.....	22.19
Surveying Instruments	7.01(c), 7.01(d)

----- **T** -----

Television Inspection	13
Testing	
Building sewer.....	12.02

Main sewer.....	12.01
Pressure sewer.....	12.03
Test Wye	
Building sewer.....	22.19(d)
Trench	
Backfilling.....	9
Definition.....	9.01
Material	
Above pipe embedment.....	9.04
Compaction.....	9.05(c)
Intersections.....	21.10, 22.17
Trenching	
Access to private drives.....	8.02(h)
Blasting.....	8.02(f)
Bracing and shoring.....	8.02(e)
Compaction.....	8.02(d)
Contractor's responsibility.....	8.02(j)
Mud or soft or spongy material.....	8.02(a)
Open trench permitted.....	8.02(i)
Open trenching required.....	8.02
Over-excavated areas.....	8.02(c)
Rock.....	8.02(b)
Sewer subgrade dewatering.....	8.02(g)
----- V -----	
Verification	
Of existing sewer or structure.....	7.01(g)
----- W -----	
Work	
Scope of.....	3.01
Work Order	
Signed by responsible party.....	17.03
Emergency repair.....	17.03